

ASME A17.6-2017
(Revision of ASME A17.6-2010)

Standard for Elevator Suspension, Compensation, and Governor Systems

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6-2017

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

ASME A17.6-2017
(Revision of ASME A17.6-2010)

Standard for Elevator Suspension, Compensation, and Governor Systems

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6-2017

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

Date of Issuance: August 6, 2018

The next edition of this Standard is scheduled for publication in 2022.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. Interpretations are published on the ASME website under the Committee Pages at <http://cstools.asme.org/> as they are issued.

Errata to codes and standards may be posted on the ASME website under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting "Errata" in the "Publication Information" section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

The American Society of Mechanical Engineers
Two Park Avenue, New York, NY 10016-5990

Copyright © 2018 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All rights reserved
Printed in U.S.A.

CONTENTS

Foreword	v
Committee Roster	vi
Preface	xv
Summary of Changes	xvii
Part 1 Stranded Carbon Steel Wire Ropes for Elevators	1
Section 1.1 Scope	1
Section 1.2 References	1
Section 1.3 Terminology	2
Section 1.4 Material	7
Section 1.5 Rope Workmanship and Finish	8
Section 1.6 Properties and Tolerances of Newly Constructed Rope	8
Section 1.7 Testing and Compliance for Newly Constructed Rope	10
Section 1.8 Ordering Information	12
Section 1.9 Packaging and Identification	12
Section 1.10 Replacement Criteria	12
Part 2 Aramid Fiber Ropes for Elevators	16
Section 2.1 Scope	16
Section 2.2 References	16
Section 2.3 Terminology	16
Section 2.4 Material	18
Section 2.5 Properties and Tolerances of Newly Constructed Rope	18
Section 2.6 Newly Constructed Rope Dimensions for Circular Cross-Section Designs (Type I)	19
Section 2.7 Newly Constructed Rope Dimensions for Noncircular Cross-Section Designs (Type II)	19
Section 2.8 Testing and Compliance	19
Section 2.9 Replacement Criteria	20
Part 3 Noncircular Elastomeric-Coated Steel Suspension Members for Elevators	22
Section 3.1 Scope	22
Section 3.2 References	22
Section 3.3 Terminology	22
Section 3.4 Material	23
Section 3.5 Properties and Tolerances	23
Section 3.6 Testing and Compliance	24
Section 3.7 Replacement Criteria	24
Mandatory Appendix	
I Rope Classifications Used in Part 1	26

Nonmandatory Appendix

A	Inspection and Replacement of Steel Wire Ropes	34
---	--	----

Figures

1.3.1.1-1	Elements of Stranded Steel Wire Rope	2
1.3.1.3.2-1	Round Strand	3
1.3.1.3.2-2	Compacted Round Strand: Before and After Compacting	3
1.3.1.3.3-1	Lay Direction of Strands for Stranded Ropes	3
1.3.1.3.4-1	Seale Construction (e.g., 19S, 9-9-1)	3
1.3.1.3.4-2	Warrington Construction [e.g., 19W, (6+6)-6-1]	3
1.3.1.3.4-3	Filler Construction (e.g., 25F, 12-6F-6-1)	3
1.3.1.4-1	Examples of Cores	4
1.3.2.4.2-1	Regular (Ordinary) Lay and Lang Lay	5
1.3.3.1.1-1	Diameter of Round Rope	5
1.3.3.2.1-1	Strand Lay Length	5
1.3.3.2.2-1	Rope Lay Length	6
A-1	Inspection and Replacement of Steel Wire Rope(s)	35

Tables

1.4.1-1	Wire Level or Tensile Strength Grades for Given Rope Grades	7
1.4.1.1-1	Wire Level or Tensile Strength Grade Requirements	8
1.4.1.1-2	Wire Torsion Requirements	8
1.6.4.1-1	Weight of Coating for Final-Galvanized or Final-Coated Zn-5Al-MM Rope Wire for Newly Constructed Rope	10
1.6.4.1-2	Weight of Coating for Drawn-Galvanized or Drawn-Coated Zn-5Al-MM Rope Wire for Newly Constructed Rope	10
1.6.6.1.1-1	Tolerances on Rope Diameter (Stranded Rope) for Newly Constructed Rope With Cores of Fiber or Other Nonmetallic Materials	10
1.6.6.1.1-2	Tolerances on Rope Diameter (Stranded Rope) for Newly Constructed Rope With Steel or Steel-Based Composite Cores	11
1.6.6.1.2-1	Permissible Differences in Rope Diameter for Newly Constructed Rope	11
1.8.1-1	Ordering Information	13
1.10.1.2-1	Wire Breaks: Crown Wire Breaks Per Lay Length	14
1.10.3-1	Minimum Diameter	15
2.4.1.1-1	Nominal Aramid Yarn Property Values	18
2.4.1.1-2	Aramid Resin Impregnated Strand Property Values	18
2.6.2-1	Tolerances on Diameter	19
2.7.2-1	Tolerances on Dimensions	20
3.5.7-1	Tolerances on Nominal Noncircular Elastomeric-Coated Steel Suspension Members Sizes . .	24
I-1.1-1	Classification 6 × 19 FC, Round Strand, Fiber Core or Polymer Core	27
I-1.1-2	Classification 8 × 19 FC, Round Strand, Fiber Core or Polymer Core	29
I-1.1-3	Classification 8 × 19, Round Strand, Steel Core	31
I-1.1-4	Classification 6 × 19, Round Strand, Steel Cores	33

FOREWORD

This is the second edition of a Standard for elevator suspension and compensation systems as well as ropes for governor applications. This Standard has been developed by the American Society of Mechanical Engineers (ASME) to provide guidance to the elevator industry for the appropriate use of means for suspension, compensation, and governors. The second edition includes standards for three technologies for elevators, namely: steel wire ropes, aramid fiber ropes, and noncircular elastomeric-coated steel suspension members. Uniform standards for these important items are necessary to ensure consistent levels of safety and to provide guidance for the manufacturers of these items as well as the designers, manufacturers, installers, maintainers, and inspectors of elevator equipment.

As other technologies emerge and are deemed to be suitable for similar applications, this Standard will be expanded to include criteria for their usage.

In developing this Standard, experts were assembled from the steel wire rope, aramid fiber rope, and noncircular elastomeric-coated steel suspension members engineering and manufacturing fields. Relevant existing standards were studied during the development of this Standard and are referenced where appropriate. The scope of this Standard covers North American and international requirements in a comprehensive manner and does not conflict with existing American or international standards. This Standard is intended to be used in conjunction with the ASME A17.1/CSA B44, Safety Code for Elevators and Escalators, and related Codes and standards.

Steel Wire Rope for Elevators. Steel wire rope has been used for many years in the elevator industry, for suspension, compensation, and governor applications.

Due to the large range of applications in this diverse market, many variations of steel wire ropes are in current use. Examples include rope of regular and lang lay, left and right lay, preformed and nonpreformed. Such ropes may be of a variety of wire materials, from iron to high tensile steel and may be of corrosion resistant construction. Various core materials including natural and synthetic fiber and steel may also be used. Nominal imperial dimensions as well as SI dimensional ropes are used.

In recognition of the importance of this vital elevator component and the unique practices of the North American industry, this Standard was developed. This Standard covers the current applications and provides strength and material criteria as well as testing, compliance, inspection, replacement, and ordering information. Imperial and SI dimensions are addressed in the Standard. The purpose of this Standard is to enhance public safety and to provide guidance to manufacturers and users of steel wire rope.

Aramid Fiber Ropes and Elastomeric-Coated Steel Belts. With the appearance in the market place of new suspension and compensation means technologies, such as aramid fiber ropes and noncircular elastomeric-coated steel suspension members for elevators, the need for standards that will ensure the safe application of these items became evident. This Standard addresses these important technologies.

In developing the standards, extensive test results were studied and the properties and durability of the new suspension and compensation means were examined. The work included visits to major laboratories at which all aspects of the noncircular elastomeric-coated steel suspension members were tested.

The work included a visit to the factory of a major manufacturer of aramid fiber and technical presentations by experts in this technology. The test work of a major laboratory and field results from the application of aramid fiber rope on elevators were also studied.

Test facilities where the noncircular elastomeric-coated steel suspension members were extensively tested on elevators were also visited. In addition, technical presentations on the noncircular elastomeric-coated steel suspension members regarding their construction and testing took place.

Tests on both aramid fiber ropes and noncircular elastomeric-coated steel suspension members included life, durability, resistance to damage, traction, replacement criteria, effects of the environment, and many other criteria. This work was extremely helpful in developing the standards and building confidence in the validity of the requirements.

ASME A17.6-2017 was approved by the American National Standards Institute on September 29, 2017.

ASME A17 ELEVATOR AND ESCALATOR COMMITTEE

(September 2017)

STANDARDS COMMITTEE

J. W. Coaker, *Chair*, Coaker & Co., PC
R. E. Baxter, *Vice Chair*, Baxter Residential Elevators, LLC
H. E. Peelle III, *Vice Chair*, The Peelle Company Ltd.
S. P. Reynolds, *Alternate*, The Peelle Company Ltd.
G. A. Burdeshaw, *Staff Secretary*, The American Society of Mechanical Engineers
E. V. Baker, IUEC
M. D. Morand, *Alternate*, QEITF
T. D. Barkand, U.S. Department of Labor
L. Bialy, Otis Elevator Co.
B. Blackaby, Otis Elevator Co.
K. L. Brinkman, Kevin L. Brinkman & Associates
J. Brooks, Wagner Consulting Group, Inc.
R. C. Burch, GAL Manufacturing Corp.
D. A. Witham, *Alternate*, GAL Manufacturing Corp.
J. Filippone, Port Authority of New York and New Jersey
K. P. Morse, *Alternate*, NAVFAC
R. A. Gregory, Vertex Corp.
P. S. Rosenberg, *Alternate*, Performance Elevator Consulting, LLC
P. Hampton, ThyssenKrupp Elevator Manufacturing, Inc.
J. D. Henderson, *Alternate*, ThyssenKrupp Elevator Manufacturing, Inc.

J. T. Herrity, NAVFAC
D. A. Kalgren, Kone, Inc.
D. S. Boucher, *Alternate*, Kone, Inc.
J. W. Koshak, Elevator Safety Solutions, LLC
H. Simpkins, *Alternate*, ThyssenKrupp Elevator Co.
R. Kremer, Technical Standards & Safety Authority
D. McColl, Otis Canada, Inc.
D. McLellan, Technical Standards & Safety Authority
J. L. Meyer, National Elevator Inspection Services
J. Rearick, Rearick & Company, Inc.
A. Rehman, Schindler Elevator Corp.
J. W. Blain, *Alternate*, Schindler Elevator Corp.
V. P. Robibero, Schindler Elevator Corp.
J. Carlson, *Alternate*, Schindler Elevator Corp.
C. W. Rogler, State of Michigan
R. S. Seymour, Robert L. Seymour & Associates, Inc.
R. D. Shepherd, NAESA International
W. M. Snyder, VTE Solution, LLC
M. H. Tevyaw, MHT Codes & Consulting
D. L. Turner, Davis L. Turner & Associates, LLC
J. Xue, *Delegate*, Shanghai Institute of Special Equipment Inspection and Technical Research

EX-OFFICIO MEMBERS

G. A. Burdeshaw, *Staff Secretary*
B. Blackaby
J. Brooks
J. R. Carrick

J. Filippone
J. W. Koshak
N. J. Montesano
S. P. Reynolds

HONORARY MEMBERS

G. A. Burdeshaw, *Staff Secretary*
L. Blaiotta
E. A. Donoghue
B. J. Fanguy
C. E. Hempel
C. L. Kort

A. A. Mascone
Z. R. McCain, Jr.
E. M. Philpot
R. L. Rogers
L. E. White

REGULATORY ADVISORY COUNCIL

D. McLellan, *Chair*
J. L. Borwey, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
G. D. Barnes
G. E. Brewer
G. R. Brown
D. Bruce
J. H. Burpee
J. R. Calpini

P. Caploon
R. Capuani
J. Day
N. C. Dimitruck
M. Dorosk
K. Dunbar
C. Gardiner
L. A. Giovannetti
J. M. Gould

W. J. Hartung
D. J. Hedgecock
S. J. Hickory
D. Holmes
G. Johnson
D. Leopard
S. MacArthur
C. C. Mann
P. L. McClare
S. Mercier
K. P. Morse
M. E. Pedersen
M. R. Poulin
W. J. Reinke

J. P. Roche
K. R. Steeves
J. Stewart
M. K. Stewart
S. F. Stout
D. Tudor
C. Updyke
L. E. Watson
W. C. Watson
W. J. Witt
D. L. Barker, *Alternate*
D. Melvin, *Alternate*
R. E. Kaspersma, *Contributing Member*
R. D. Shepherd, *Contributing Member*

INTEREST REVIEW GROUP

G. A. Burdeshaw, *Staff Secretary*
J. P. Andrew
D. M. Begue
R. J. Blatz
M. T. Brierley
B. B. Calhoun
J. A. Caluori
C. S. Carr
M. A. Chavez
R. F. Dieter
B. Faerber
H. S. Frank
L. A. Giovannetti
J. M. Gould
S. H. Grainer
D. L. Harris
N. R. Herchell
J. E. Herwig
R. Howkins
J. M. Imgarten
J. Inglis
T. Isaacs
Q. JianXiong

F. A. Kilian
M. Krstanoski
M. L. Lane
W. R. Larsen
M. A. Malek
J. J. Mancuso
C. C. Mann
D. Mason
J. L. Meyer
T. S. Mowrey
F. G. Newman
J. W. O'Boyle
J. J. O'Donoghue
B. Peyton
M. J. Pfeiffer
P. M. Puno
L. S. Rigby
J. R. Runyan
R. D. Schloss
S. Shanes
J. L. Stabler
D. M. Stanlaske
L. M. Taylor

B44.1/A17.5 ELEVATOR AND ESCALATOR ELECTRICAL EQUIPMENT COMMITTEE

M. L. Hite, *Chair*
M. A. Mueller, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
P. Gulletson, *Secretary*
J.-M. Aitamurto
J. W. Blain
J. D. Busse
J. Caldwell
S. J. Carlton
J. L. Della Porta
R. Garcia
B. J. Mierzejewski
M. Mihai

C. R. Woo
L. Yang
P. D. Barnhart, *Alternate*
K. Chieu, *Alternate*
J. Kleine, *Alternate*
P. F. McDermott, *Alternate*
B. Shah, *Alternate*
O. Simonetta, *Alternate*
S. Feng, *Contributing Member*
B. T. Irmscher, *Contributing Member*
J. H. Shull, *Contributing Member*
R. S. Williams, *Contributing Member*

CODE COORDINATION COMMITTEE

K. L. Brinkman, *Chair*
V. P. Robibero, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
L. Bialy
B. Horne

J. Koshak
M. A. Mueller
A. J. Shelton
B. Tubbs
J. W. Blain, *Alternate*

K. Paarlberg, *Alternate*
R. Bukowski, *Contributing Member*
P. Caploon, *Contributing Member*

R. Cote, *Contributing Member*
G. W. Gibson, *Contributing Member*
J. Xue, *Contributing Member*

DUMBWAITER AND ATD COMMITTEE

J. B. Peskuski, *Chair*
D. C. Witt, *Vice Chair*
G. Bolan, *Staff Secretary*
E. Dominguez, *Staff Secretary*
N. G. Soto
R. A. Gregory

R. Helps
F. M. Hoch
J. Woolford
G. Ziebell
S. D. Holat, *Alternate*
B. P. McCune, *Alternate*

EARTHQUAKE SAFETY COMMITTEE

W. C. Schadrack III, *Chair*
B. Blackaby, *Vice Chair*
N. Gomez, *Staff Secretary*
G. W. Gibson
A. Jahn
M. J. Leonard
R. Lorenzo
J. L. Meyer
W. C. Ribeiro

A. J. Shelton
M. J. Smith
R. Taylor
D. A. Kalgren, *Alternate*
R. K. Leckman, *Alternate*
M. A. Mueller, *Alternate*
J. A. Varona, *Alternate*
A. J. Schiff, *Contributing Member*

EDITORIAL COMMITTEE

D. McColl, *Chair*
G. A. Burdeshaw, *Staff Secretary*
K. L. Brinkman

J. Filippone
R. S. Hultstrom
M. A. Mueller

ELECTRICAL COMMITTEE

B. Blackaby, *Chair*
J. W. Blain, *Vice Chair*
J. D. Henderson, *Vice Chair*
G. Bolan, *Staff Secretary*
E. Dominguez, *Staff Secretary*
T. D. Barkand
P. D. Barnhart
R. C. Burch
J. D. Busse
J. Caldwell
J. L. Della Porta
J. P. Donnelly
W. J. Hartung
G. N. Henry
D. Holloway
J. Kleine
P. F. McDermott
M. Mihai
P. Ojapalo
B. Ortiz
A. L. Peck

D. K. Prince
C. Ramirez Woo
V. P. Robibero
J. R. Valone
S. P. Wood
L. Yang
G. Zogbi
J. Carlson, *Alternate*
B. C. Castillo, *Alternate*
P. C. Hoppie, *Alternate*
C. Mason, *Alternate*
N. J. McCann, *Alternate*
B. J. Mierzejewski, *Alternate*
E. R. Nickens, *Alternate*
I. E. Rebhi, *Alternate*
S. H. Benjamin, *Contributing Member*
R. Elias, *Contributing Member*
M. L. Hite, *Contributing Member*
Y. C. Ho, *Contributing Member*
D. Morris, *Contributing Member*
P. M. Puno, *Contributing Member*

ELEVATORS USED FOR CONSTRUCTION COMMITTEE

C. W. Rogler, *Chair*
G. A. Burdeshaw, *Staff Secretary*
R. E. Baxter

R. A. Gregory
J. A. Lowery, Jr.
N. B. Martin

EMERGENCY OPERATIONS COMMITTEE

D. McColl, *Chair*
S. R. James, *Vice Chair*
G. Bolan, *Staff Secretary*
E. Dominguez, *Staff Secretary*
D. Anderson
D. R. Beste
D. S. Boucher
K. L. Brinkman
R. C. Burch
J. C. Carlson
D. P. Finnegan
R. B. Fraser
J. D. Henderson
C. Koenig
J. Latham
S. A. Morse
T. F. Norton
J. J. O'Donoghue
D. K. Prince
P. D. Rampf
V. R. Reisinger III
S. Sears
D. C. Witt
T. D. Gervais, *Alternate*
J. Kleine, *Alternate*
B. M. Krishnan, *Alternate*

K. Moody, *Alternate*
J. K. O'Donnell, *Alternate*
G. M. Rees, *Alternate*
R. Reiswig, *Alternate*
J. W. Stockstill, *Alternate*
D. A. Witham, *Alternate*
M. Abbott, *Contributing Member*
T. Bitz, *Contributing Member*
M. T. Brierley, *Contributing Member*
M. W. Bunker, Jr., *Contributing Member*
J. Canty, *Contributing Member*
P. Caploon, *Contributing Member*
G. B. Cassini, *Contributing Member*
C. S. Dart, *Contributing Member*
D. Holmes, *Contributing Member*
J. A. Marinelli, *Contributing Member*
M. Martin, *Contributing Member*
B. F. O'Neill, *Contributing Member*
W. Ouyang, *Contributing Member*
A. Rehman, *Contributing Member*
L. F. Richardson, *Contributing Member*
R. J. Roux, *Contributing Member*
J. K. Schimeck, *Contributing Member*
M. H. Tevyaw, *Contributing Member*
S. Weiss-Ishai, *Contributing Member*

ESCALATOR AND MOVING WALK COMMITTEE

D. L. Turner, *Chair*
T. R. Nurnberg, *Vice Chair*
R. Mohamed, *Staff Secretary*
P. R. Bothwell
S. Broder
C. S. Carr
N. Chahal
D. R. Evans
J. A. Fernandez Fidalgo
K. G. Hamby
H. A. Hausmann
B. Horne
J. A. Kinahan
T. F. Martel
N. J. McCann
D. McLellan

A. Morris
R. D. Shepherd
R. C. Shumate
K. J. Smith
J. L. Stabler
P. Velasquez, Jr.
D. Winkelhake
C. Anayiotos, *Alternate*
T. P. Kenny, *Alternate*
T. Lee, *Alternate*
M. A. Mueller, *Alternate*
D. E. Rush, *Alternate*
P. L. Edwards, *Contributing Member*
J. Filippone, *Contributing Member*
H. Shi, *Contributing Member*
J. Xue, *Contributing Member*

GUIDE FOR EMERGENCY PERSONNEL

R. S. Seymour, *Chair*
R. D. Shepherd, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
J. R. Brooks
J. Day
G. DeCola
D. McLellan
J. L. Meyer

C. W. Rogler
D. L. Turner
D. P. Cook, *Contributing Member*
C. S. Dart, *Contributing Member*
D. L. Flint, *Contributing Member*
J. J. O'Donoghue, *Contributing Member*
J. K. Schimeck, *Contributing Member*

EXISTING INSTALLATIONS COMMITTEE

D. B. Labrecque, *Chair*
R. E. Baxter, *Vice Chair*
J. S. Rearick, *Vice Chair*
N. Gomez, *Staff Secretary*
J. M. Block
C. Buckley
J. D. Carlisle, Jr.
J. Day
C. J. Duke
J. R. Freeman
A. T. Gazzaniga
R. A. Gregory
S. S. Greywall
R. Haynes
R. Kremer
D. P. Lloyd
G. M. Losey
B. S. McCue
P. McPartland
R. C. Morrical
G. L. Nyborg III
N. Ortiz
S. A. Quinn
P. Reid

V. P. Robibero
R. T. Shanklin
R. D. Shepherd
J. L. Stabler
D. M. Stanlaske
G. Stiffler
J. W. Stockstill
H. M. Vyas
T. Waardenburg
J. Bera, *Alternate*
P. Hampton, *Alternate*
D. Keller, *Alternate*
K. S. Lloyd, Jr., *Alternate*
M. D. Morand, *Alternate*
D. J. Winslow, *Alternate*
J. H. Butler, *Contributing Member*
G. B. Cassini, *Contributing Member*
J. T. Herrity, *Contributing Member*
Z. R. McCain, Jr., *Contributing Member*
N. R. Mistry, *Contributing Member*
A. J. Saxer, *Contributing Member*
D. L. Turner, *Contributing Member*
P. J. Welch, *Contributing Member*

HAND AND SIDEWALK ELEVATOR COMMITTEE

N. J. Montesano, *Chair*
G. A. Burdeshaw, *Staff Secretary*
V. G. Bahna
R. Carter
J. Doyle
J. Duffy

G. Greenberg
E. L. Krull, Jr.
C. P. Robinson
G. West
B. Casas, *Alternate*

HOISTWAY COMMITTEE

D. S. Boucher, *Chair*
H. E. Peelle III, *Vice Chair*
G. Bolan, *Staff Secretary*
E. Dominguez, *Staff Secretary*
L. J. Blaiotta, Jr.
K. L. Brinkman
R. C. Burch
A. S. Conkling
H. J. Gruszynski
E. A. Heath III
D. McColl
S. A. Morse
G. L. Nuschler
A. Rehman
V. R. Reisinger III
S. P. Reynolds
S. Sears
H. Simpkins
J. W. Stockstill
D. C. Witt
L. Bialy, *Alternate*

L. Blaiotta, Sr., *Alternate*
T. D. Gervais, *Alternate*
J. D. Henderson, *Alternate*
B. Horne, *Alternate*
F. Leo, *Alternate*
W. M. Miller, *Alternate*
K. Moody, *Alternate*
D. K. Quinn, *Alternate*
D. A. Witham, *Alternate*
J. Cole, *Contributing Member*
G. W. Gibson, *Contributing Member*
J. L. Harding, *Contributing Member*
D. Holmes, *Contributing Member*
J. A. Marinelli, *Contributing Member*
A. Morris, *Contributing Member*
M. H. Tevyaw, *Contributing Member*
S. Weiss-Ishai, *Contributing Member*
L. C. Woods, *Contributing Member*
O. Y. Zhang, *Contributing Member*
W. Ziegert, *Contributing Member*

HYDRAULIC COMMITTEE

H. Simpkins, *Chair*
R. S. Hultstrom, *Vice Chair*
A. L. Guzman Rodriguez, *Staff Secretary*
D. M. Begue
L. Bialy
S. A. Bruno
B. Horne
C. B. Jackson
J. W. Koshak
M. G. Miller
T. S. Mowrey
M. J. Paschke

A. Rehman
L. S. Rigby
J. L. Shrum
J. W. Stockstill
B. Giddens, *Alternate*
K. A. Grunden, *Alternate*
A. M. McClement, *Alternate*
P. E. A. Burge, *Contributing Member*
H. A. Hammerstrom, *Contributing Member*
A. Jahn, *Contributing Member*
C. W. Rogler, *Contributing Member*

INCLINED ELEVATOR COMMITTEE

J. R. Carrick, *Chair*
G. A. Burdeshaw, *Staff Secretary*
M. J. Botzet

J. T. Herrity
R. D. Shepherd
J. S. Rearick, *Contributing Member*

INSPECTIONS COMMITTEE

M. H. Tevyaw, *Chair*
J. R. Runyan, *Vice Chair*
R. Mohamed, *Staff Secretary*
G. Antona
C. Archer
R. E. Baxter
R. D. Bell
D. S. Boucher
K. L. Brinkman
J. R. Brooks
C. Buckley
J. W. Coaker
S. Cowen
J. Day
G. DeCola
M. V. Farinola
J. Filippone
K. J. Garst
P. Hampton
H. Z. Hamze
R. Haynes
K. Heling
J. T. Herrity
R. S. Hultstrom
J. J. Knolmayer
N. Martin
C. McDilda
D. McLellan
M. J. Mellon, Jr.
M. D. Morand
E. R. Nickens

A. Rehman
C. W. Rogler
R. D. Schloss
R. S. Seymour
R. D. Shepherd
F. C. Slater
A. Smith
M. P. Snyder
W. M. Snyder
D. M. Stanlaske
S. Swett
D. J. Winslow
C. S. Carr, *Alternate*
S. Collins, *Alternate*
P. Donigain, *Alternate*
C. J. Duke, *Alternate*
T. D. Gervais, *Alternate*
E. McGehee, *Alternate*
K. P. Morse, *Alternate*
J. S. Rearick, *Alternate*
J. L. Stabler, *Alternate*
J. W. Stockstill, *Alternate*
J. L. Borwey, *Contributing Member*
H. S. Frank, *Contributing Member*
Z. R. McCain, Jr., *Contributing Member*
H. Ouyang, *Contributing Member*
J. D. Rosenberger, *Contributing Member*
A. A. Sattar, *Contributing Member*
D. L. Turner, *Contributing Member*
J. Xue, *Contributing Member*

INTERNATIONAL STANDARDS COMMITTEE

L. Bialy, *Chair*
V. P. Robibero, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
G. Antona

F. A. Belio, Jr.
B. Blackaby
K. L. Brinkman
J. W. Coaker

M. Farinola
G. W. Gibson
P. Hampton
J. T. Herrity
R. S. Hultstrom
D. A. Kalgren
J. W. Koshak
H. E. Peelle III
J. Popp

J. S. Rearick
W. M. Snyder
D. L. Turner
T. Derwinski, *Alternate*
C. A. Herrity, *Alternate*
A. Hsu, *Alternate*
S. Bornstein, *Contributing Member*
D. McColl, *Contributing Member*
D. McKee, *Contributing Member*

LIMITED-USE/LIMITED-APPLICATION ELEVATOR COMMITTEE

P. Chance, *Chair*
R. J. Murphy, *Vice Chair*
K. Hyam, *Staff Secretary*
K. L. Brinkman
K. L. Heyungs
F. M. Hoch
S. J. Mehalko
J. E. Newstrom

W. Richardson
F. C. Slater
R. B. Weber
D. M. Winkle, Jr.
G. Ziebell
S. A. Bruno, *Alternate*
H. H. Bippin, Jr., *Contributing Member*
J. P. Schumacher, *Contributing Member*

MAINTENANCE, REPAIR, AND REPLACEMENT COMMITTEE

R. A. Gregory, *Chair*
R. E. Baxter, *Vice Chair*
M. V. Farinola, *Vice Chair*
N. Gomez, *Staff Secretary*
J. M. Block
J. Day
C. J. Duke
J. Filippone
J. R. Freeman
S. P. Greene
S. S. Greywall
R. Haynes
R. Kremer
D. B. Labrecque
D. P. Lloyd
G. M. Losey
B. S. McCue
P. J. McPartland
M. J. Mellon, Jr.
J. L. Meyer
M. D. Morand
R. C. Morrical
N. Ortiz
J. S. Rearick
P. Reid
V. P. Robibero
P. S. Rosenberg
R. D. Schloss
R. T. Shanklin

R. D. Shepherd
D. M. Stanlaske
G. Stiffler
J. W. Stockstill
H. M. Vyas
T. Waardenburg
C. Buckley, *Alternate*
G. S. Carr, *Alternate*
P. Hampton, *Alternate*
E. A. Heath III, *Alternate*
D. Keller, *Alternate*
K. S. Lloyd, Jr., *Alternate*
J. L. Stabler, *Alternate*
K. P. Sullivan, *Alternate*
D. J. Winslow, *Alternate*
G. B. Cassini, *Contributing Member*
J. J. DeLorenzi, *Contributing Member*
R. E. Haukeness, *Contributing Member*
J. T. Herrity, *Contributing Member*
A. S. Hopkirk, *Contributing Member*
J. J. Knolmayer, *Contributing Member*
Z. R. McCain, Jr., *Contributing Member*
D. McColl, *Contributing Member*
C. McDilda, *Contributing Member*
N. R. Mistry, *Contributing Member*
J. Murphy, *Contributing Member*
A. Rehman, *Contributing Member*
A. J. Saxer, *Contributing Member*
D. L. Turner, *Contributing Member*

MARINE ELEVATOR COMMITTEE

G. A. Burdeshaw, *Staff Secretary*
D. Brady
E. J. Crawford
W. D. George
E. P. Graff

T. J. Ingram
H. Moran
M. R. Tilyou
R. Wagner

MECHANICAL DESIGN COMMITTEE

R. J. Walker, *Chair*
B. Horne, *Vice Chair*
M. P. Lamb, *Vice Chair*
N. Gomez, *Staff Secretary*
E. V. Baker
F. A. Belio, Jr.
L. Bialy
A. M. Culver
G. W. Gibson
D. A. Kalgren
R. E. Kaspersma
J. W. Koshak
R. Kremer
M. Rhiner
A. J. Shelton

H. Simpkins
D. L. Turner
D. S. Boucher, *Alternate*
S. Conrey, *Alternate*
S. Lahmers, *Alternate*
R. K. Leckman, *Alternate*
D. L. Barker, *Contributing Member*
R. E. Creak, *Contributing Member*
H. S. Frank, *Contributing Member*
K. Konyar, *Contributing Member*
W. Ouyang, *Contributing Member*
A. Rehman, *Contributing Member*
H. Wu, *Contributing Member*
S. P. Wurth, *Contributing Member*

MINE ELEVATOR COMMITTEE

T. D. Barkand, *Chair*
N. Martin, *Vice Chair*
N. Gomez, *Staff Secretary*
R. L. Adamson
R. M. Bates
A. R. Brower

W. M. Heimbuch
L. B. Keaney
J. K. Moore
A. J. Saxer
M. P. Snyder
J. K. Taylor

NEW TECHNOLOGY COMMITTEE

D. McColl, *Chair*
R. E. Kaspersma, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
P. D. Barnhart
L. Bialy
S. Bornstein
K. L. Brinkman
D. Bruce
T. M. Chambers
J. W. Coaker
S. Cowen
A. M. Culver
G. W. Gibson
P. Gulletson
K. Heling
J. T. Herrity
R. S. Hultstrom
D. A. Kalgren
J. W. Koshak

K. McGettigan
J. L. Meyer
M. Mihai
J. S. Rearick
V. P. Robibero
C. W. Rogler
S. Steiner
D. L. Turner
R. E. Baxter, *Alternate*
S. J. Carlton, *Alternate*
M. Chan, *Alternate*
C. A. Herrity, *Alternate*
B. Horne, *Alternate*
C. Mason, *Alternate*
O. Simonetta, *Alternate*
H. Ruan, *Contributing Member*
J. H. Shull, *Contributing Member*
H. Wu, *Contributing Member*

RACK AND PINION AND SPECIAL PURPOSE PERSONNEL ELEVATOR COMMITTEE

R. C. Meiresonne, *Chair*
S. Harris, *Vice Chair*
G. A. Burdeshaw, *Staff Secretary*
K. M. Harrison, *Secretary*
C. W. Cartwright II
M. A. Doenges
T. A. Gross
A. Harris

R. E. Kaspersma
J. W. Koshak
S. D. Larson
A. J. Marchant
S. P. Wood, *Alternate*
J. L. Borwey, *Contributing Member*
R. E. Haukeness, *Contributing Member*
B. L. O'Neill, *Contributing Member*

RESIDENCE ELEVATOR COMMITTEE

W. Richardson, *Chair*
P. Chance, *Vice Chair*
K. Hyam, *Staff Secretary*
R. D. Baxter
R. Boseley
F. M. Hoch
S. D. Holat
C. Jones
M. Lewis
S. J. Mehalko
R. J. Murphy
J. E. Newstrom
C. D. Robinson
W. P. Rockhold

R. B. Weber
D. M. Winkle, Jr.
G. Ziebell
S. A. Bruno, *Alternate*
J. B. Peskuski, *Alternate*
K. L. Brinkman, *Contributing Member*
P. Edwards, *Contributing Member*
L. Katz, *Contributing Member*
T. C. Kingsley, *Contributing Member*
J. C. Lund, *Contributing Member*
W. M. McKinley, *Contributing Member*
T. L. Pope, *Contributing Member*
J. P. Schumacher, *Contributing Member*
F. C. Slater, *Contributing Member*

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6 2017

PREFACE

GENERAL This is one of many standards developed by the American Society of Mechanical Engineers (ASME) under the general auspices of the American National Standards Institute (ANSI). Safety codes and standards are intended to enhance public health and safety. Revisions result from committee consideration of factors such as technological advances, new data, and changing environmental and industry needs. Revisions do not imply that previous editions were inadequate.

This Standard is referenced by and intended to be used in conjunction with ASME A17.1/CSA B44, Safety Code for Elevators and Escalators, and related Codes and standards. Written inquiries regarding this Standard should be addressed to the Secretary of the ASME A17 Standards Committee.

NOTE: Referenced Codes, Standards, and Test Methods that appear with no date indicated shall be the edition in effect at the time of publication of this Standard.

FORM AND ARRANGEMENT This Standard consists of three Parts, each covering a specific technology related to elevator suspension and compensation means and governor ropes. The Foreword, Preface, and Notes that are included in this document are not part of this American National Standard. They are advisory in nature and are intended for clarification only.

SCOPE This Standard covers the means and members of suspension, compensation, and governor systems for elevators within the scope of ASME A17.1/CSA B44.

NOTE: It must be determined by the individual working committees as to the level of appropriateness of applying the New Technologies in their particular applications.

This Standard includes the material properties, design, testing, inspection, and replacement criteria for these means. It includes the requirements for steel wire rope, aramid fiber rope, and noncircular elastomeric-coated steel suspension members, and provides direction for future constructions as new technology develops.

INTRODUCTION This Standard is intended to be used with ASME A17.1/CSA B44, Safety Code for Elevators and Escalators, A17.2, Guide for the Inspection of Elevators, Escalators, and Moving Walks, and A17.3, Safety Code for Existing Elevators and Escalators, and other Codes and Standards referenced by these Standards as well as other related Standards.

The ASME A17.1/CSA B44 Code specifically references the suspension and compensation means and governor systems covered by this Standard. This Standard was developed to provide safe, consistent criteria for steel wire rope, aramid fiber rope, noncircular elastomeric-coated steel suspension members and other means of suspension and compensation used in the Elevator Industry.

Part 1 covers steel wire rope.

Part 2 covers aramid fiber rope.

Part 3 covers noncircular elastomeric-coated steel suspension members.

The Standard is under the auspices of the ASME A17.1 Standards Committee and is subject to the operating procedures of this Committee.

ASME ELEVATOR PUBLICATIONS The American Society of Mechanical Engineers (ASME) has developed and published safety codes and standards for elevators, escalators, and related equipment since the first edition of A17.1, Safety Code for Elevators and Escalators, which was published in 1921.

This Code is one of the numerous codes and standards that have been or are being developed by The American Society of Mechanical Engineers.

The following publications are of special interest to users of this Code. For prices and availability:

Tel: 800-843-2763

Fax: 973-882-1717

E-Mail: customercare@asme.org

ASME Website: www.asme.org/shop

ASME A18.1, Safety Standard for Platform Lifts and Stairway Chairlifts. This safety Standard covers the design, construction, installation, operation, inspection, testing, maintenance, and repair of inclined stairway chairlifts and inclined and vertical platform lifts intended for transportation of a mobility impaired person only.

CORRESPONDENCE WITH A17 COMMITTEE ASME codes and standards are developed and maintained with the intent to represent the consensus of concerned interests. As such, users of this and other ASME A17 codes and standards may interact with the committee by requesting interpretations, proposing revisions, and attending committee meetings. Correspondence should be addressed to:

Secretary, A17 Standards Committee
The American Society of Mechanical Engineers
Two Park Avenue
New York, NY 10016
<http://go.asme.org/Inquiry>

All correspondence to the Committee must include the individual's name and post office address in case the Committee needs to request further information.

Proposing Revisions. Revisions are made periodically to the Code to incorporate changes that appear necessary or desirable, as demonstrated by the experience gained from the application of the procedures, and in order to conform to developments in the elevator art. Approved revisions will be published periodically.

The Committee welcomes proposals for revisions to this Code. Such proposals should be as specific as possible, citing the Section number(s), the proposed wording, and a detailed description of the reasons for the proposal including any pertinent documentation.

Requesting Interpretations. Upon request, the A17 Committee will render an interpretation of any requirement of the Code. Interpretations can only be rendered in response to a written request sent to the Secretary of the A17 Standards Committee.

Requests for interpretation should preferably be submitted through the online Interpretation Submittal Form. The form is accessible at <http://go.asme.org/InterpretationRequest>. Upon submittal of the form, the Inquirer will receive an automatic e-mail confirming receipt.

If the Inquirer is unable to use the online form, he/she may mail the request to the Secretary of the A17 Standards Committee at the above address. The request for interpretation should be clear and unambiguous. It is further recommended that the Inquirer submit his/her request in the following format:

Subject: Cite the applicable Section number(s)
and the topic of the inquiry in one or
two words.

Edition: Cite the applicable edition and
supplement of the Code for which the
interpretation is being requested.

Question: Phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. Please provide a condensed and precise question, composed in such a way that a "yes" or "no" reply is acceptable.

Proposed Reply(ies): Provide a proposed reply(ies) in the form of "Yes" or "No," with explanation as needed. If entering replies to more than one question, please number the questions and replies.

Background Information: Provide the Committee with any background information that will assist the Committee in understanding the inquiry. The Inquirer may also include any plans or drawings that are necessary to explain the question; however, they should not contain proprietary names or information.

Requests that are not in the format described above will be rewritten in this format by the Committee prior to being answered, which may inadvertently change the intent of the original request.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME committee or subcommittee. ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity.

Attending Committee Meetings. The A17 Standards Committee and the various Working Committees regularly hold meetings and/or telephone conferences, all of which are open to the public. Persons wishing to attend any meeting and/or telephone conference should contact the Secretary of the Standards Committee.

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6 2017

INTENTIONALLY LEFT BLANK

Part 1

Stranded Carbon Steel Wire Ropes for Elevators

SECTION 1.1 SCOPE

Part 1 covers the general requirements for the more common types of stranded steel wire ropes for hoisting, compensation, and governor applications on passenger or freight elevators. Included in the scope of this Part are steel wire ropes in various grades and constructions from 4 mm to 38 mm ($\frac{5}{32}$ in. to $1\frac{1}{2}$ in.) manufactured from uncoated wire or metallic coated wire. For specific applications, additional or alternative requirements may apply, provided equivalent safety is maintained.

Part 1 covers regular lay and lang lay, preformed and nonpreformed elevator rope in nominal imperial dimensions as well as SI dimensions. Various constructions of steel wire rope are covered, i.e., Seale, Warrington, and Filler. **Part 1** covers the broad range of wire materials in current use including Iron, Traction, Extra High Strength Traction, 1570 Single, 1180/1770 Dual, 1370/1770 Dual, 1770 Single, 1960 Single, and 2300 Single. Various rope core materials in current use are covered by this Part including natural and synthetic fiber cores and steel cores. This Part covers ropes made from uncoated wires or metallic coated wires (e.g., galvanized). This Part includes criteria for testing and compliance of rope, replacement of rope, and ordering information for steel wire rope.

NOTE: **Part 1** is written in the combined format, presenting requirements for rope products in both Imperial units, utilized historically in the SI and U.S. Customary units as recognized by current international standards. The values stated in SI (metric) units or Imperial units are to be regarded separately. The values are not exact equivalents; therefore, each system must be used independently of the other.

SECTION 1.2 REFERENCES

Part 1 incorporates, by dated or undated reference, provisions from other publications. These normative references are cited at their appropriate place in the text, and the publications are listed. For dated references, subsequent amendments to or revisions of any of these publications apply to this Part only when incorporated by

amendment or revision. For undated references, the latest edition would apply.

ASME A17.1/CSA B44 (latest edition), Safety Code for Elevators and Escalators

ASME A17.2 (latest edition), Guide for Inspection of Elevators, Escalators, and Moving Walks

Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5990 (www.asme.org)

ASTM A931-2008, Standard Test Method for Tension Testing of Wire Ropes and Strand

ASTM A1007-2000, Standard Specification for Carbon Steel Wire for Wire Rope

ASTM A1023-2002, Specification for Stranded Carbon Steel Wire Ropes for General Purposes

Publisher: American Society for Testing and Materials (ASTM International), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

ISO 2020-1:1997, Aerospace — Preformed flexible steel wire rope for aircraft controls — Part 1: Dimensions and loads

ISO 2232:1990, Round drawn wire for general purpose non-alloy steel wire ropes — Specifications

ISO 3108:1974, Steel wire ropes for general purposes — determination of actual breaking load

ISO 4101:1983, Drawn steel wire for elevator ropes — Specifications


ISO 4344:2004, Steel wire ropes for lifts — Minimum requirements

ISO 4345:1988, Steel wire ropes — Fibre main cores — Specification

ISO 4346:1977, Steel wire ropes for general purposes — Lubricants — Basic requirements

ISO 9001, Quality management systems — Requirements

Publisher: International Organization for Standardization (ISO), Central Secretariat, Chemin de Blandonnet 8, Case Postale 401, 1214 Vernier, Geneva, Switzerland (www.iso.org)

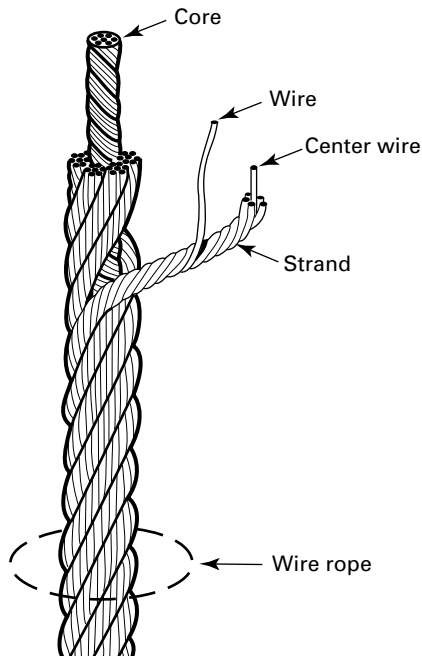Figure 1.3.1.1-1 Elements of Stranded Steel Wire Rope

SECTION 1.3 TERMINOLOGY

1.3.1 Descriptions of Terms Specific to Rope Elements

1.3.1.1 Stranded Steel Wire Rope. An assembly of strands laid helically in one layer around a core. See Figure 1.3.1.1-1.

1.3.1.2 Wire. A single continuous length of steel with a circular uniform cross-section cold drawn from a rod.

1.3.1.2.1 Finish and Quality of Coating. The condition of the surface finish of the wire, e.g., uncoated or metallic coated (zinc or zinc alloy) shall comply with the following:

(a) *Uncoated Wire.* Carbon steel wire that does not have a metallic coating; formerly referred to as bright wire.

(b) *Metallic Coated Wire.* Carbon steel wire that has a metallic coating.

(1) *Final-Galvanized Wire.* Coated carbon steel wire with a zinc coating applied after the final wire drawing operation.

(2) *Drawn-Galvanized Wire.* Coated carbon steel wire with a zinc coating applied prior to the final wire drawing operation.

(3) *Final-Coated Zn-5Al-MM Wire.* Coated carbon steel wire with a zinc-aluminum alloy (mischmetal) coating applied after the final wire drawing operation.

(4) *Drawn-Zn-5Al-MM Wire.* Coated carbon steel wire with a zinc-aluminum alloy (mischmetal) coating applied prior to the final wire drawing operation.

1.3.1.2.2 Function

(a) *Load-Bearing Wires (Main Wires).* Those wires in a rope that are considered as contributing toward the breaking force of the rope.

(b) *Non-Load-Bearing Wires.* Those wires in a rope that are considered as not contributing towards the breaking force of the rope.

(c) *Filler Wires.* Comparatively small wires used in certain constructions to create the necessary number of interstices for supporting the next layer of covering wires.

(d) *Seizing (Serving) Wires or Strands.* Those single wires or strands used for making a close-wound helical serving to retain the elements of a rope in their assembled position.

1.3.1.2.3 Position

(a) *Center Wire.* Wire positioned at the center of a strand of a stranded rope.

(b) *Inner Wire.* All wires except center, filler, core, and outer wires of a stranded rope.

(c) *Outer Wire.* All wires in the outer layer of the strand of a stranded rope.

(1) *Crown Wire.* The visible portion of the helically laid outer wire that contacts the wear surfaces.

(2) *Valley Wire.* The visible portion of the helically laid outer wire that does not contact the wear surfaces.

(d) *Core Wire.* All wires comprising the core of a stranded rope, where applicable.

1.3.1.2.4 Layer of Wires. An assembly of wires having one pitch diameter. The exception is a Warrington layer comprising large and small wires where the smaller wires are positioned on a larger pitch circle than the larger wires. The first layer of wires is that which is laid over the strand center wire. Filler wires do not constitute a separate layer.

1.3.1.3 Strands

1.3.1.3.1 Strand. An element of rope normally consisting of an assembly of wires of appropriate shape and dimensions laid helically in one or more layers around a center wire.

1.3.1.3.2 Shape of Cross-Section

(a) *Round Strand.* Strand having a perpendicular cross-section that is approximately the shape of a circle. See Figure 1.3.1.3.2-1.

(b) *Compacted Round Strand.* A round strand that has been subjected to a compacting process such as drawing, rolling, or swaging. See Figure 1.3.1.3.2-2.

Figure 1.3.1.3.2-1 Round Strand




Figure 1.3.1.3.2-2 Compacted Round Strand: Before and After Compacting

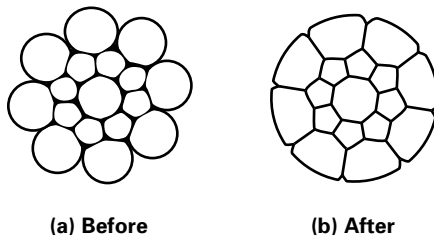


Figure 1.3.1.3.3-1 Lay Direction of Strands for Stranded Ropes


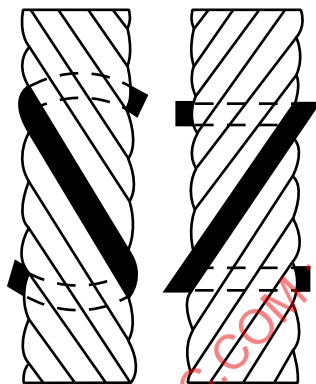


Figure 1.3.1.3.4-1 Seale Construction (e.g., 19S, 9-9-1)



1.3.1.3.3 Strand Lay Direction. The direction right (z) or left (s) corresponding to the direction of lay of the outer wires in relation to the longitudinal axis of the strand. See Figure 1.3.1.3.3-1.

Figure 1.3.1.3.4-2 Warrington Construction [e.g., 19W, (6+6)-6-1]





Figure 1.3.1.3.4-3 Filler Construction (e.g., 25F, 12-6F-6-1)



1.3.1.3.4 Strand Type and Constructions: Parallel Lay.

Strand that contains at least two layers of wires all of which are laid in one operation (in the same direction). The lay length of all wire layers are equal, and the wire of any two superimposed layers are parallel to each other resulting in linear contact.

NOTE: Strand construction is designated by listing the number of wires, beginning with the outer wires, with each layer separated by a hyphen.

There are three types of parallel lay constructions commonly used for elevator rope, which are as follows:

(a) *Seale (S)*. Construction having same number of wires in each layer, e.g., 9-9-1. See Figure 1.3.1.3.4-1.


(b) *Warrington (W)*. Construction having outer (Warrington) layer containing alternately large and small wires and twice the number of wires as the inner layer. Warrington layers are designated by listing the number of large and small wires with a plus sign (+) in between and parentheses around the layer, e.g., (6 + 6). See Figure 1.3.1.3.4-2.

(c) *Filler (F)*. Construction having outer layer containing twice the number of wires than the inner layer, with filler wires laid in the interstices between the layers. Filler wires are designated with the letter "F." See Figure 1.3.1.3.4-3.

1.3.1.4 Rope Cores. Central elements, usually of fiber or steel around which the strands are helically laid. Rope cores shall have a rope manufacturer-specific identification marker incorporated during core manufacture or during closing of finished rope. The marker shall be of filament, fiber, or ribbon material. See Figure 1.3.1.4-1.

1.3.1.4.1 Fiber Core (FC). An element made from either natural or synthetic fibers.

Figure 1.3.1.4-1 Examples of Cores

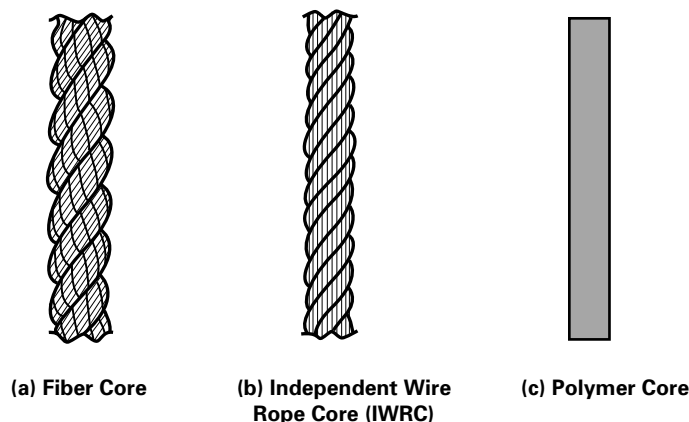

1.3.1.4.2 Independent Wire Rope Core (IWRC). A core constructed as a round stranded steel wire rope. The core and/or its outer strands may also be covered or filled with either fiber or solid polymer.

1.3.1.4.3 Solid Polymer Core. A single element of solid polymer material that is either cylindrical or shaped (grooved). It may also include an element or elements of wire or fiber.

1.3.1.5 Lubrication

1.3.1.5.1 Rope Lubricant. A material applied during the manufacture of a strand, core, or rope in elevator systems, reducing internal friction and/or providing protection against corrosion.

1.3.1.5.2 Impregnating Compound. A material used in the manufacture of natural fiber cores for the purpose of preserving fiber integrity in service and providing protection against rotting and decay of the fiber material.

1.3.2 Descriptions of Elements Specific to Rope Assemblies

1.3.2.1 Rope Types

1.3.2.1.1 Stranded Rope. An assembly of several strands layed helically around a core.

(a) *Single Layer.* Rope consisting of one layer of strands laid helically around a core.

(b) *Compacted Strand.* Rope in which the strands, prior to closing of the rope, are subjected to a compacting process such as drawing, rolling, or swaging.

(c) *Multilayered.* Ropes consisting of multiple layers of strands laid helically around a core.

1.3.2.2 Rope Classification and Construction

1.3.2.2.1 Rope Classification. A grouping of ropes of similar characteristics on the basis of, for stranded ropes, the number of strands and their shape, the nominal number of wires in one strand, the actual number of

outer wires in one strand, and the actual number of wire layers in one strand. For classification details refer to [Tables I-1.1-1, I-1.1-2, I-1.1-3, and I-1.1-4](#).

1.3.2.2.2 Rope Construction. The detail and arrangement of the various elements of the rope, taking into account the number of strands and the number of wires in the strand. For designation details refer to [Tables I-1.1-1, I-1.1-2, I-1.1-3, and I-1.1-4](#).

NOTE: Rope construction is designated by listing the number of outer strands followed by the number of wires in each strand and the designation for the type of construction, e.g., $6 \times 25F$. The “x” symbol is read as “by.”

1.3.2.3 Rope Grade. A level of requirement of breaking force that is designated either by a number (e.g., 1570, 1770) or historical grade designations (e.g., Traction, Extra High Strength). See [1.6.3](#).

NOTE: Rope grade does not imply that the actual tensile strength of the wires in the rope are necessarily of this grade as multiple wire grades can be used in the same rope.

1.3.2.4 Rope Lay


1.3.2.4.1 Lay Direction of Rope. The direction right (Z) or left (S) corresponding to the direction of lay of the outer strands in a stranded rope in relation to the longitudinal axis of the rope.

1.3.2.4.2 Lay Types. See [Figure 1.3.2.4.2-1](#).

(a) *Regular (Ordinary).* Stranded rope in which the direction of lay of the wires in the outer strands is in the opposite direction to the lay of the outer strands in the rope.

(b) *Lang Lay.* Stranded rope in which the direction of lay of the wires in the outer strands is the same direction as that of the outer strands in the rope.

Figure 1.3.2.4.2-1 Regular (Ordinary) Lay and Lang Lay

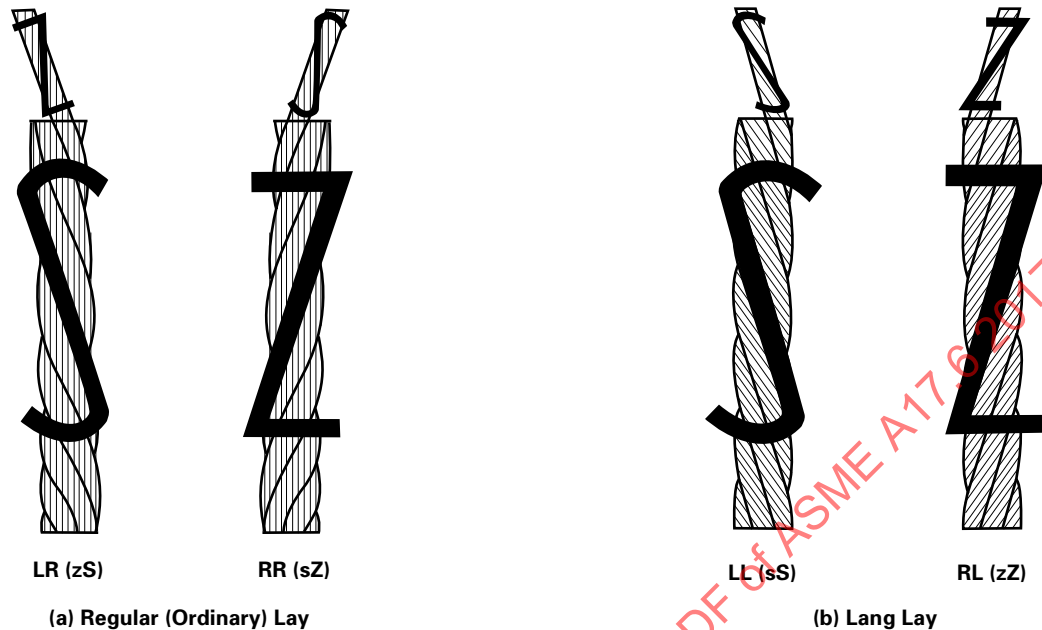

GENERAL NOTE: The lowercase first letter denotes strand direction; the uppercase second letter denotes rope direction.

Figure 1.3.3.1.1-1 Diameter of Round Rope


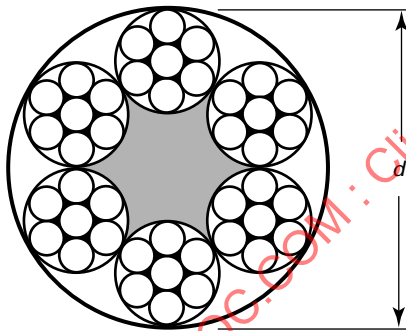


Figure 1.3.3.2.1-1 Strand Lay Length

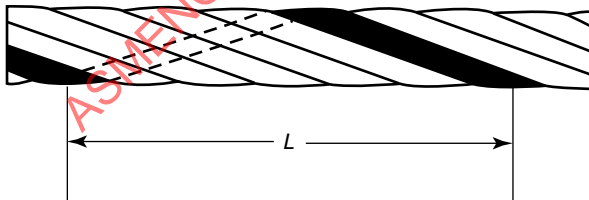

1.3.3 Dimensional Characteristics

1.3.3.1 Diameter of Rope

1.3.3.1.1 Diameter of Round Rope. The diameter, d , of a circle that circumscribes the rope cross-section. Diameter is expressed in millimeters (mm) or inches (in.). See Figure 1.3.3.1.1-1.

1.3.3.2 Lay Length

1.3.3.2.1 Strand Lay Length. That distance measured parallel to the longitudinal strand axis, in which the wire in the strand makes one complete turn (or helix) about the axis of the strand. The lay length of a strand is that corresponding to the outer layers of wires. See Figure 1.3.3.2.1-1.

1.3.3.2.2 Rope Lay Length. That distance measured parallel to the longitudinal rope axis in which the outer strands of a stranded rope make one complete turn (or helix) about the axis of the rope. See Figure 1.3.3.2.2-1.


1.3.4 Mechanical Properties

1.3.4.1 Wire

1.3.4.1.1 Wire Tensile Strength. Ratio between the maximum force obtained in a tensile test and the nominal cross sectional area of the test piece.

Requirements for wire tensile strength are determined by the tensile strength grade or wire level as specified in this Standard for outer wire, by wire level as specified by ASTM A1007 for inner and core wires, or by the tensile

Figure 1.3.3.2.2-1 Rope Lay Length

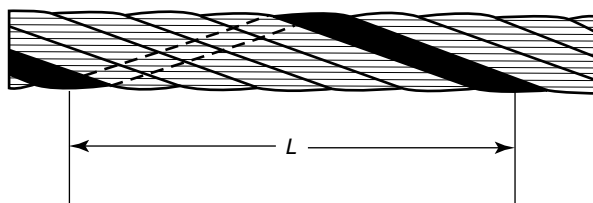

strength grade as specified in ISO 2232 for all component wires.

(a) *Wire Level*. A level of requirement for tensile strength in pounds per square inch (e.g., Level 3, see ASTM A1007).

(b) *Tensile Strength Grade*. A level of requirement for tensile strength. It is designated by a value according to the lower limit of tensile strength and is used when specifying wire.

1.3.4.1.2 Torsions. A measure of wire ductility normally expressed as the number of 360-deg revolutions that a wire can withstand before breakage occurs, using the prescribed test method in ASTM A1007 or ISO 2232. Torsion requirements are based on the wire diameter and wire level or tensile strength grade, as found in the appropriate wire standard.

1.3.4.2 Rope

1.3.4.2.1 Minimum Breaking Force (MBF). A specified value that the actual (measured) breaking force must meet or exceed in a prescribed tensile test.

1.3.4.2.2 Actual (Measured) Breaking Force. The breaking force obtained using the prescribed tensile test method in ASTM A931 or ISO 3108.

1.3.4.2.3 Calculated Breaking Force. The value of breaking force obtained from the sum of the measured breaking forces of the load-bearing wires in the rope, before rope making, multiplied by the measured spinning efficiency.

1.3.4.2.4 Measured Spinning Efficiency. The ratio between the measured breaking force of the rope and the sum of the measured breaking forces of the wires, before rope making.

1.3.4.2.5 Residual Strength. The actual breaking strength of a suspension member at any time during its operational life cycle.

NOTE: The residual strength will be reduced as the suspension member is used and is subjected to wear.

1.3.4.3 Rope Stretch (Extension)

1.3.4.3.1 Constructional Stretch (Extension). The amount of extension that is attributed to the initial bedding down of wires within the strands and the

strands within the rope due to loading. Initial extension cannot be determined by calculation.

1.3.4.3.2 Elastic Stretch (Extension). The amount of recoverable extension that follows Hooke's Law within certain limits due to application of a load.

1.3.4.3.3 Permanent Stretch (Extension). Nonelastic extension.

1.3.5 Rope Manufacture

1.3.5.1 Preformation

1.3.5.1.1 Preformed Rope. Rope in which the wires and strands in the rope will not, after removal of any seizing (serving), spring out of the rope formation.

1.3.5.1.2 Nonpreformed Rope. Rope in which the wires and strands in the rope will, after removal of any seizing (serving), spring out of the rope formation.

1.3.5.2 Prestretching. The name given to a process that results in the removal of a limited amount of constructional stretch.

1.3.5.3 Production Length. The length of rope manufactured in one continuous operation from one loading of the closing machine comprising strands, each of which has been produced in one continuous operation on the stranding machine. A production length may comprise one or more reels of rope.

1.3.6 Values

1.3.6.1 Nominal Value. The conventional value by which a physical characteristic is designated.

1.3.6.2 Actual (Measured) Value. Value derived from direct measurement in a prescribed manner.

1.3.6.3 Minimum Value. Specified value that an actual value must meet or exceed.

1.3.6.4 Maximum Value. Specified value that an actual value must not exceed.

1.3.7 Rope Degradation

1.3.7.1 Normal Wear. Ropes showing wear equally on all strands around the circumference of the rope.

1.3.7.2 Unfavorable Wear. Ropes showing uneven wear and/or rouging due to poor installation, worn sheaves, unequally tensioned ropes, or severe environmental conditions.

1.3.7.3 Crown Wire Breaks. Fatigue failure of the outer wire following a diameter reduction due to wear.

1.3.7.3.1 Equally Distributed Breaks. Randomly distributed wire breaks throughout the lay of the rope without any pattern.

Table 1.4.1-1 Wire Level or Tensile Strength Grades for Given Rope Grades

Rope Grade [Note (1)]	Wire Level or Tensile Strength Grade	
	Outer	Inner
Iron	Iron/Grade 680	Level 2/Grade 1570; Level 3/Grade 1770; Level 4/Grade 1960
Traction	Traction/Grade 1180	Level 2/Grade 1570; Level 3/Grade 1770; Level 4/Grade 1960
Extra High Strength	Level 3/Grade 1770	Level 3/Grade 1770; Level 4/Grade 1960; Level 5/Grade 2160
1570 Single	Level 2/Grade 1570	Level 2/Grade 1570
1180/1770 Dual	Traction/Grade 1180	Level 3/Grade 1770; Level 4/Grade 1960
1370/1770 Dual	Level 1/Grade 1370	Level 3/Grade 1770; Level 4/Grade 1960
1770 Single	Level 3/Grade 1770	Level 3/Grade 1770
1960 Single	Grade 1960	Level 4/Grade 1960; Level 5/Grade 2160
2300 Single	Grade 2300	Grade 2300

GENERAL NOTE: "Level" refers to North American tensile strength standards and "Grade" refers to European Tensile test standards.

NOTE: (1) See [Section 1.2](#).

1.3.7.3.2 Unequally Distributed Breaks. Wire breaks predominating in one or two strands within the lay of the rope.

1.3.7.3.3 Side-by-Side Breaks. Four wire breaks in one strand within the lay of a rope that resembles a staircase.

1.3.7.4 Valley Breaks. Wire breaks that are visible and occur outside of the crown wear area with the crown wire intact.

SECTION 1.4 MATERIAL

1.4.1 Rope Wire

The wires used in rope making shall comply with the appropriate parts of this Standard, ASTM A1007 for rope wire, ISO 2232, or equivalent. For those wires covered by the tables, the manufacturer, subject to the limits in [Table 1.4.1-1](#), shall decide the tensile grade so that the minimum breaking force of the rope is achieved.

1.4.1.1 Outer wires shall be made to the tensile ranges specified in [Table 1.4.1.1-1](#) and torsion requirements specified in [Table 1.4.1.1-2](#).

1.4.1.2 Wire tensile limitations in [Table 1.4.1-1](#) do not apply to center, filler, and core wires.

1.4.1.3 Wire tensile limitations do not apply to compacted strand ropes.

1.4.1.4 The manufacturer shall have the option to adopt a single wire level or tensile strength grade throughout the rope or to decide on a combination of wire levels or tensile strength grades.

1.4.1.5 Wire diameters shall be selected by the manufacturer in accordance with design requirements.

1.4.2 Rope Core

Cores of stranded ropes are normally of either fiber or steel composition. Core lubricants shall be compatible with the lubricant applied during rope stranding, having no deleterious effects on any rope component.

1.4.2.1 Fiber Core. Fiber cores larger than 8 mm (0.315 in.) diameter shall be doubly closed. The cores shall be of uniform hardness, effectively supporting the strands.

1.4.2.1.1 Natural Fiber Core. All natural fiber cores shall be hard-twisted, sisal or manila vegetable fiber made in accordance with ISO 4345. Core lubricant content shall be 10% to 15% by weight of the dry fiber material that shall be measured by the method in ISO 4345, Appendix C.

1.4.2.1.2 Synthetic Fiber Core. Synthetic fiber cores shall be made of fiber made from polyolefins (i.e., polypropylene or polyethylene), polyester, or other suitable synthetic fiber agreed to by purchaser and supplier. Lubricant content shall be the subject of agreement between purchaser and supplier.

1.4.2.2 Steel Core. Steel main cores, use subject to agreement between supplier and purchaser, shall be an independent wire rope core (IWRC) for ropes larger than 7 mm, unless otherwise specified. Steel cores for ropes 7 mm and smaller may be either a single strand or IWRC. Steel cores shall be lubricated. Cores closed in one operation (parallel lay) with the outer strands of the rope may be specified by agreement between the supplier and the purchaser.

1.4.3 Rope Lubricant

Steel wire rope, unless otherwise specified, shall be lubricated and impregnated in the manufacturing process with a suitable lubricant selected by the manufacturer. Stranding lubricants used for fiber core ropes shall be compatible with the impregnating compound of the fiber core. Rope lubricants shall be of the

Table 1.4.1.1-1 Wire Level or Tensile Strength Grade Requirements

Rope Grade [Note (1)]	Outer Wire Level or Tensile Strength Grade			
	N/mm ²		psi × 10 ³	
	Min.	Max.	Min.	Max.
Iron	680	880	100.0	130.0
Traction	1 180	1 470	170.0	215.0
Extra High Strength	1 670	1 960	245.0	285.0
1570 Tensile	1 570	...	227.8	Note (2)
1180/1770 Dual	1 180	...	171.2	Note (2)
1370/1770 Dual	1 370	...	198.8	Note (2)
1770 Single	1 770	...	256.8	Note (2)
1960 Single	1 960	...	284.3	...
2300 Single	2 300	...	333.5	...

NOTES:

(1) See Section 1.2.

(2) Maximum tensile strengths vary according to size and shall be in accordance with ISO 2232, Section 3.3.

Table 1.4.1.1-2 Wire Torsion Requirements

Rope Grade	Outer Wire Minimum Torsion Value (Number of Turns in 100d)
Iron	Per ASTM A1007, Wrap Test
Traction	Per ASTM A1007, 34 turns/100d
Extra High Strength	Per ASTM A1007, 29 turns/100d
1570 Tensile	Per ISO 2232
1180/1770 Dual	Per ISO 2232
1370/1770 Dual	Per ISO 2232
1770 Single	Per ISO 2232
1960 Single	Per ISO 2232
2300 Single	Per ISO 2232

proper type and consistency for elevator service. Rope lubricant shall have no deleterious effects on any rope component and shall include a rust inhibitor. Lubricants shall comply with ISO 4346.

SECTION 1.5 ROPE WORKMANSHIP AND FINISH

1.5.1 Strand

Strand wires shall be tight and uniform. All the wire layers in a strand shall have the same direction of lay. The lay lengths of corresponding wire layers in strands of the same size shall be uniform.

1.5.2 Rope

1.5.2.1 The rope shall be uniformly made and the strands shall lie tightly on the core or the underlying strands.

1.5.2.2 The core of a stranded rope shall be designed or selected so that in a new rope under no load, there is clearance between outer strands.

1.5.2.3 Rope ends shall have a minimum of one seizing (serving) applied to secure and maintain the integrity of the rope and prevent its unraveling.

1.5.3 Wire Joints

1.5.3.1 Wires over 0.4 mm (0.015 in.) diameter shall, where necessary, have their ends joined by hard soldering, brazing, or welding.

1.5.3.2 Wires up to and including 0.4 mm (0.015 in.) diameter may also be joined by soldering, brazing, welding, twisting, or by ends being simply inserted into the strand's formation.

1.5.3.3 The minimum distance between joints in any strand shall be 18 times the nominal rope diameter for stranded ropes.

1.5.4 Preformation

Stranded ropes shall be preformed unless otherwise specified.

1.5.5 Prestretching

When specified, ropes may be prestretched using either a process of static or dynamic loading. Prestretch loads shall not exceed 55% of the minimum breaking force for the rope.

NOTE: An example of static prestretching practice: rope is subjected to three cycles of tensile loading to 40% of the rope minimum breaking force for 5 min each, returning to 5% of the minimum breaking force between cycles. After the last cycle, the tensile force is completely released.

SECTION 1.6 PROPERTIES AND TOLERANCES OF NEWLY CONSTRUCTED ROPE

1.6.1 Classification

The rope classification shall be specified by the purchaser and shall normally be one of those covered in [Mandatory Appendix I, Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4](#), although other classifications and constructions may be supplied by agreement between purchaser and manufacturer or supplier.

NOTE: Where only the rope classification is specified by the purchaser, the construction shall be decided by the manufacturer.

1.6.2 Rope Core

Natural fiber cores are supplied unless otherwise specified with core construction selected by the manufacturer. Other cores shall be the subject of agreement between supplier and purchaser.

1.6.3 Rope Grade

Rope grade shall be one of the following although other grades may be supplied by agreement between purchaser and manufacturer or supplier.

(a) Rope grades for SI units (Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4)

- (1) 1570 Single: normal hoisting applications
- (2) 1180/1770 Dual: normal hoisting applications
- (3) 1370/1770 Dual: normal hoisting applications
- (4) 1770 Single: high-speed/high-loading applications

(5) 1960 Single: special hoisting applications

(6) 2300 Single: special hoisting applications

(b) Rope grades for Imperial units (Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4)

- (1) Iron: applications other than hoist rope
- (2) Traction: normal hoisting applications
- (3) Extra High Strength: high-speed/high-loading applications

1.6.4 Wire Finish

Unless otherwise specified, steel wire ropes will be furnished with uncoated wires. For steel wire ropes requested with metallic-coated wires, the wires shall be galvanized unless otherwise specified by the purchaser.

1.6.4.1 Final-Galvanized Rope. All outer wires shall be supplied as final galvanized. Inner, filler, and center wires may be supplied as final galvanized or drawn galvanized. Minimum weight of coating for galvanized wire shall be as specified in Tables 1.6.4.1-1 and 1.6.4.1-2. An adherence test will be required involving six tightly spaced wraps around a mandrel twice the wire diameter, without peeling or cracking.

1.6.4.1.1 Final-Galvanized Rope. Final-galvanized rope will be supplied with a minimum nominal breaking force 10% less than that specified in Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4.

1.6.4.1.2 Final-Coated Zn-5Al-MM. Wires of final-coated Zn-5Al-MM may be substituted for final-galvanized wire at the option of the manufacturer. Minimum weight of coating shall be as specified in Table 1.6.4.1-1.

1.6.4.2 Drawn-Galvanized (Zinc Coated) Rope. All the wires shall be drawn galvanized (zinc coated), including those of any steel core. Minimum weight of coating shall be as specified in Table 1.6.4.1-2.

1.6.4.2.1 Minimum Breaking Forces. Drawn galvanized rope shall be supplied with minimum breaking forces as listed in Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4 unless otherwise agreed to between supplier and purchaser.

1.6.4.2.2 Drawn-Zn-5Al-MM. Wires of drawn-Zn-5Al-MM may be substituted for drawn-galvanized wire at the option of the manufacturer. Minimum weight of coating shall be as specified in Table 1.6.4.1-2.

1.6.5 Direction and Type of Rope Lay

The direction and type of rope lay shall be as specified by the purchaser and shall be one of the following:

- (a) right regular (ordinary) lay (sZ)
- (b) left regular (ordinary) lay (zS)
- (c) right lang lay (zZ)
- (d) left lang lay (sS)

Right regular (ordinary) lay will be supplied for 6- and 8-strand constructions unless otherwise specified by the purchaser.

1.6.6 Dimensions

1.6.6.1 Rope Diameter. The nominal diameter shall be as specified by the purchaser and shall be the dimension by which the rope is designated. See Figure 1.3.3.1-1-1.

1.6.6.1.1 Tolerance on Rope Diameter. When measured in accordance with 1.7.3.3.1, the actual diameter shall not vary from the nominal diameter by more than the tolerances specified in Tables 1.6.6.1.1-1 and 1.6.6.1.1-2, in accordance with ISO 4344.

1.6.6.1.2 Permissible Differences in Diameter. The difference between any two of the four measurements taken in accordance with 1.7.3.3.1 and expressed as a percentage of the nominal diameter shall not exceed the values given in Table 1.6.6.1.2-1.

1.6.6.2 Lay Length. The lay length of the finished rope shall not exceed 6.75 times the nominal rope diameter.

1.6.7 Mechanical Properties

1.6.7.1 Breaking Force. Values for minimum breaking force for the covered classes of rope are specified in Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4.

1.6.7.2 Mass. The approximate rope mass shall be as given in Table I-1.1-1, I-1.1-2, I-1.1-3, or I-1.1-4, or as agreed upon by the manufacturer and purchaser.

1.6.7.3 Length. The actual length of rope supplied, expressed in feet or meters, shall be the specified length under no load subject to the following limits of tolerance:

- (a) up to and including 400 m (1,300 ft): +5.0% of specified length

**Table 1.6.4.1-1 Weight of Coating for Final-Galvanized or Final-Coated
Zn-5Al-MM Rope Wire for Newly Constructed Rope**

Diameter of Wire		Minimum Weight of Coating	
mm	in.	kg/m ²	oz/ft ²
0.51 to 1.19 inclusive	0.020 to 0.047 inclusive	0.06	0.20
Over 1.19 to 1.37 inclusive	Over 0.047 to 0.054 inclusive	0.12	0.40
Over 1.37 to 1.60 inclusive	Over 0.054 to 0.063 inclusive	0.15	0.50
Over 1.60 to 2.01 inclusive	Over 0.063 to 0.079 inclusive	0.18	0.60
Over 2.01 to 2.34 inclusive	Over 0.079 to 0.092 inclusive	0.21	0.70
Over 2.34 to 4.88 inclusive	Over 0.092 to 0.192 inclusive	0.24	0.80

**Table 1.6.4.1-2 Weight of Coating for Drawn-Galvanized or Drawn-Coated
Zn-5Al-MM Rope Wire for Newly Constructed Rope**

Diameter of Wire		Minimum Weight of Coating	
mm	in.	kg/m ²	oz/ft ²
0.15 up to 0.25	0.006 up to 0.010	0.010 [Note (1)]	0.03 [Note (1)]
0.25 to 0.43 inclusive	0.010 to 0.017 inclusive	0.015	0.05
Over 0.43 to 0.71 inclusive	Over 0.017 to 0.028 inclusive	0.03	0.10
Over 0.71 to 1.52 inclusive	Over 0.028 to 0.060 inclusive	0.06	0.20
Over 1.52 to 2.29 inclusive	Over 0.060 to 0.090 inclusive	0.09	0.30
Over 2.29 to 3.56 inclusive	Over 0.090 to 0.140 inclusive	0.12	0.40

NOTE: (1) The values shown are in accordance with ISO 2020-1:1997.

**Table 1.6.6.1.1-1 Tolerances on Rope Diameter (Stranded Rope) for Newly Constructed Rope
With Cores of Fiber or Other Nonmetallic Materials**

Nominal Rope Diameter, <i>d</i>			Diameter Tolerance		
mm	in.	Load on Rope	Min.	Max.	Out-of-Round Tolerance
10 and less	$\frac{3}{8}$ and less	None	+2%	+6%	5%
		10% MBF	+0%	+4%	3%
Greater than 10	Greater than $\frac{3}{8}$	None	+2%	+5%	5%
		10% MBF	+0%	+3%	3%

GENERAL NOTE: MBF = minimum breaking force.

(b) over 400 m (1,300 ft) and up to 1 000 m (3,280 ft):
+3.5% of specified length

(c) over 1 000 m (3,280 ft): +2.0% of specified length

NOTE: Ropes required with smaller length tolerance should be the subject of agreement between the supplier and purchaser.

SECTION 1.7 TESTING AND COMPLIANCE FOR NEWLY CONSTRUCTED ROPE

1.7.1 General

Steel wire ropes shall be manufactured in accordance with the applicable requirements of this Standard. The manufacturer shall be able to demonstrate compliance with this Standard by complying with either 1.7.2 or 1.7.3.

1.7.2 Compliance

The manufacture shall operate a quality assurance system that includes a sampling program that meets the following requirements:

1.7.2.1 For each new class, size, or grade of a given steel wire rope design, each manufacturer shall be able to present evidence from testing of at least one sample from each of three production lengths, showing that the steel wire rope conforms to the requirements as defined in this Part.

1.7.2.2 Future production lengths of the same class, size, and grade as in 1.7.2.1 shall be deemed to comply when, at a minimum, a sample from every twentieth production length is subjected to and successfully meets the requirements of the breaking force test.

Table 1.6.6.1.1-2 Tolerances on Rope Diameter (Stranded Rope) for Newly Constructed Rope With Steel or Steel-Based Composite Cores

Nominal Rope Diameter, <i>d</i>		Load on Rope	Diameter Tolerance		Out-of-Round Tolerance
mm	in.		Min.	Max.	
10 and less	$\frac{3}{8}$ and less	None	+0%	+3%	5%
		10% MBF	-1%	+2%	3%
Greater than 10	Greater than $\frac{3}{8}$	None	+0%	+3%	5%
		10% MBF	-1%	+2%	3%

GENERAL NOTES:

(a) The term "steel-based composite cores" refers to rope constructions with steel plus fiber (natural or synthetic) cores.

(b) MBF = minimum breaking force.

Table 1.6.6.1.2-1 Permissible Differences in Rope Diameter for Newly Constructed Rope

Nominal Rope Diameter, <i>d</i>		Percentage Allowable Difference
mm	in.	
8 and less	$\frac{5}{16}$ and less	5%
Greater than 8	Greater than $\frac{5}{16}$	4%

1.7.3 Acceptance Tests

1.7.3.1 Test Piece. When required by 1.7.1, one sample shall be tested from each production length.

1.7.3.2 Test Verification. When requested, the manufacturer shall allow the purchaser or his representative the opportunity to witness acceptance tests or to examine test records, to verify compliance with this Part.

NOTE: Test lengths required by the purchaser should be ordered as additional lengths.

1.7.3.3 Rope

1.7.3.3.1 Diameter. Measurements for diameter shall be taken on a straight portion of the rope at two positions spaced at approximately 1 m (or 3 ft) apart and at each position two diameters at right angles shall be measured. These measurements shall be performed both with and without tension. The respective average of each set of four measurements shall be within the tolerances given in Tables 1.6.6.1.1-1 and 1.6.6.1.1-2. The permissible difference between any two measurements at 90 deg at the same point expressed as a percentage shall be within the out-of-round tolerances given in Tables 1.6.6.1.1-1 and 1.6.6.1.1-2.

1.7.3.3.2 Breaking Force. When measured in accordance with the method specified in ASTM A931 or ISO 3108, the actual (measured) breaking force obtained shall be equal to or greater than the minimum breaking force specified in the appropriate part of this Part. When the minimum breaking force is not reached, two additional tests are required, both of which have to achieve the minimum breaking force.

1.7.3.4 Rope Wires

1.7.3.4.1 Tests. Tests on wires shall be carried out in respect of diameter, tensile strength, and torsions, and, where applicable, metallic coating in accordance with the methods in ASTM A1007 or ISO 2232. The manufacturer shall have the option to test wires either before or after fabrication of the rope.

NOTE: After-fabrication wire testing does not apply to compacted strand ropes.

1.7.3.4.2 Sampling. All main wires from the equivalent of one complete strand, including steel rope core if applicable, shall be tested. For the purposes of evaluating the test results, the rope manufacturer shall specify the nominal diameters and tensile grades of the wires.

(a) The sample selected shall be of sufficient length to allow for retest.

(b) The wires shall be selected at random.

(c) Filler wires and other non-load bearing wires shall be excluded from this test.

1.7.3.4.3 Levels of Acceptance

(a) *Wire Before Fabrication.* Wire samples tested before fabrication shall meet the requirements for the size and grade (level) specified by the supplier and as found in the appropriate wire standard.

(b) *Wire After Fabrication.* For each requirement in (1), (2), and (3) below, a maximum of 5% of wires tested is permitted to lie outside the values specified, rounded to the nearest whole number of wires. Where the same wire fails in more than one test, this is counted as one failure.

(1) *Diameter.* When tested in accordance with the wire standard referred to in the appropriate part of this standard; the 5% of the wires may exceed, by up to 50%, the specified tolerance for the nominal diameter.

(2) *Tensile Strength.* When tested in accordance with ASTM A1007, the measured values shall be within the tolerance specified in the wire standard referred to in the appropriate part of this standard with an additional tolerance of 50 N/mm² (7,000 psi) below the minimum value.

(3) *Torsion*. When tested in accordance with ASTM A1007, the measured values of wires of 0.5 mm (0.020 in.) diameter and greater shall be at least 85% of the values specified in the wire standard referred to in the appropriate part of this standard, rounded down to the next whole number. The measured value of wire diameters less than 0.5 mm (0.020 in.) for (2) and (3) shall be at or above the minimum values specified in the appropriate wire standard.

1.7.4 Special Purpose

Manufacturers complying with all requirements of 1.7.2 and 1.7.3 may use calculated breaking force to verify compliance with requirements for

(a) individual production length not included in sample testing, or

(b) individual production lengths of lesser grade ropes of the same size and same design that have not been included in the sample testing

NOTE: Examples of acceptable quality assurance systems are API Q1, ANSI/ASQC Q9001, and ISO 9001.

SECTION 1.8 ORDERING INFORMATION

1.8.1 Typical Information

Typical information used to order steel wire rope shall include items 1 through 7 in Table 1.8.1-1 and may include but is not limited to additional items noted.

1.8.2 Certification of Conformance and Test

A certificate of conformance and test shall confirm compliance with Part 1. It shall contain all of the information listed in (a). The items in (b) shall be completed as agreed between the supplier and the purchaser.

The additional information listed in (b) and (c) can be supplied under agreement between purchaser and supplier.

(a) *Confirmation Data*

- (1) certificate number
- (2) purchaser name and address
- (3) purchaser order number
- (4) rope supplier name and address
- (5) supplier order number
- (6) number traceable to manufacturer's production length

- (7) nominal length(s) of rope
- (8) rope designation, (nominal diameter, construction and core, lay and grade)
- (9) minimum breaking force in kilonewtons or pounds

(b) *Tests on Wires and Rope*

- (1) quality system registration number of the rope manufacturer, if applicable

- (2) approximate mass in kg/m (lb/ft)
- (3) wire standard used
- (4) number of wires tested
- (5) nominal dimensions of wire
- (6) measured dimensions of wire
- (7) breaking force of wire
- (8) tensile strength of wire
- (9) number of torsions completed (and test length)
- (10) mass of zinc (or zinc alloy)
- (11) actual (measured) diameter of rope
- (12) actual (measured) breaking force of rope
- (c) *Additional Information and Certification*
 - (1) space for additional information
 - (2) space for certification with provision for certifying the foregoing, name and position held, signature, and date

SECTION 1.9 PACKAGING AND IDENTIFICATION

1.9.1 Packaging

Unless otherwise specified by the purchaser, ropes shall be supplied in coils or on reels at the discretion of the manufacturer.

1.9.2 Identification

Each package of rope shall be legibly identified with at least the following information:

- (a) rope supplier and address
- (b) rope length and description
- (c) number traceable to manufacturer's production length

SECTION 1.10 REPLACEMENT CRITERIA

NOTES:

- (1) Replacement criteria for steel wire rope are based on the worst conditions of diameter and wire breaks. Crown wires are subject to both wear that reduces the diameter of the rope and the breaks that occur in the wear area. Breaks that are visible and occur outside of the crown wear area with the crown wire intact are called valley breaks.
- (2) Where ropes are subjected to reverse bends or where ropes are installed on nonmetallic sheaves or sheaves with nonmetallic liners or inserts, extra attention must be given to the rope due to possible acceleration of valley breaks.

1.10.1 Traction Drive Machines

1.10.1.1 Replacement requirements for steel wire (17) suspension ropes for traction elevators shall be as follows (see [Nonmandatory Appendix A](#)):

- (a) The steel wire rope(s) shall be replaced if the rope is permanently kinked, bent, or deformed in any way (see 1.10.5).

Table 1.8.1-1 Ordering Information

Item	Example 1, SI	Example 2, Imperial
1) Length	100 m	500 ft
2) Size (diameter)	10 mm	$\frac{3}{4}$ in.
3) Rope classification or construction (if known)	6 × 25	8 × 19S
4) Preformed or nonpreformed	Nonpreformed	Preformed
5) Lay direction and type	sZ	Right regular
6) Rope grade	1370/1770 Dual	Traction
7) Wire finish (bright or galvanized and type)	Drawn galvanized	Uncoated
8) Core type	Synthetic	Natural fiber
9) Applicable standard	ASME A17.6, Part 1	ASME A17.6, Part 1
10) Special requirements		
a) Termination of rope ends
b) Special length tolerance
c) Type of certificate
d) Special packaging and identification
e) Lubrication, other than as noted in 1.4.3
f) Prestretching

(b) For rope diameters equal to or greater than 8 mm (0.315 in.), the ropes shall be replaced in accordance with [1.10.1.2\(a\)](#) through [1.10.1.2\(g\)](#) and [1.10.3](#).

(c) For rope diameters less than 8 mm (0.315 in.), the ropes shall be replaced in accordance with [1.10.1.2\(a\)](#) through [\(g\)](#), [1.10.1.2.1](#), and [1.10.3](#). In addition, other replacement criteria based on the application shall be permitted to be applied and shall be documented in the Maintenance Control Program (see ASME A17.1/CSA B44, requirement 8.6.1.4.1).

- (17) **1.10.1.2** Criteria for replacement include at least one of the following:

(a) if the broken crown wires are equally distributed among the strands, when the number of broken wires per rope lay in the worst section of rope exceeds the values shown in the “Normal Wear Conditions,” first column of [Table 1.10.1.2-1](#).

(b) if the distribution of breaks is unequal and broken crown wires predominate in one or two strands, when the number of broken wires per rope lay in the worst section of rope or the minimum diameter exceeds the values shown in the “Normal Wear Conditions,” first column of [Table 1.10.1.2-1](#).

(c) if four wires, side-by-side, are broken across the crown of any strand, when the number of broken wires per rope lay in the worst section of rope exceeds the values shown in the “Normal Wear Conditions,” first column of [Table 1.10.1.2-1](#).

(d) if an unfavorable condition exists, such as but not limited to corrosion due to external conditions, excessive wear of individual wires in the strands, unequal tension, poor sheave grooves. The criteria for broken crown wires shall be the values indicated in the “Unfavorable Wear Conditions,” second column of [Table 1.10.1.2-1](#) for any of the conditions described above.

(e) if red dust or rouge exists, the criteria for broken wires shall be the values indicated in the “Rope Showing Rouge,” third column of [Table 1.10.1.2-1](#) for any of the conditions described above.

(f) if there is more than one valley break per rope lay.

(g) if there are any valley breaks at any location where rouge exists.

1.10.1.2.1 Steel wire ropes of less than 8 mm (0.315 in.) in diameter shall be replaced when there is evidence of rouge.

1.10.2 Winding Drum Machines

Suspension ropes shall be replaced on winding drum machines if any of the following applies:

(a) The broken crown wires are equally distributed among the strands, when the number of broken wires per rope lay in the worst section of rope exceeds 12.

(b) The broken crown wires predominate in one or two strands, when the number of broken wires per rope lay in the worst section of rope exceeds 6.

(c) There is more than one valley break per rope lay.

(d) There are any valley breaks at any location where rouge exists.

1.10.3 All Elevator Types

The suspension, compensation, and governor ropes shall be replaced when their actual diameter is reduced below the value shown in [Table 1.10.3-1](#). For nominal diameters not listed in [Table 1.10.3-1](#), the minimum diameter reduction shall be calculated using the criteria outlined in [Table 1.10.3-1](#), General Notes (a) and (b). Normal wear diameters, unfavorable wear, and rouge conditions as listed in the table shall apply.

**Table 1.10.1.2-1 Wire Breaks:
Crown Wire Breaks Per Lay Length**

Break Type	6-Strand Rope Applications		
	Normal Wear Conditions	Unfavorable Wear Conditions	Ropes Showing Rouge
Distributed breaks (max.)	24	12	12
Unequal breaks (max.)	8	4	4
4 side-by-side breaks	12	6	6

Break Type	8- and 9-Strand Rope Applications		
	Normal Wear Conditions	Unfavorable Wear Conditions	Ropes Showing Rouge
Distributed breaks (max.)	32	16	16
Unequal breaks (max.)	10	5	5
4 side-by-side breaks	16	8	8

GENERAL NOTES:

- (a) Where ropes are subjected to reverse bends or where ropes are installed on nonmetallic coated, plastic, fiber-reinforced plastic sheaves or sheaves with nonmetallic liners or inserts, extra attention must be given to any steel wire rope (6, 8, or 9 strand) due to possible acceleration of valley breaks.
- (b) This table does not apply to winding drum machines. See 1.10.2 for replacement criteria.
- (c) No more than one valley break per lay length and no valley breaks allowed if visible rouge.
- (d) For ropes less than 8 mm (0.315 in.), also see 1.10.1.2.1 for additional replacement requirements.

Compensation and governor ropes shall also conform to 1.10.1.1(a), and 1.10.1.2(a) through 1.10.1.2(g).

Measurement for diameter shall be taken on a straight portion of rope at the worst location. Two measurements at the same position at right angles shall be taken. The ropes shall be replaced if both of these measurements are below the replacement value. However, if only one of the measurements is below the replacement value, then the criteria for wire breaks under "Unfavorable Wear Conditions" shall apply. See Table 1.10.1.2-1.

1.10.4 Replacement of Ropes

Replacement of all ropes, except governor ropes (see ASME A17.1/CSA B44, requirement 8.6.3.4), shall conform to the requirements of 1.10.4.1 through 1.10.4.6.

1.10.4.1 Replacement ropes shall be as specified by the original elevator manufacturer or be at least equivalent in strength, weight, and design.

1.10.4.2 Ropes that have previously been installed and used on another installation shall not be reused.

1.10.4.3 When replacing suspension, compensating, and car or drum counterweight ropes, all ropes in a set shall be replaced, except as permitted by 1.10.5.

1.10.4.4 The ropes in the set shall be new, all from the same manufacturer and of the same material, grade, construction, and diameter.

1.10.4.5 Data tags conforming to ASME A17.1/CSA B44, requirement 2.20.2.2 shall be applied.

1.10.4.6 Suspension, car, and drum counterweight rope fastenings shall conform to ASME A17.1/CSA B44, requirement 2.20.9.

1.10.5 Replacement of a Single Suspension Rope

If one rope of a set is worn or damaged and requires replacement, the entire set of ropes shall be replaced; except, where one rope has been damaged during installation or acceptance testing prior to being subjected to elevator service, it shall be permissible to replace a single damaged rope with a new rope, provided that the requirements of 1.10.4.4 and of 1.10.5.1 through 1.10.5.1.6 are met.

NOTE: Damage includes but is not limited to kinked ropes.

1.10.5.1 The steel wire rope data for the replacement rope must correspond to the steel wire rope data specified in ASME A17.1/CSA B44, requirement 2.20.2.2.

1.10.5.2 The replacement rope shall be provided with a data tag conforming to ASME A17.1/CSA B44, requirement 2.20.2.2.

1.10.5.3 The suspension ropes, including the damaged rope, shall not have been shortened since their original installation.

1.10.5.4 The diameter of any of the remaining ropes shall not be less than the nominal diameter minus 0.4 mm (0.015 in.).

1.10.5.5 The tension of the new replacement rope shall be checked and adjusted as necessary at semimonthly intervals over a period of not less than 2 months after installation. If proper equalization of the rope tension cannot be maintained after 6 months, the entire set of suspension ropes shall be replaced.

1.10.5.6 The replacement rope shall be provided with the same type of suspension rope fastening used with the other ropes.

Table 1.10.3-1 Minimum Diameter

6-, 8-, and 9-Strand Rope Applications						
Nominal Rope Size	Normal Wear Conditions		Unfavorable Wear Conditions		Ropes Showing Rouge	
	mm	in.	mm	in.	mm	in.
4 mm	3.875	0.153	3.875	0.153	Note (1)	Note (1)
5 mm	4.844	0.191	4.844	0.191	Note (1)	Note (1)
6 mm	5.813	0.229	5.813	0.229	Note (1)	Note (1)
1/4 in.	6.152	0.242	6.152	0.242	Note (1)	Note (1)
6.5 mm	6.297	0.248	6.297	0.248	Note (1)	Note (1)
6.7 mm	6.491	0.256	6.491	0.256	Note (1)	Note (1)
5/16 in.	7.689	0.303	7.689	0.303	Note (1)	Note (1)
8 mm	7.500	0.295	7.500	0.295	7.750	0.305
9 mm	8.438	0.332	8.438	0.332	8.719	0.343
3/8 in.	8.930	0.352	8.930	0.352	9.227	0.363
10 mm	9.375	0.369	9.375	0.369	9.688	0.381
11 mm	10.31	0.406	10.31	0.406	10.66	0.420
7/16 in.	10.42	0.410	10.42	0.410	10.77	0.424
12 mm	11.25	0.443	11.25	0.443	11.63	0.458
1/2 in.	11.91	0.469	11.91	0.469	12.30	0.484
13 mm	12.19	0.480	12.19	0.480	12.59	0.496
14 mm	13.13	0.517	13.13	0.517	13.56	0.534
9/16 in.	13.39	0.527	13.39	0.527	13.84	0.545
15 mm	14.06	0.554	14.06	0.554	14.53	0.572
5/8 in.	14.88	0.586	14.88	0.586	15.38	0.605
16 mm	15.00	0.591	15.00	0.591	15.50	0.610
11/16 in.	16.37	0.645	16.37	0.645	16.92	0.666
18 mm	16.88	0.664	16.88	0.664	17.44	0.687
19 mm	17.81	0.701	17.81	0.701	18.41	0.725
3/4 in.	17.86	0.703	17.86	0.703	18.45	0.727
20 mm	18.75	0.738	18.75	0.738	19.38	0.763
13/16 in.	19.35	0.762	19.35	0.762	19.99	0.787
22 mm	20.63	0.812	20.63	0.812	21.31	0.839
7/8 in.	20.84	0.820	20.84	0.820	21.53	0.848
15/16 in.	22.32	0.879	22.32	0.879	23.07	0.908
1 in.	23.81	0.938	23.81	0.938	24.61	0.969
1 1/8 in.	26.79	1.055	26.79	1.055	27.68	1.090
1 1/4 in.	29.77	1.172	29.77	1.172	30.76	1.211
1 3/8 in.	32.74	1.289	32.74	1.289	33.83	1.332
1 1/2 in.	35.72	1.406	35.72	1.406	36.91	1.453

GENERAL NOTES:

- (a) Maximum allowable diameter reduction below nominal for rope diameters less than 8 mm is 3.125%.
- (b) Maximum allowable diameter reduction below nominal for rope diameters equal to or greater than 8 mm are as follows:
- (1) Normal wear or unfavorable wear conditions is 6.25%.
 - (2) Ropes showing rouge is 3.125%.

NOTE: (1) For ropes less than 8 mm, the rope must be replaced if rouge is evident. See 1.10.1.2.1.

Part 2

Aramid Fiber Ropes for Elevators

SECTION 2.1 SCOPE

Part 2 covers the general requirements for aramid fiber ropes for suspension and compensation applications on elevators within the Scope of ASME A17.1/CSA B44.

NOTE: This Part is written in the combined format, presenting requirements for rope products in both Imperial units, utilized historically in the U.S. Customary and SI units as recognized by CSA B44 and ASME A17.1 standards. The values stated in SI (metric) units or Imperial units are to be regarded separately. The values are not exact equivalents; therefore, each system must be used independently of the other.

SECTION 2.2 REFERENCES

Part 2 incorporates by dated or undated reference, provisions from other publications. These normative references are cited at their appropriate place in the text, and the publications are listed. For dated references, subsequent amendments to or revisions of any of these publications apply to this Standard only when incorporated by amendment or revision. For undated references, the latest edition would apply.

ANSI/ASQC Q9001, Quality management systems — Requirements

Publisher: American Society for Quality (ASQ), P.O. Box 3005, Milwaukee, WI 53201 (www.asq.org)

API Spec. Q1, Specification for Quality Programs for the Petroleum, Petrochemical and Natural Gas Industry

Publisher: American Petroleum Institute (API), 1220 L Street, NW, Washington, DC 20005 (www.api.org)

ASME A17.1/CSA B44 (latest edition), Safety Code for Elevators and Escalators

ASME A17.2 (latest edition), Guide for Inspection of Elevators, Escalators, and Moving Walks

Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5900 (www.asme.org)

ASTM D885/D885M, Standard Test Methods for Tire Cords, Tire Cord Fabrics, and Industrial Filament Yarns Made From Manufactured Organic-Base Fibers — Yarn Test

ASTM D2343, Standard Test Methods for Tensile Properties of Glass Fiber Strands, Yarns, and Rovings Used in Reinforced Plastics — Impregnated Strand Test

ASTM D7269, Standard Test Methods for Tensile Testing of Aramid Yarns

Publisher: American Society for Testing and Materials (ASTM International), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

CI 1500-02, Test Methods for Fiber Rope

Publisher: Cordage Institute (CI), 994 Old Eagle School Road, Wayne, PA 19087 (www.ropecord.com)

ISO 9001, Quality management systems — Requirements

Publisher: International Organization for Standardization (ISO), Central Secretariat, Chemin de Blandonnet 8, Case Postale 401, 1214 Vernier, Geneva, Switzerland (www.iso.org)

SECTION 2.3 TERMINOLOGY

2.3.1 Descriptions of Terms Specific to Part 2

2.3.1.1 Stranded Aramid Fiber Rope. An assembly of impregnated strands of aramid yarn in one or more helically laid layers around a center aramid or other synthetic core.

2.3.1.2 Impregnated Strand. An assembly of essentially parallel yarns held in a circular configuration by means of a bonding agent.

2.3.1.3 Rope Components

2.3.1.3.1 Load-Carrying Strand. A strand whose yarns contribute towards the breaking force of the rope.

2.3.1.3.2 Non-Load-Carrying Strand. A strand whose yarns do not contribute towards the breaking force of the rope.

2.3.1.3.3 Core. The central element around which the load- and/or non-load-carrying strands are laid.

2.3.1.3.4 Center Strand. An aramid yarn strand acting as the core of the rope. This strand shall be permitted to be a load-carrying strand.

2.3.1.3.5 Rope Cover. A protective outer coating that prevents the yarns in load-carrying strands from abrasion.

2.3.1.3.6 Wear Sleeve. An internal coating that protects yarns in load-carrying strands from abrasion.

2.3.1.3.7 Filament. A polymeric fiber of indefinite length that has a nominal diameter of 5 microns to 50 microns.

2.3.1.3.8 Yarn. A continuous assembly of 100 to 2,000 essentially parallel filaments. Yarns can be further assembled into strands, woven fabrics, knitted fabrics, etc. A yarn is the basic purchased and tested component.

2.3.2 Rope Terminology

2.3.2.1 Rope Types

2.3.2.1.1 Helically Stranded Rope. An assembly of helically laid yarn strands.

(a) *Single Layer.* A rope consisting of one strand layer helically wound around a core.

(b) *Multilayer.* A rope consisting of two or more strand layers helically wound around a core.

2.3.2.1.2 Parallel-Stranded Rope. An assembly of parallel laid yarn strands.

(a) *Single Layer.* A rope consisting of one strand layer around a core.

(b) *Multilayer.* A rope consisting of two or more strand layers around a core.

2.3.2.2 Rope Classification and Construction

2.3.2.2.1 Rope Classification. A grouping of ropes of similar characteristics on the basis of the number of layers, the number of strands, and their shape.

2.3.2.2.2 Rope Construction. The detail and arrangement of various elements of the rope, taking into account the number of strands, the arrangement of strands, wear sleeves, and covers where provided.

2.3.2.3 Rope Grade. A level of requirement of breaking strength of the aramid yarn that is designated by a number based on N/mm^2 (psi).

2.3.3 Dimensional Characteristics

2.3.3.1 Circular Cross-Section Designs (Type I)

(a) *Diameter of the Rope.* The diameter of a circle circumscribing the rope cross-section or the designed diameter of the rope cover.

(b) *Functional Diameter of the Rope.* The diameter of the load-carrying strands used to determine the sheave to rope ratios as stipulated by the manufacturer.

(c) *Lay Length.* The distance measured parallel to the longitudinal rope axis, in which the outer strands of a stranded rope make one complete turn about the axis of the rope.

2.3.3.2 Noncircular Cross-Section Designs (Type II)

(a) The nominal size of the noncircular designs are described by the maximum measured outside width and depth dimensions. The thickness dimension is the dimension for the axis of bending.

(b) The functional thickness of the maximum dimension of the load-carrying strands in the axis of bending. For noncircular section designs, functional thickness is treated as functional diameter for determining minimum sheave diameters.

2.3.4 Mechanical Properties

2.3.4.1 Aramid Fiber

2.3.4.1.1 Aramid Yarn Tensile Strength. The ratio between the maximum force obtained in a tensile test and the nominal cross-sectional area of the test yarn. Requirements for aramid tensile strength is determined by the yarn tensile strength grade as specified by ASTM D885/D885M or ASTM D7269, and requirements for aramid strand tensile strength grade as specified by ASTM D2343.

2.3.4.1.2 Aramid Yarn/Strand Tensile Modulus. The ratio between the stress and unit strain of the test yarn/strand.

2.3.4.2 Rope

2.3.4.2.1 Minimum Breaking Force (MBF). The specified value that the actual (measured) breaking force must meet or exceed in a prescribed tensile test.

2.3.4.2.2 Actual (Measured) Breaking Force. The breaking force obtained using the prescribed tensile test method per CI 1500.

2.3.4.2.3 Calculated Breaking Force. The value of breaking force obtained from the sum of the measured breaking forces of all of the yarns in the rope, before rope making.

2.3.4.2.4 Rated Breaking Force. A value of breaking force, less than or equal to minimum breaking force, published by the manufacturer to which ASME A17.1/CSA B44 rope factors of safety are applied.

2.3.4.2.5 Residual Strength. The actual breaking strength of a suspension member at any time during its operational life cycle.

NOTE: The residual strength will be reduced as the suspension member is used and is subjected to wear.

Table 2.4.1.1-1 Nominal Aramid Yarn Property Values

Yarn Type	Yarn Tensile Strength		Yarn Tensile Modulus		Yarn Creep (Per Decade of Time)
	N/mm ²	psi	N/mm ² × 10 ³	psi × 10 ⁶	
Standard aramid	2 896	420,000	72.40	10.5	0.05%
High modulus aramid	2 827	410,000	106.90	15.5	0.02%

2.3.4.3 Rope Stretch (Extension)

2.3.4.3.1 Constructional Stretch. The amount of extension that is attributed to the initial bedding down of the filaments and yarns within the strands and the strands within the rope due to loading.

2.3.4.3.2 Elastic Stretch. The amount of recoverable extension that follows Hooke's Law within certain limits due to application of load.

2.3.4.3.3 Permanent Stretch. The amount of nonelastic extension.

SECTION 2.4 MATERIAL

2.4.1 Aramid Properties

2.4.1.1 Aramid fiber shall have nominal fiber properties per the yarn (ASTM D885/D885M or ASTM D7269) or impregnated strand (ASTM D2343) test values listed in [Table 2.4.1.1-1](#) or [2.4.1.1-2](#), respectively.

2.4.1.2 Rope cover may be polyurethane skin or other suitable material agreed to between purchaser and supplier.

2.4.1.3 Wear sleeves may be polyurethane or other suitable material.

2.4.1.4 Strand impregnating material may be made from polyurethane, polyesters, or other suitable material.

2.4.1.5 Aramid fibers shall maintain strength and flexibility properties throughout a temperature range of -46°C to 54°C (-50°F to 130°F) and a relative humidity range of 0% to 100%.

SECTION 2.5**PROPERTIES AND TOLERANCES OF NEWLY CONSTRUCTED ROPE****2.5.1 Classification**

Aramid fiber ropes shall be normally of two basic classifications.

- (a) Type I, circular jacketed rope
- (b) Type II, noncircular jacketed rope

2.5.2 Rope Core

Aramid fiber ropes shall be normally constructed with an aramid core, unless specified otherwise. Other cores shall be the subject of agreement between supplier and purchaser.

2.5.3 Rope Grade

Rope grade shall be based on the yarn commercial designation specified in [Table 2.4.1.1-1](#) or equivalent.

2.5.4 Rope Lay

Rope lay shall be specified by purchaser. Rope strands (single or multi-element) shall be helically or parallel laid. The direction right (Z) or left (S) shall correspond to the direction of lay of the outer strands of the rope in relation to the longitudinal axis of the rope.

2.5.5 Lay Length

The rope lay length shall be specified between the purchaser and manufacturer.

2.5.6 Rope Mass

The rope mass shall be specified by the manufacturer in either kg/m or lb/ft.

2.5.7 Rope Length

The actual length of rope supplied, expressed in meters or feet shall be the specified length subject to the following limits of tolerance:

Table 2.4.1.1-2 Aramid Resin Impregnated Strand Property Values

Strand Type	Strand Tensile Strength		Strand Tensile Modulus	
	N/mm ²	psi	N/mm ² × 10 ³	psi × 10 ⁶
Standard modulus aramid yarns	3 620	525,000	82.74	12.0
High modulus aramid yarns	3 620	525,000	124.11	18.0

Table 2.6.2-1 Tolerances on Diameter

Nominal Rope Diameter, <i>d</i>		Load on Rope	Diameter Tolerance		Out-of-Round Tolerance
mm	in.		Min.	Max.	
11 and less	$\frac{7}{16}$ and less	None	0%	+8%	5%
		10% MBF	0%	+4%	3%
Greater than 11	Greater than $\frac{7}{16}$	None	0%	+5%	5%
		10% MBF	0%	+3%	3%

GENERAL NOTE: MBF = minimum breaking force.

(a) up to and including 400 m (1,300 ft): +5% of specified length

(b) over 400 m (1,300 ft) up to 1 000 m (3,280 ft): +3.5% of specified length

(c) over 1 000 m (3,280 ft): +2% of specified length

2.5.8 Protection From Exposure

Means shall be provided to prevent damage to aramid fibers as a result of exposure to weather and ultraviolet light.

2.5.9 Temperature Resistance

The final rope construction shall be self-extinguishing; the average flame time after removal of the flame source shall not exceed 15 sec. The suspension means shall maintain functional suspension capability up to 121°C (250°F) ambient hoistway and machine room temperatures.

SECTION 2.6

NEWLY CONSTRUCTED ROPE DIMENSIONS FOR CIRCULAR CROSS-SECTION DESIGNS (TYPE I)

2.6.1 Rope Diameter

The nominal rope size shall be specified by the purchaser and shall be the dimension by which the rope is designated.

2.6.2 Tolerances on Nominal Rope Diameter

Measurements for diameter shall be taken on a straight portion of the rope, at two positions spaced at approximately 1 m (3 ft) apart and at each position two diameters at right angles shall be measured. These measurements shall be performed both with and without tension. The respective average of each set of four measurements shall be within the tolerances given in Table 2.6.2-1. The permissible difference between any two measurements at 90 deg at the same point expressed as a percentage shall be within the out-of-round tolerances given in Table 2.6.2-1.

SECTION 2.7

NEWLY CONSTRUCTED ROPE DIMENSIONS FOR NONCIRCULAR CROSS-SECTION DESIGNS (TYPE II)

2.7.1 Rope Dimensions

The nominal rope size shall be specified by the purchaser and shall be the designated in terms of a width and thickness dimension. The thickness dimension is in the axis of bending over the sheaves.

2.7.2 Tolerances on Nominal Noncircular Rope Dimensions

Measurements for width and thickness shall be taken on a straight portion of the rope, at two positions spaced at approximately 1 m (3 ft) apart. These measurements shall be performed both with and without tension. The respective average of each set of four measurements shall be within the tolerances given in Table 2.7.2-1. The permissible difference between any two measurements as a percentage shall be within the tolerances given in Table 2.7.2-1.

SECTION 2.8

TESTING AND COMPLIANCE

2.8.1 General

Aramid fiber ropes shall be manufactured in accordance with the applicable requirements of this Part. The manufacturer shall be able to demonstrate compliance with this Part by complying with either 2.8.2 or 2.8.3.

2.8.2 Compliance

The manufacturer shall operate a quality assurance system that includes a sampling program that meets requirements of 2.8.2.1 and 2.8.2.2.

2.8.2.1 For each new class or size or grade of a given rope construction design, each manufacturer shall be able to present evidence from testing of at least one sample from each of three production lengths, showing that the rope conforms to the requirements as defined in this Part.

Table 2.7.2-1 Tolerances on Dimensions

Nominal Rope Depth, <i>d</i>			Thickness Tolerance		Width Tolerance	
mm	in.	Load on Rope	Min.	Max.	Min.	Max.
11 and less	$\frac{7}{16}$ and less	None	0%	+5%	0%	+3%
		10% MBF	0%	-5%	0%	-3%
Greater than 11	Greater than $\frac{7}{16}$	None	0%	+5%	0%	+3%
		10% MBF	0%	-5%	0%	-3%

GENERAL NOTE: MBF = minimum breaking force.

2.8.2.2 Future production lengths of the same class, size, and grade as in 2.8.2.1 shall be deemed to comply when, at a minimum, a sample from every twentieth production length is subjected to and successfully meets the requirements of the breaking force test.

2.8.3 Acceptance Tests

2.8.3.1 Test Piece. One sample shall be tested from each production length.

2.8.3.2 Test Verification. When requested, the manufacturer shall allow the purchaser or their representative the opportunity to witness acceptance tests or to examine test records to verify compliance with this Part.

NOTE: Examples of acceptable quality assurance systems are API Q1, ANSI/ASQC Q9001, and ISO 9001.

SECTION 2.9 REPLACEMENT CRITERIA

2.9.1 Replacement of Ropes

Replacement of all aramid fiber suspension and compensation ropes shall conform to the requirements of 2.9.1.1 through 2.9.1.6.

2.9.1.1 Replacement ropes shall be as specified by the original elevator manufacturer or be at least equivalent in strength, weight, and design.

2.9.1.2 Ropes that have previously been installed and used on another installation shall not be reused.

2.9.1.3 When replacing suspension or compensating ropes, all ropes in a set shall be replaced, except as permitted by 2.9.3.

2.9.1.4 The ropes in the set shall be new, all from the same manufacturer and of the same material, grade, construction, and diameter.

2.9.1.5 Data tags conforming to ASME A17.1/CSA B44, requirement 2.20.2.2 shall be applied.

2.9.1.6 Suspension or compensating rope fastenings shall conform to ASME A17.1/CSA B44 requirement 2.20.9.

2.9.2 Replacement Due to Wear

(a) Replacement due to wear shall be considered in either of the following categories:

(1) normal wear of the rope cover and fatigue limit
(2) internal abrasive wear limit of the load carrying strands

(b) The entire set of ropes shall be replaced when
(1) the elevator rope cover, through wear or damage, results in any load carrying yarn wear or damage; or
(2) the residual strength criterion is reached

2.9.3 Replacement Due to Damage

The suspension or compensating rope shall be replaced when load-carrying yarns are damaged by an exterior source. Damage to the rope cover itself is not a criterion for replacement as long as load-carrying yarns have not been damaged or exposed to wear. If one rope of a set is damaged during installation or acceptance testing prior to being subjected to elevator service, it is permissible to replace the damaged rope only. In all other cases, the entire set must be replaced.

2.9.3.1 The rope data for the replacement rope must correspond to the rope data specified in ASME A17.1/CSA B44, requirement 2.20.2.2.

2.9.3.2 The replacement rope shall be provided with a data tag conforming to ASME A17.1/CSA B44, requirement 2.20.2.2.

2.9.3.3 The suspension ropes, including the damaged rope, shall not have been shortened since their original installation.

2.9.3.4 The dimensions of any of the remaining ropes shall comply with Table 2.6.2-1 or 2.7.2-1.

2.9.3.5 The tension of the new replacement rope shall be checked and adjusted as necessary at semi-monthly intervals over a period of not less than 2 months after installation. If proper equalization of the rope tension cannot be maintained after 6 months, the entire set of suspension ropes shall be replaced.

2.9.3.6 The replacement rope shall be provided with the same type of suspension rope fastening used with the other ropes.

2.9.3.7 The rope shall be new, from the same manufacturer, and of the same material, grade, construction, and dimensions.

2.9.4 Replacement Due to Residual Strength Criterion

The elevator manufacturer, using information from the rope manufacturer and considering the application, shall establish the residual strength criterion to ensure that the residual strength of the aramid fiber rope is not less than 60% of the rated breaking force at the time of replacement.

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6 2017

Part 3

Noncircular Elastomeric-Coated Steel Suspension Members for Elevators

SECTION 3.1 SCOPE

Part 3 covers the general requirements for noncircular elastomeric-coated steel suspension members for suspension and compensation applications on elevators within the Scope of ASME A17.1/CSA B44.

NOTE: This Part is written in SI units recognized by the ASME A17.1/CSA B44 Code.

SECTION 3.2 REFERENCES

This Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at their appropriate place in the text and the publications are listed. For dated references, subsequent amendments to or revisions of any of these publications apply to this Standard only when incorporated by amendment or revision. For undated references, the latest edition would apply.

ANSI/ASQC Q9001, Quality management systems — Requirements

Publisher: American Society for Quality (ASQ), P.O. Box 3005, Milwaukee, WI 53201 (www.asq.org)

API Spec. Q1, Specification for Quality Programs for the Petroleum, Petrochemical and Natural Gas Industry

Publisher: American Petroleum Institute (API), 1220 L Street, NW, Washington, DC 20005 (www.api.org)

ASME A17.1/CSA B44 (latest edition), Safety Code for Elevators and Escalators

ASME A17.2 (latest edition), Guide for Inspection of Elevators, Escalators, and Moving Walks

Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5990 (www.asme.org)

ASTM D395, Standard Test Methods for Rubber Property — Compression Set

ASTM D624, Standard Test Method for Tear Strength of Conventional Vulcanized Rubber and Thermoplastic Elastomers

ASTM D1456, Standard Test Method for Rubber Property — Elongation at Specific Stress

ASTM D2240, Standard Test Method for Rubber Property — Durometer Hardness

ASTM D2969, Standard Test Methods for Steel Tire Cords

ASTM D5963, Standard Test Method for Rubber Property — Abrasion Resistance (Rotary Drum Abrader)

Publisher: American Society for Testing and Materials (ASTM International), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

ISO 9001, Quality management systems — Requirements
Publisher: International Organization for Standardization (ISO), Central Secretariat, Chemin de Blandonnet 8, Case Postale 401, 1214 Vernier, Geneva, Switzerland (www.iso.org)

SECTION 3.3 TERMINOLOGY

3.3.1 Descriptions of Terms Specific to Part 3

3.3.1.1 Steel Cord. An assembly of steel strands each comprising several steel wires. The strands are helically laid around a central core strand. See 1.3.1.4.2. For definition of wire, see 1.3.1.2. For definition of strand, see 1.3.1.3.1.

3.3.1.2 Noncircular Elastomeric-Coated Steel Suspension Member. A noncircular suspension member, such as an elastomeric-coated steel belt comprising several steel cords arranged in parallel and molded within a coating.

3.3.1.3 Cord Cores. The central elements, usually of steel (unless specified otherwise) around which the strands are helically laid.

3.3.1.4 Noncircular Elastomeric-Coated Steel Suspension Member Grade. A level of requirement of the breaking force of the noncircular elastomeric-

coated steel suspension member, which is designated by the minimum breaking force in kilonewtons (kN).

3.3.2 Dimensional Characteristics

3.3.2.1 Steel Cords

3.3.2.1.1 Cord Diameter. The diameter of a circle that circumscribes the cross-section of a cord. This diameter is used for evaluating diameter ratios.

3.3.2.1.2 Cord Lay Length. That distance measured parallel to the longitudinal member axis, in which the outer strands of the cord make one complete turn about the axis of the cord.

3.3.2.1.3 Number of strands in a cord.

3.3.2.1.4 Number of steel wires in a strand.

3.3.2.2 Molded Noncircular Elastomeric-Coated Steel Suspension Member

3.3.2.2.1 Number of steel cords in a noncircular elastomeric-coated steel suspension member.

3.3.2.2.2 Cord Pitch. The spacing between adjacent cord centerlines in the noncircular elastomeric-coated steel suspension member.

3.3.2.2.3 Noncircular Elastomeric-Coated Steel Suspension Member Width. The dimension of the cross-section of the molded noncircular suspension member, measured in the direction of sheave axis.

3.3.2.2.4 Noncircular Elastomeric-Coated Steel Suspension Member Thickness. The dimension of the cross-section of the molded noncircular suspension member measured perpendicular to the direction of the sheave axis.

3.3.3 Mechanical Properties

3.3.3.1 Steel Cord, Minimum Breaking Force (MBF). Specified value that the actual (measured) steel cord breaking force must meet or exceed in a prescribed tensile test.

3.3.3.2 Rated Breaking Force. A value of breaking force, less than or equal to minimum breaking force, published by the manufacturer to which ASME A17.1/CSA B44 rope factors of safety are applied.

3.3.3.3 Noncircular Elastomeric-Coated Steel Suspension Member, Minimum Breaking Force. Specified value that the actual (measured) noncircular elastomeric-coated steel suspension member breaking force must meet or exceed in a prescribed tensile test.

3.3.3.4 Noncircular Elastomeric-Coated Steel Suspension Member Stretch (Extension)

3.3.3.4.1 Constructional Stretch. Amount of extension that is attributed to the initial bedding down of the wires within strands and the strands within the cords due to member loading.

3.3.3.4.2 Elastic Stretch. Amount of recoverable extension that follows Hooke's Law, within certain limits due to application of load.

3.3.3.4.3 Permanent Stretch. Nonelastic extension.

3.3.3.5 Residual Strength. The actual breaking strength of a suspension member at any time during its operational life cycle.

NOTE: The residual strength will be reduced as the suspension member is used and is subjected to wear.

SECTION 3.4 MATERIAL

3.4.1 Construction

3.4.1.1 Steel wire used in cord construction may be carbon or alloy steel manufactured to meet the tensile strength properties and durability requirements specified by the noncircular elastomeric-coated steel suspension member manufacturer or user. Specified wire tensile strength values shall be within the range stated as follows. Mechanical properties shall be measured to ASTM D2969-89.

Specified Tensile Strength, N/mm ²	
Min.	Max.
1 570	3 500

3.4.1.2 Steel wires or cords may be plated with corrosion reducing materials as required by the noncircular elastomeric-coated steel suspension member manufacturer or user.

3.4.1.3 Elastomeric coating material may be polyurethane or other suitable material that meets the durability, flexibility, and traction requirements specified by the noncircular elastomeric-coated steel suspension member manufacturer or user. Mechanical properties to be measured to ASTM D1456, D2240, D5963, D395, or equivalents of these.

SECTION 3.5 PROPERTIES AND TOLERANCES

3.5.1 Classification

Noncircular elastomeric-coated steel suspension member shall be classified by the width and thickness, number of cords, cord diameter, and coating material.

Table 3.5.7-1 Tolerances on Nominal Noncircular Elastomeric-Coated Steel Suspension Members Sizes

Load on Suspension Member, kN	Tolerance				Flatness
	Width		Thickness		
	Min.	Max.	Min.	Max.	
0 to 10% MBF	-5%	+5%	-5%	+5%	3%

3.5.2 Cord Core

Cords shall be constructed with a steel core unless specified otherwise. Other cores shall be determined by agreement between supplier and purchaser.

3.5.3 Noncircular Elastomeric-Coated Steel Suspension Member Grade

See 3.3.1.4.

3.5.4 Cord Lay

The cord lay shall be specified between purchaser and manufacturer.

3.5.5 Noncircular Elastomeric-Coated Steel Suspension Member Mass

The suspension member mass shall be specified in kg/m (lb/ft) by the manufacturer.

3.5.6 Noncircular Elastomeric-Coated Steel Suspension Member Length

The actual length of noncircular elastomeric-coated steel suspension member supplied expressed in meters shall be specified by the manufacturers subject to tolerances agreed upon by manufacturer and purchaser.

3.5.7 Dimensional Tolerances

Tolerances on cord diameter shall be agreed upon by manufacturer and purchaser. The dimensional tolerances of the noncircular elastomeric-coated steel suspension members shall be as indicated in Table 3.5.7-1.

SECTION 3.6

TESTING AND COMPLIANCE

3.6.1 General

Noncircular elastomeric-coated steel suspension members shall be manufactured in accordance with the applicable requirements of this Standard. The manufacturer shall be able to demonstrate compliance with this Part by complying with either 3.6.2 or 3.6.3.

3.6.2 Compliance

The manufacturer shall operate a quality assurance system that includes a sampling program that meets requirements of 3.6.2.1 and 3.6.2.2.

3.6.2.1 For each new class, size, or grade of a given noncircular elastomeric-coated steel suspension member design, each manufacturer shall be able to present evidence from testing of at least one sample from each of three production lengths, showing that the noncircular elastomeric-coated steel suspension member conforms to the minimum requirements as defined in this Part.

3.6.2.2 Future production lengths of the same class, size, and grade as in 3.6.2.1 shall be deemed to comply when, at a minimum, a sample from every twentieth production length is subjected to and successfully meets the requirements of the breaking force test.

3.6.3 Acceptance Tests

3.6.3.1 Test Piece. One sample shall be tested from each production length.

3.6.3.2 Test Verification. When requested, the manufacturer shall allow the purchaser or his representative the opportunity to witness acceptance tests or to examine test records to verify compliance with this Part.

NOTE: Examples of acceptable quality assurance systems are API Q1, ANSI/ASQC Q9001, and ISO 9001.

SECTION 3.7

REPLACEMENT CRITERIA

3.7.1 Replacement of Members

Replacement of all noncircular elastomeric-coated steel suspension members shall conform to the requirements of 3.7.1.1 through 3.7.1.6.

3.7.1.1 Replacement members shall be as specified by the original elevator manufacturer or be at least equivalent in strength, weight, and design.

3.7.1.2 Members that have previously been installed and used on another installation shall not be reused.

3.7.1.3 When replacing suspension or compensating members, all members in a set shall be replaced, except as permitted by 3.7.3.

3.7.1.4 The members in the set shall be new, all from the same manufacturer and of the same material, grade, construction, and dimensions.

3.7.1.5 Data tags conforming to ASME A17.1/CSA B44, requirement 2.20.2.2 shall be applied.

3.7.1.6 Suspension or compensating member fastenings shall conform to ASME A17.1/CSA B44, requirement 2.20.9.

3.7.2 Replacement Due to Wear

The noncircular elastomeric-coated steel suspension member shall be replaced when any of the following occurs:

(a) The steel cords, strands or wires break through the elastomeric coating.

(b) The elastomeric coating has been worn so that any steel cord is exposed to wear.

(c) There is evidence of red rouging on any part of the noncircular elastomeric-coated steel suspension member except where continuous monitoring of the steel cords for the residual strength criteria of ASME A17.1/CSA B44, requirement 2.20.8.3 is applied. (In noncircular elastomeric-coated steel suspension members manufactured with transverse slots, rouging will first be evident in the slots, however not all red discoloration is rouging).

If any one member is replaced due to wear, the complete set of similarly utilized members on that elevator shall be replaced.

3.7.3 Replacement Due to Damage

The noncircular elastomeric-coated steel suspension member shall be replaced when load-carrying cords are damaged by an exterior source. Damage to the member coating itself is not a criterion for replacement as long as load-carrying cords have not been damaged or exposed to wear. If one member of a set is damaged during installation or acceptance testing prior to being subjected to elevator service, it is permissible to replace the damaged member only. In all other cases, the entire set must be replaced.

3.7.3.1 The member data for the replacement member must correspond to the member data specified in ASME A17.1/CSA B44, requirement 2.20.2.2.

3.7.3.2 The replacement member shall be provided with a data tag conforming to ASME A17.1/CSA B44, requirement 2.20.2.2.

3.7.3.3 The suspension members, including the damaged member, shall not have been shortened since their original installation.

3.7.3.4 The dimensions of any of the remaining members shall comply with [Table 3.5.7-1](#).

3.7.3.5 The tension of the new replacement member shall be checked and adjusted as necessary at semi-monthly intervals over a period of not less than 2 months after installation. If proper equalization of the member tension cannot be maintained after 6 months, the entire set of suspension members shall be replaced.

3.7.3.6 The replacement member shall be provided with the same type of suspension member fastening used with the other members.

3.7.3.7 The noncircular elastomeric-coated steel suspension member shall be replaced if the member is permanently kinked, bent, or deformed in any way.

3.7.4 Replacement Due to Residual Strength Criterion

The noncircular elastomeric-coated steel suspension member shall be replaced if the residual strength criterion of the load-carrying cords is reached.

The elevator manufacturer using information from the noncircular elastomeric-coated steel suspension member manufacturer and considering the application, shall establish the residual strength criterion to ensure that the residual strength of the noncircular elastomeric-coated steel suspension member is not less than 60% of the rated breaking force at the time of replacement.

MANDATORY APPENDIX I

ROPE CLASSIFICATIONS USED IN PART 1

SECTION I-1 BREAKING FORCE AND DIAMETER TOLERANCE

Tables I-1.1-1, I-1.1-2, I-1.1-3, and I-1.1-4 show the breaking forces and diameter tolerances of the more common classes, sizes, and grades of steel wire rope under Part 1. The following requirements apply:

- (a) Minimum breaking forces listed apply to uncoated or drawn-galvanized ropes.
- (b) Minimum breaking forces for final-galvanized ropes are 10% lower than the values listed.
- (c) Minimum breaking forces for compacted strand ropes are 10% higher than values listed.

ASMENORMDOC.COM : Click to view the full PDF of ASME A17.6-2017