

INTERNATIONAL STANDARD

IEC
61892-4

First edition
2007-06

**Mobile and fixed offshore units –
Electrical installations –**

**Part 4:
Cables**

IECNORM.COM : Click to view the full PDF of IEC 61892-4:2007



Reference number
IEC 61892-4:2007(E)



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembé
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch

Tel.: +41 22 919 02 11

Fax: +41 22 919 03 00


INTERNATIONAL STANDARD

IEC
61892-4

First edition
2007-06

Mobile and fixed offshore units – Electrical installations –

Part 4: Cables

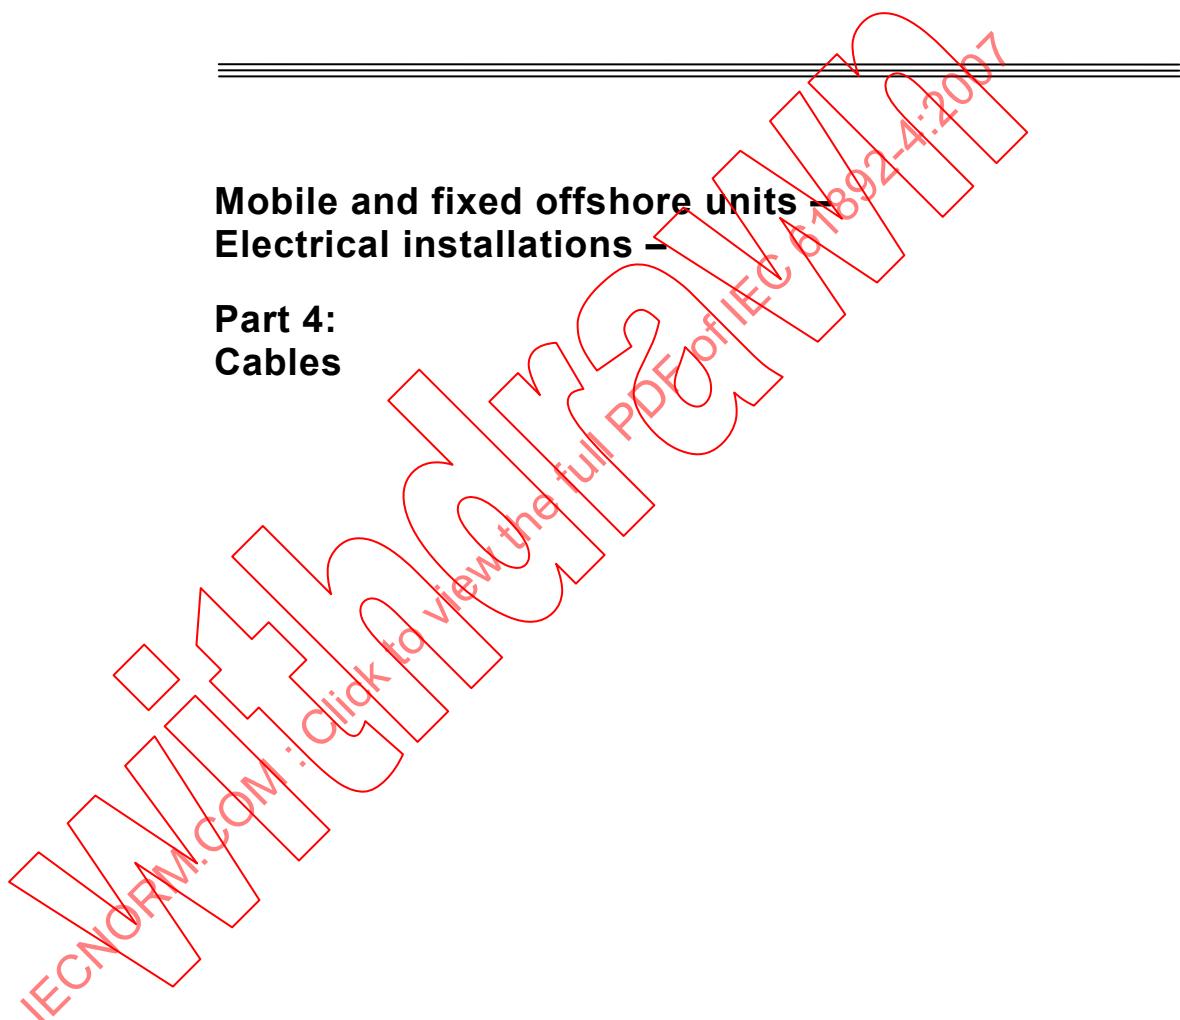

Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

X

For price, see current catalogue

CONTENTS

FOREWORD	4
INTRODUCTION	6
1 Scope	7
2 Normative references	7
3 Terms and definitions	8
4 Types, installation and operating conditions of cables	10
4.1 Types of cables	10
4.2 Voltage rating	10
4.2.1 Power frequency cables	10
4.2.2 Control and instrumentation cables	11
4.3 Cross-sectional areas of conductors and current-carrying capacities	11
4.3.1 Cross-sectional areas of conductors	11
4.3.2 Current-carrying capacities	13
4.3.3 Current-carrying capacities for continuous service	13
4.3.4 Correction factors for different ambient air temperatures	17
4.3.5 Correction factors for short time duty	18
4.3.6 Correction factors for cable grouping	21
4.4 Voltage drop	22
4.5 Estimation of lighting loads	22
4.6 Parallel connection of cables	22
4.7 Separation of circuits	22
4.8 Short circuit capacity (withstand capability)	22
4.9 Conductor	22
4.10 Insulation material	23
4.11 Screen, core screen or shield	23
4.12 Sheathing material	23
4.13 Metallic braid armour	23
4.14 Fire performance	23
4.15 Bending radius	24
Annex A (informative) Tabulated current-carrying capacities – Defined installations	26
Annex B (informative) Fire stops	40
Annex C (informative) Jet fire test for hydrocarbon (HCF) fire resistant cables	41
Annex D (informative) Drilling fluid test procedure and requirements	42
Bibliography	44
Table 1 – Choice of cables for a.c. systems	11
Table 2 – Sizes of earth continuity conductors* and equipment earthing connections	13
Table 3 – Coefficient related to maximum permissible temperature of the conductor	14
Table 4 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 70 °C (ambient air temperature 45 °C)	15

Table 5 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 90 °C (ambient air temperature 45 °C)	16
Table 6 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 95 °C (ambient air temperature 45 °C)	17
Table 7 – Correction factor for various ambient air temperatures (reference ambient temperature of 45 °C)	18
Table 8 – Correction factor for various ambient air temperatures (reference ambient temperature of 30 °C)	18
Table 9 – Bending radii for cables rated up to 1,8/3 kV	25
Table 10 – Bending radii for cables rated at 3,6/6,0(7,2) kV and above	25
Table A.1 – Current-carrying capacities in amperes – Copper conductor temperature 60 °C and reference ambient air temperature 45 °C	29
Table A.2 – Current-carrying capacities in amperes – Copper conductor temperature 70 °C and reference ambient air temperature 45 °C	30
Table A.3 – Current-carrying capacities in amperes – Copper conductor temperature 85 °C and reference ambient air temperature 45 °C	31
Table A.4 – Current-carrying capacities in amperes – Copper conductor temperature 60 °C and reference ambient air temperature 30 °C	32
Table A.5 – Current-carrying capacities in amperes – Copper conductors temperature 70 °C and reference ambient temperature 30 °C	33
Table A.6 – Current-carrying capacities in amperes – Copper conductors temperature 85 °C and reference ambient temperature 30 °C	34
Table A.7 – Current-carrying capacities in amperes – Copper conductors temperature 90 °C and reference ambient temperature 45 °C	35
Table A.8 – Current-carrying capacities in amperes – Copper conductors temperature 95 °C and reference ambient temperature 45 °C	36
Table A.9 – Correction factors for groups of more than one circuit or of more than one multi-core cable to be used with current-carrying capacities of Tables A.1 to A.8	37
Table A.10 – Correction factors for group of more than one multi-core cable to be applied to reference ratings for multi-core cables in free air – Method of installation E in Tables A.1 to A.8	38
Table A.11 – Correction factors for groups of more than one circuit of single-core cables to be applied to reference rating for one circuit of single-core cables in free air – Method of installation F in Tables A.1 to A.8	39
Figure 1 – Time constant of cables	19
Figure 2 – Correction factors for half-hour and one-hour service	20
Figure 3 – Correction factor for intermittent service	21
Figure C.1 – International recognized HC fire curve	41

INTERNATIONAL ELECTROTECHNICAL COMMISSION

MOBILE AND FIXED OFFSHORE UNITS –
ELECTRICAL INSTALLATIONS –

Part 4: Cables

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61892-4 has been prepared by IEC technical committee 18: Electrical installations of ships and of mobile and fixed offshore units, in cooperation with SC 18A: Cables and cable installations.

The text of this standard is based on the following documents:

FDIS	Report on voting
18/1052/FDIS	18/1058/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61892 series, published under the general title *Mobile and fixed offshore units – Electrical installations*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IECNORM.COM : Click to view the full PDF of IEC 61892-4:2007

INTRODUCTION

IEC 61892 forms a series of International Standards intended to enable safety in the design, selection, installation, maintenance and use of electrical equipment for the generation, storage, distribution and utilisation of electrical energy for all purposes in offshore units which are being used for the purpose of exploration or production of petroleum resources.

This part of IEC 61892 also incorporates and coordinates, as far as possible, existing rules and forms a code of interpretation, where applicable, of the requirements of the International Maritime Organisation. It also constitutes a guide for future regulations which may be prepared and a statement of practice for offshore unit owners, constructors and appropriate organisations.

This standard is based on equipment and practices which are in current use but it is not intended in any way to impede development of new or improved techniques.

The ultimate aim has been to produce a set of International standards exclusively for the offshore petroleum industry.

IECNORM.COM : Click to view the full PDF of IEC 61892-4:2007

MOBILE AND FIXED OFFSHORE UNITS – ELECTRICAL INSTALLATIONS –

Part 4: Cables

1 Scope

This part of IEC 61892 specifies requirements for the choice and installation of electrical cables intended for fixed electrical systems in mobile and fixed offshore units, including pumping or “pigging” stations, compressor stations and exposed location single buoy moorings, used in the offshore petroleum industry for drilling, production, processing and for storage purposes.

The reference to fixed electrical systems includes those that are subjected to vibration due to the movement of the unit, e.g. cables installed on a drag chain, and not those that are intended for repeated flexing. Cables suitable for repeated flexing use are detailed in other IEC specifications, e.g. IEC 60227 and IEC 60245, and their uses on board offshore units are restricted to those situations which do not directly involve exposure to a marine environment, e.g. portable tools, domestic appliances, etc.

The following types and applications of cables are not included:

- optical fibre cables;
- sub-sea and umbilical cables;
- cables supplying downhole pumps;
- data, telecommunication and radio frequency cables.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60038:1983, *IEC standard voltages*¹⁾
Amendment 1 (1994)
Amendment 2 (1997)

IEC 60092-350:2001, *Electrical installations in ships – Part 350: Shipboard power cables - General construction and test requirements*

IEC 60092-351, *Electrical installations in ships – Part 351: Insulating materials for shipboard and offshore units, power, control, instrumentation, telecommunication and data cables*

IEC 60092-353, *Electrical installations in ships – Part 353: Single and multicore non-radial field power cables with extruded solid insulation for rated voltages 1 kV and 3 kV*

IEC 60092-354, *Electrical installations in ships – Part 354: Single and three-core power cables with extruded solid insulation for rated voltages 6 kV ($U_m=7,2$ kV); up to 30 kV ($U_m=36$ kV)*

¹⁾ There exists a consolidated edition 6.2 (2002) including IEC 60038:1983 and its Amendments 1 and 2.

IEC 60092-359, *Electrical installations in ships – Part 359: Sheathing materials for shipboard power and telecommunication cables*

IEC 60092-376, *Electrical installations in ships – Part 376: Cables for control and instrumentation circuits 150/250 V (300 V)*

IEC 60228:2004, *Conductors of insulated cables*

IEC 60331-21:1999, *Tests for electric cables under fire conditions – Circuit integrity – Part 21: Procedures and requirements – Cables of rated voltage up to and including 0,6/1,0 kV*

IEC 60331-31:2002, *Tests for electric cables under fire conditions – Circuit integrity – Part 31: Procedures and requirements for fire with shock – Cables of rated voltage up to and including 0,6/1 kV*

IEC 60332-1-2:2004, *Tests on electric and optical fibre cables under fire conditions – Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame*

IEC 60332-3-22:2000, *Tests on electric cables under fire conditions – Part 3-22: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category A*

IEC 60754-1:1994, *Test on gases evolved during combustion of materials from cables – Part 1: Determination of the amount of halogen acid gas*

IEC 60754-2:1991, *Test on gases evolved during combustion of electric cables – Part 2: Determination of degree of acidity of gases evolved during the combustion of materials taken from electric cables by measuring pH and conductivity*

Amendment 1 (1997)

IEC 61034-2:2005, *Measurement of smoke density of cables burning under defined conditions – Part 2: Test procedure and requirements*

IEC 61892-1:2001, *Mobile and fixed offshore units – Electrical installations – Part 1: General requirements and conditions*

IEC 61892-2, *Mobile and fixed offshore units – Electrical installations – Part 2: System design*

IEC 61892-6, *Mobile and fixed offshore units – Electrical installations – Part 6: Installation*

3 Terms and definitions

3.1

appropriate authority

governmental body and/or classification society with whose rules an offshore unit is required to comply

3.2

braid armour

covering formed from braided metal wires used to protect the cable from external mechanical effects

3.3

braid

covering made of plaited metallic or non-metallic material

3.4**core insulated conductor**

assembly comprising a conductor and its own insulation (and screens, if any)

3.5**core screen**

electric screen of non-metallic and/or metallic materials covering the insulation

3.6**insulated cable**

an assembly consisting of:

- one or more cores,
- their individual covering(s) (if any)
- assembly protection (if any)
- protective coverings (if any)

NOTE Additional uninsulated conductor(s) may be included in the cable.

3.7**conductor screen**

non-metallic conducting layer applied between the conductor and insulation to equalise the electrical stress between these components. It may also provide smooth surfaces as the boundaries of the insulation and assist in the elimination of spaces at these boundaries

3.8**inner sheath**

inner jacket (North America) non-metallic extruded sheath applied under a metallic sheath, reinforcement, or armour

NOTE

It must be extruded.

It can be used to fill the interstices.

It must be a material listed in IEC 60092-359.

It has a defined nominal thickness (value).

3.9**outer sheath****jacket (North America)**

non-metallic extruded sheath applied over a metallic sheath, reinforcement, or armour It must be extruded.

NOTE 1

It can be used to fill the interstices.

It must be a material listed in IEC 60092-359.

It has a defined nominal thickness (value).

NOTE 2 The term sheath is only used for metallic coverings in North America, where the term jacket is used for non-metallic coverings.

3.10**electrostatic screen****electrostatic shield** (North America)

surrounding earthed metallic layer to confine the electric field within the cable cores, pair(s), triples(s), or quad(s), and to protect the pair(s), triad(s), or quad(s) from external influence

4 Types, installation and operating conditions of cables

4.1 Types of cables

Cables constructed in accordance with IEC 60092-350, IEC 60092-353, IEC 60092-354 and IEC 60092-376 are recommended for use on mobile and fixed offshore units.

4.2 Voltage rating

4.2.1 Power frequency cables

The maximum rated voltage (U) considered in this standard for power frequency cables is 30 kV.

In the voltage designation of cables $U_0 / U / (U_m)$:

- U_0 is the rated power frequency voltage between conductor and earth or metallic screen for which the cable is designed;
- U is the rated power frequency voltage between conductors for which the cable is designed;
- U_m is the maximum value of the highest system voltage which may be sustained under normal operating conditions at anytime and at any point in the system. It excludes transient voltage conditions and rapid disconnection of loads.

U_m is chosen to be equal to or greater than the highest voltage of the three-phase system. Where cables are permitted for use on circuits where the nominal system voltage exceeds the rated voltage of the cables, the nominal system voltage shall not exceed the highest system voltage (U_m) of the cable.

Careful consideration shall be given to cables subjected to voltage surges associated with highly inductive circuits to ensure that they are of a suitable voltage rating.

The choice of standard cables of appropriate voltage designations for particular systems depends upon the system voltage and the system earthing arrangements.

The rated voltage of any cable shall not be lower than the nominal voltage of the circuit for which it is used. To facilitate the choice of the cable, the values of U recommended for cables to be used in three-phase systems are listed in Table 1 in which systems are divided into the following three categories.

- **Category A**

This category comprises those systems in which any phase conductor that comes in contact with earth or an earth conductor is automatically disconnected from the system.

- **Category B**

This category comprises those systems that, under fault conditions are operated for a short time, not exceeding 8 h on any occasion, with one phase earthed.

For example, for a 13,8 kV system of Category A or B, the cable should have a rated voltage not less than 8,7/15 kV.

NOTE In a system where an earth fault is not automatically and promptly eliminated, the increased stresses on the insulation of cables during the earth fault are likely to affect the life of the cables to a certain degree. If the system is expected to be operated fairly often with a sustained earth fault, it may be preferable to use cables suitable for Category C. In any case, for classification as Category B the expected total duration of earth faults in any year should not exceed 125 h.

- **Category C**

This category comprises all systems that do not fall into Categories A and B.

The nominal system voltages from 3,3 kV to 30 kV shown in Table 1 are generally in accordance with Series 1 in IEC 60038. For nominal system voltages intermediate between these standard voltages and also between 0,6/1 kV and 1,8/3,3 kV, the cables should be selected with a rated voltage not less than the next higher standard value. For example: a first earth fault with one phase earthed causes a $\sqrt{3}$ higher voltage between the phases and earth during the fault. If the duration of this earth fault exceeds the times given for Category B, then according to Table 1, for a 17,5 kV system, the cable is to have a rated voltage not less than 12/20 kV.

A d.c. voltage to earth of up to a maximum of 1,5 times the a.c. U_0 voltage may be used. However consideration should be given to the peak value when determining the voltage of d.c. systems derived from rectifiers, bearing in mind that smoothing does not modify the peak value when the semiconductors are operating on an open circuit.

Table 1 – Choice of cables for a.c. systems

System voltage		System category	Minimum rated voltage of cable U_0/U	
Nominal voltage U kV	Maximum sustained voltage, U_m kV		Unscreened kV	Single-core or screened kV
up to 0,25	0,30	A, B or C	0,15 / 0,25	–
1	1,2	A, B or C	0,6 / 1,0	0,6 / 1,0
3	3,6	A or B	1,8 / 3,0	1,8 / 3,0
3	3,6	C		3,6 / 6,0
6	7,2	A or B		3,6 / 6,0
6	7,2	C		6,0 / 10
10	12	A or B		6,0 / 10
10	12	C		8,7 / 15
15	17,5	A or B		8,7 / 15
15	17,5	C		12 / 20
20	24	A or B		12 / 20
20	24	C		18 / 30
30	36	A or B		18 / 30

4.2.2 Control and instrumentation cables

The typical rated voltage (U) for control and instrumentation cables considered in this standard is 250 V.

In some instances for conductor sizes 1 mm² and larger, or when circuits are to be supplied from a low impedance source, 0,6/1 kV rated cables shall be used as control or instrumentation cables.

4.3 Cross-sectional areas of conductors and current-carrying capacities

4.3.1 Cross-sectional areas of conductors

The cross-sectional area of each conductor shall be selected to be large enough to comply with the following conditions:

- a) The highest load to be carried by the cable shall be calculated from the load demands and diversity factors given in IEC 61892-2.
- b) The “corrected current rating” calculated by applying the appropriate correction factors to the “current rating for continuous services” shall not be lower than the highest current likely to be carried by the cable. The correction factors to be applied are those given in 4.3.4, 4.3.5 and 4.3.6.
- c) The voltage drop in the circuit shall not exceed the limits specified by the appropriate authority for the circuits concerned - further guidance is given in 4.4.
- d) The cross-sectional area of the conductor shall be able to accommodate the mechanical and thermal effects of a short circuit current (see 4.8) and the effect upon voltage drop of motor-starting currents (see 4.4, Note 3).
- e) The nominal cross-section of the earth conductor shall comply with Table 2. One of the alternative methods of determining the cross-sectional area of each earthing conductor is that based upon the rating of the fuse or circuit protection device installed to protect the circuit. If this method is used the nominal cross-sectional area finally selected shall be the higher of any cross-sectional area determined by each of the methods.

NOTE The tables incorporated in this standard for the current ratings give only average values; these are not exactly applicable to all cable constructions and all installation conditions existing in practice. They are nevertheless recommended for general application, considering that the errors (a few degrees Celsius in the estimated operating temperature) are of little importance against the advantages of having a single international standard for the evaluation of the current ratings. In particular cases, however, a more precise evaluation is permitted, based on experimental or calculated data acceptable to all interested parties.

IECNORM.COM : Click to view the full PDF Edition

Table 2 – Sizes of earth continuity conductors^a and equipment earthing connections

Arrangement of earth conductor		Cross-section Q of associated current-carrying conductor (One phase or pole) mm^2	Minimum cross-section of earth conductor	
1	i) Insulated earth conductor in cable for fixed installation.	$Q \leq 16$	Q	
	ii) Copper braid of cable for fixed installation according to subclause 8.2 of IEC 60092-350.		<i>50% of the current-carrying conductor, but not less than 16 mm²</i>	
	iii) Separate, insulated earth conductor for fixed installation in pipes in dry accommodation spaces, when carried in the same pipe as the supply cable.	$Q > 16$		
	iv) Separate, insulated earth conductor when installed inside enclosures or behind covers or panels, including earth conductor for hinged doors.			
2	Uninsulated earth conductor in cable for fixed installation, being laid under the cable's armour or copper braid and in metal-to-metal contact with this.	$Q \leq 2,5$	1 mm^2	
		$2,5 < Q \leq 6$	$1,5 \text{ mm}^2$	
		$Q > 6$	Not permitted	
3	Separately installed earth conductor for fixed installation other than specified in 1 iii) and 1 iv).	$Q \leq 2,5$	Same as current-carrying conductor subject to min. $1,5 \text{ mm}^2$ for stranded earthing connection or $2,5 \text{ mm}^2$ for unstranded earthing connection	
		$2,5 < Q \leq 120$	50% of current-carrying conductor, but not less than 4 mm^2	
		$Q > 120$	70 mm^2	
4	Insulated earth conductor in flexible cable.	$Q \leq 16$	Same as current-carrying conductor	
		$Q > 16$	50% of current-carrying conductor, but minimum 16 mm^2	
NOTE Refer also to 4.3.1 for method based on rating of fuses.				
^a The term protective conductor is accepted as an alternative term for the earth continuity conductor.				

4.3.2 Current-carrying capacities

The procedure for cable selection employs rating factors to adjust the current-carrying capacities for different ambient temperature, short time duty, for the mutual heating effects of grouping with other cables, and methods of installation. Guidance on the use of these factors is given below.

4.3.3 Current-carrying capacities for continuous service

Continuous service for a cable shall be considered, for the purpose of this standard, as a current-carrying service with constant load having a duration longer than three times the thermal time constant of the cable, i.e., longer than the critical duration (see Figure 1).

The current to be carried by any conductor for sustained periods during normal operation shall be such that the appropriate conductor temperature limit is not exceeded.

These current-carrying capacities are derived from those as documented in IEC 60092-352:1997.

Current ratings currently available from various approval authorities for use in the general case for continuous service are shown in Tables 4 through 6 and are recommended as being applicable to both unarmoured and armoured cables laid in free air as a group of six bunched together.

These ratings may be considered applicable, without correction factors, for cables bunched together on cable trays, in cable conduits, pipes or trunking, unless more than six cables, which may be expected to operate simultaneously at their full rated capacity, are laid close together in a cable bunch in such a way that there is an absence of free air circulation around them. In this case a correction factor of 0,85 should be applied.

NOTE Cables are said to be bunched when two or more are contained within a single conduit, trunking or duct, or if not enclosed, are not separated from each other.

These ratings have been calculated using the basis given below for an ambient temperature of 45 °C and a conductor temperature that is assumed to be equal to the maximum rated temperature of the insulation and continuously maintained. The cable constructions are based on the various insulating materials given in 60092-351 together with any type of sheathing material given in 60092-359.

The basis for the calculation of the ratings in Tables 4 to 6 is as follows:

The current ratings I , in amperes, have been calculated for each nominal cross-sectional area A , in square millimetres, with the formula:

$$I = \alpha A^{0,625}$$

where α is a coefficient related to the maximum permissible service temperature of the conductor as follows:

Table 3 – Coefficient related to maximum permissible temperature of the conductor

Maximum permissible temperature of the conductor	70 °C	90 °C	95 °C
Values of α for nominal cross-sectional area	$\geq 2,5 \text{ mm}^2$	12	17
	$< 2,5 \text{ mm}^2$	11,5	18

For two-, three- and four-conductor cables, the current ratings given in Table 3 should be multiplied by the following (approximate) correction factors:

0,85 for two core cables,

0,70 for three- and four-core cables.

The ambient temperature of 45 °C, on which the current ratings in Tables 4 through 6 are based, is considered as a standard value for the ambient air temperature, generally applicable for any kind of offshore unit in any climate.

When, however, fixed offshore units are installed in locations where the ambient temperature is known to be permanently lower than 45 °C, it is permitted to increase the current ratings from those in the tables - but in no case shall the ambient temperature be considered to be lower than 25 °C.

When, on the other hand, it is to be expected that the air temperature around the cables could be higher than 45 °C (for instance, when a cable is wholly or partly installed in spaces or compartments where heat is produced or higher cable temperatures could be reached due to heat transfer), the current ratings from the Tables 4 through 6 shall be reduced.

The correction factors for these different ambient air temperatures are given in Table 7 or 8.

The selection of the method applicable to any particular installation is the responsibility of the appropriate approval authority or governing regulation. An optional alternative method is given in Appendix A (Informative) when utilized under Engineering Supervision.

Table 4 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 70 °C (ambient air temperature 45 °C)

Rated conductor temperature	70 °C		
	Single-core (A)	2-core (A)	3- or 4-core (A)
Nominal cross-sectional area (mm ²)			
1	12	10	8
1,5	15	13	10
2,5	20	18	15
4	29	24	20
6	37	31	26
10	51	43	35
16	68	58	48
25	90	76	63
35	111	94	78
50	138	118	97
70	171	145	120
95	207	176	145
120	239	203	167
150	275	234	192
185	313	266	219
240	369	313	258
300	424	360	297
400	508	431	355
500	583	496	408
630	674	573	472

Table 5 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 90 °C (ambient air temperature 45 °C)

Conductor temperature	90 °C		
	Nominal cross-sectional area		
	Single-core	2-core	3- or 4-core
(mm ²)	(A)	(A)	(A)
1	18	15	13
1,5	23	20	16
2,5	30	26	21
4	40	34	28
6	52	44	36
10	72	61	50
16	96	82	67
25	127	108	89
35	157	133	110
50	196	167	137
70	242	206	169
95	293	249	205
120	339	288	237
150	389	331	273
185	444	377	311
240	522	444	366
300	601	511	420
400	719	611	503
500	827	703	579
630	955	812	669

IECNORM.COM - Click to view the full PDF of IEC 61892-4:2007

Table 6 – Current-carrying capacities in continuous service at maximum rated conductor temperature of 95 °C (ambient air temperature 45 °C)

Conductor temperature Nominal cross-sectional area (mm ²)	95 °C		
	Single-core (A)	2-core (A)	3- or 4-core (A)
1	20	17	14
1,5	26	22	18
2,5	32	27	22
4	43	36	30
6	55	47	39
10	76	65	53
16	102	87	71
25	135	114	94
35	166	141	116
50	208	176	145
70	256	218	179
95	310	263	217
120	359	305	251
150	412	351	289
185	470	400	329
240	553	470	387
300	636	541	445
400	761	647	533
500	875	744	613
630	1011	860	708

4.3.4 Correction factors for different ambient air temperatures

The ambient temperature is the temperature of the surrounding medium when the cable(s) or insulated conductor(s) under consideration are not loaded.

The current-carrying capacity tabulated in this subclause and in Annex A assumes the following reference ambient temperatures for insulated conductors and cables in air, irrespective of the method of installation:

- 45 °C for standard situations, generally applicable for any kind of unit and in any climate;
- 30 °C for particular situations, applicable for mobile and fixed offshore units for particular uses for which the ambient temperature is known to be permanently lower or equal to 30 °C.

Where the ambient temperature in the intended location of the insulated conductors or cables differs from the reference ambient temperature, the appropriate correction factors specified in Table 7 and Table 8 shall be applied to the values of current-carrying capacity set out in this subclause and in Annex A.

NOTE The air temperature around the cables can be higher than 45 °C when, for instance, a cable is wholly or partly installed in spaces or compartments where heat is produced or due to heat transfer.

**Table 7 – Correction factor for various ambient air temperatures
(reference ambient temperature of 45 °C)**

Maximum conductor temperature °C	Correction factors for ambient air temperatures												
	25 °C	30 °C	35 °C	40 °C	45 °C	50 °C	55 °C	60 °C	65 °C	70 °C	75 °C	80 °C	85 °C
70	1,32	1,25	1,18	1,10	1,00	0,89	0,77	0,63	-	-	-	-	-
90	1,20	1,15	1,10	1,05	1,00	0,94	0,88	0,82	0,74	0,67	0,58	0,47	-
95	1,18	1,14	1,10	1,05	1,00	0,95	0,89	0,84	0,77	0,71	0,63	0,55	0,45

**Table 8 – Correction factor for various ambient air temperatures
(reference ambient temperature of 30 °C)**

Maximum conductor temperature °C	Correction factors for ambient air temperatures													
	20 °C	25 °C	30 °C	35 °C	40 °C	45 °C	50 °C	55 °C	60 °C	65 °C	70 °C	75 °C	80 °C	85 °C
70	1,12	1,06	1,00	0,94	0,87	0,79	0,71	0,61	0,50	-	-	-	-	-
90	1,08	1,04	1,00	0,96	0,91	0,87	0,82	0,76	0,71	0,65	0,58	0,50	0,41	-
95	1,07	1,04	1,00	0,96	0,92	0,88	0,83	0,78	0,73	0,68	0,62	0,55	0,48	0,39

4.3.5 Correction factors for short time duty

If a cable is intended to supply a motor or equipment operating for periods of half an hour or one hour, its current rating, as given by the relevant table (see 4.3.3 and Annex A), may be increased using the relevant correction factors given by Figure 2. These correction factors are applicable only if the intermediate periods of rests are longer than the critical duration (which is equal to three times the time constant of the cable), given in Figure 1 as a function of the cable diameter.

NOTE 1 The correction factors given in Figure 2 are approximate and depend mainly upon the diameter of the cable. In general, the half-an-hour service is applicable to mooring winches. The half-an-hour rating might not be adequate for automatic tensioning mooring winches.

NOTE 2 For cables supplying a single motor or other equipment intended to operate in an intermittent service, as is generally the case for engine room cranes and similar devices, the current ratings as given by Annexes A and B may be increased by applying the correction factor given by Figure 3.

NOTE 3 The correction factor given in Figure 3 has been roughly calculated for periods of 10 min, of which 4 min are with a constant load and 6 min without load.


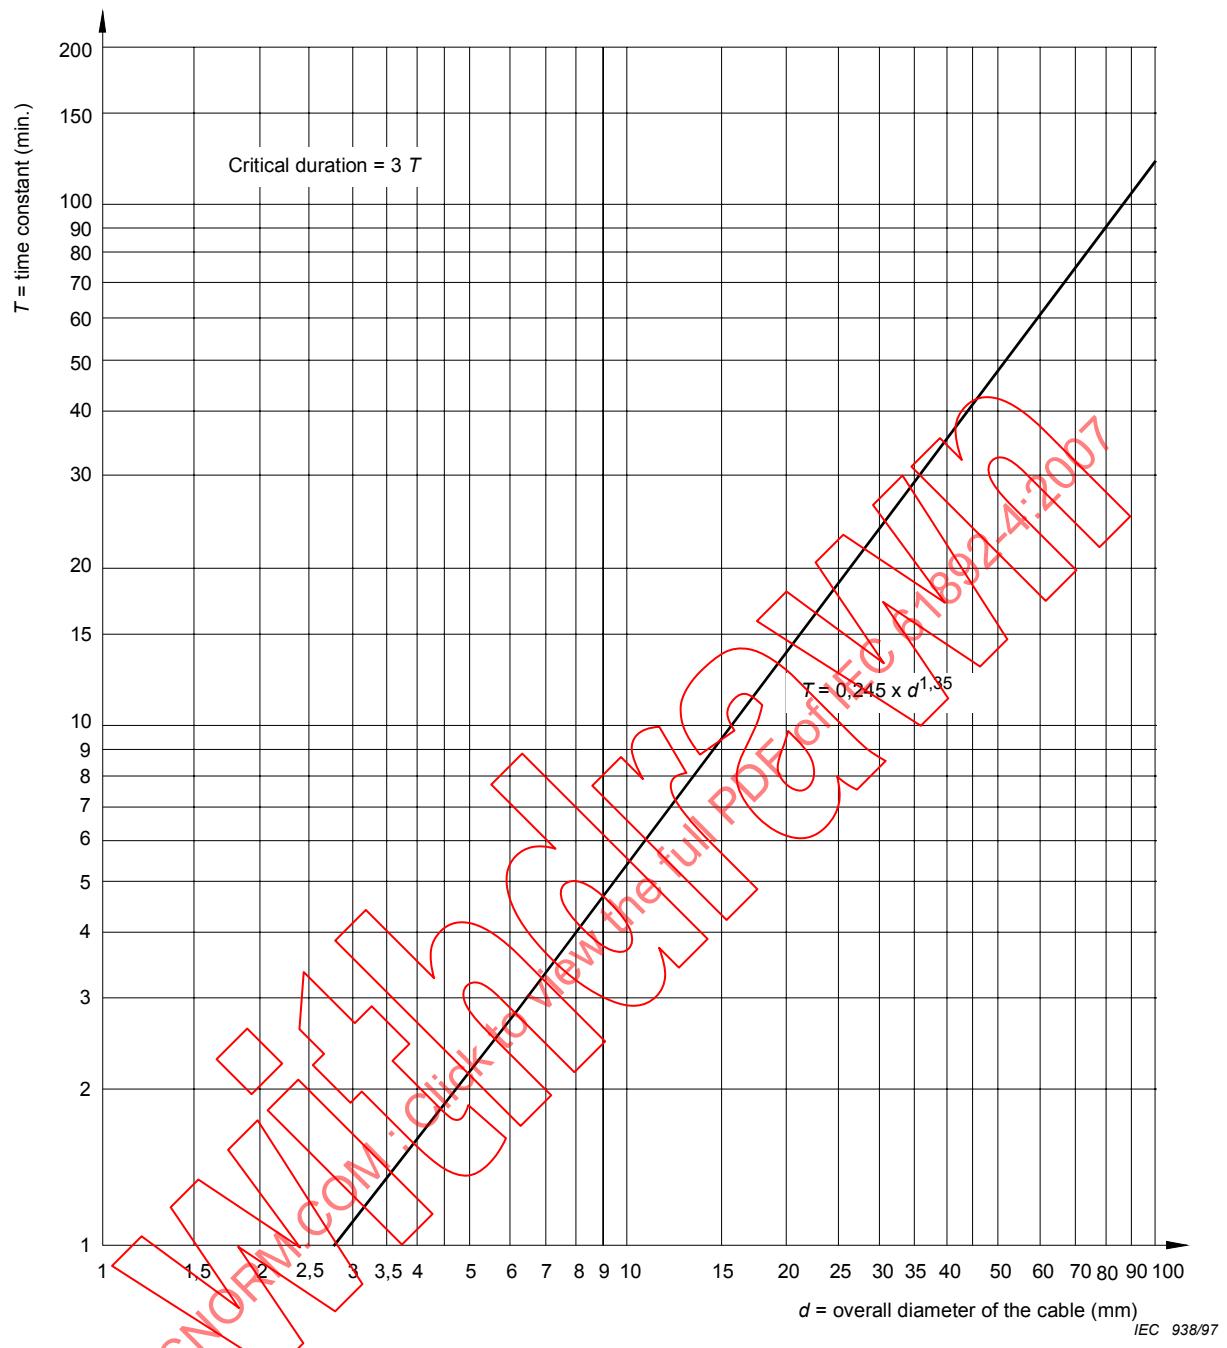


Figure 1 – Time constant of cables

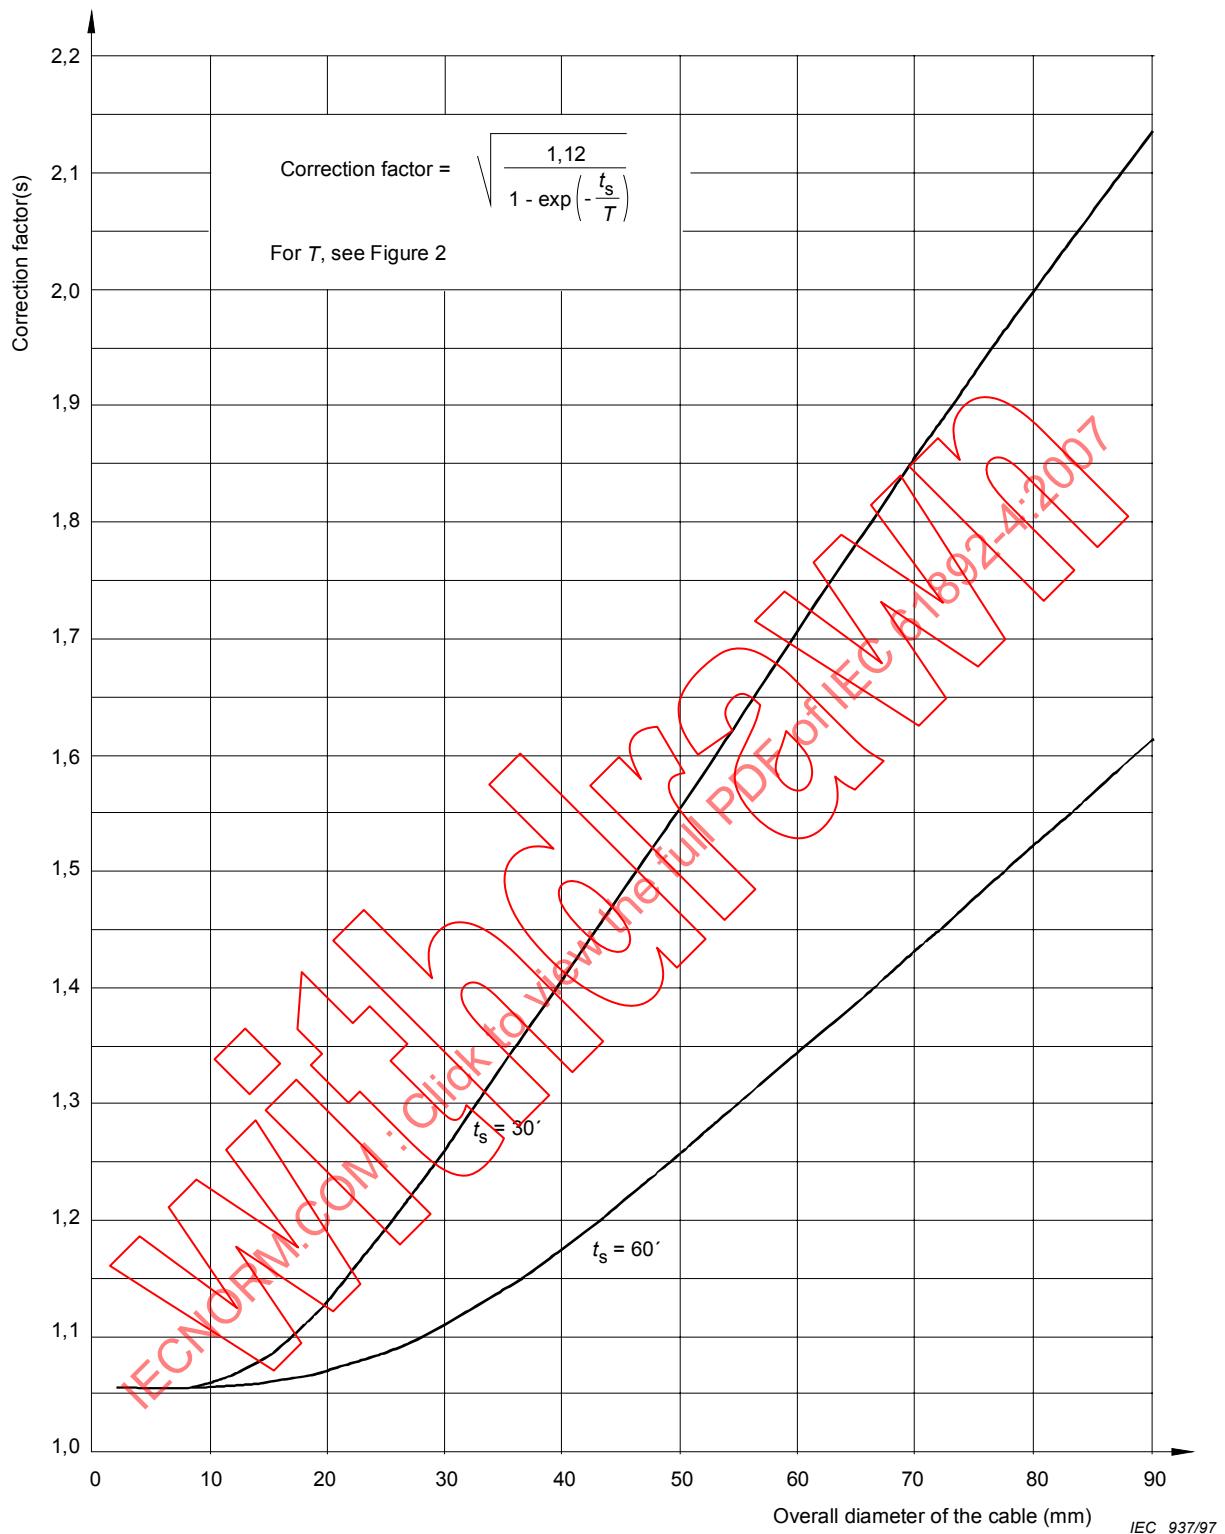

t_s = service time

Figure 2 – Correction factors for half-hour and one-hour service

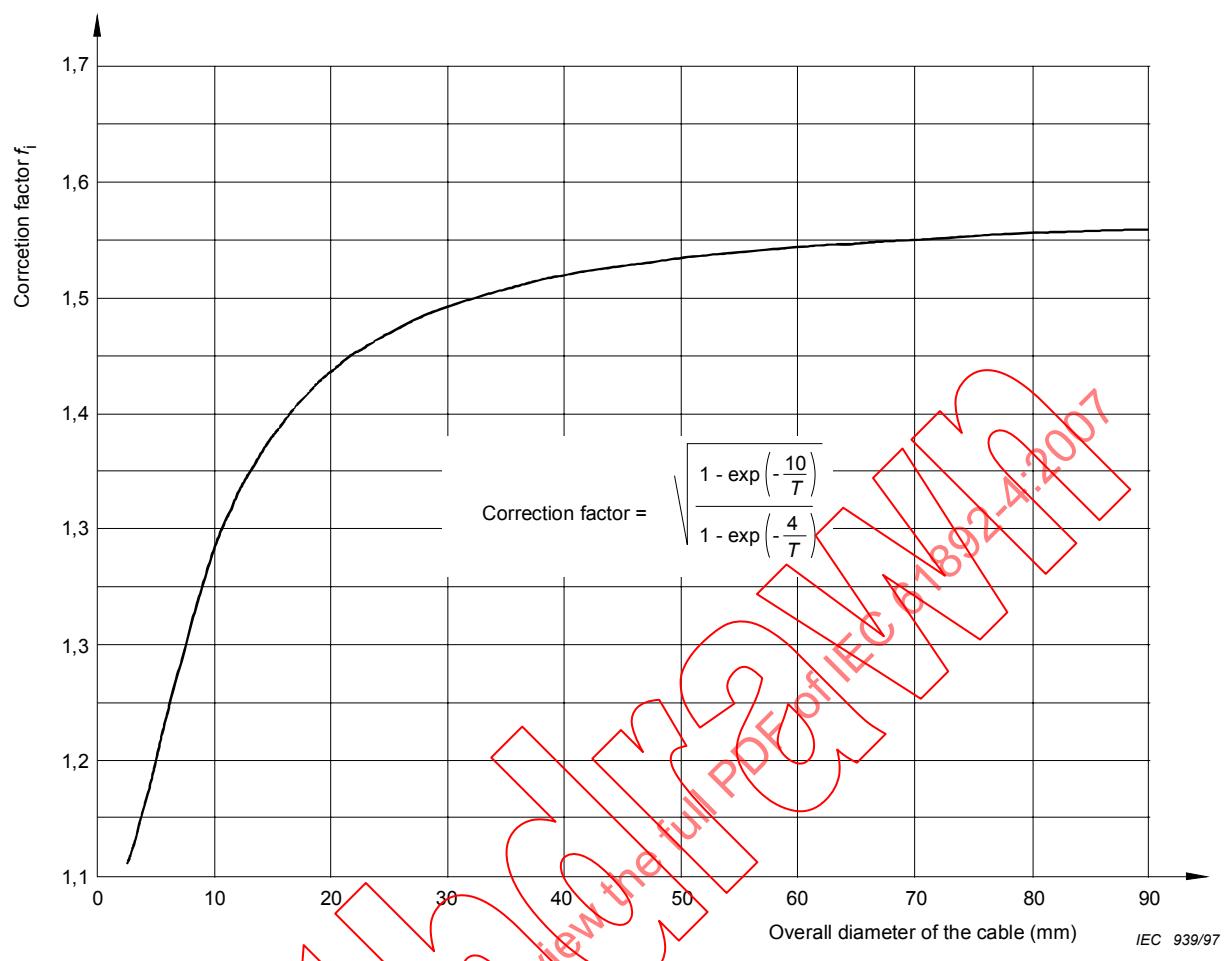


Figure 3 – Correction factor for intermittent service

4.3.6 Correction factors for cable grouping

In the case of a group of insulated conductors or cables the current-carrying capacities tabulated are subjected to the group correction factors given in 4.3.3 or the tables of Annex A.

The group reduction factors are applicable to groups of insulated conductors or cables having the same maximum operating temperature.

For groups containing cables or insulated conductors having different maximum operating temperatures, the current-carrying capacity of all the cables or insulated conductors in the group shall be based on the lowest maximum operating temperature of any cable in the group together with the appropriate group reduction factor.

Where operating conditions are known, and a cable or insulated conductor is not expected to carry a current greater than 30 % of its calculated grouped rating, it can be ignored for the purpose of obtaining a correction factor for the rest of the group. Also in the case of cables not being loaded simultaneously, consideration of the actual loading appertaining is permitted.

NOTE Cables are said to be bunched when two or more are contained within a single conduit, trunking or duct, or, if not enclosed, are not separated from each other.

4.4 Voltage drop

In the absence of specific design limits or limits set by the appropriate authority the cross-sectional areas of conductors shall be so determined that the drop in voltage from the main or emergency switchboard bus-bars to any and every point on the installation when the conductors are carrying the maximum current under normal conditions of service, does not exceed the limitation given in 4.9 of IEC 61892-1.

NOTE 1 For supplies from batteries with a voltage not exceeding 50 V, this value may be increased to 10 %.

NOTE 2 For navigation lights it may be necessary to limit voltage drops to lower values in order to maintain required lighting output and colour.

NOTE 3 The values are applicable under normal steady conditions. Under special conditions of short duration, such as motor starting, higher voltage drops may be accepted provided the installation is capable of withstanding the effects of these higher voltage drops or dips.

4.5 Estimation of lighting loads

For the purpose of determining sizes of conductors in lighting circuits, the assessment of the current to be carried shall be made on the basis that every lampholder is deemed to require a current equivalent to the maximum load likely to be connected to it. This shall be assumed to be at least 100 W; except that, where the lighting fitting is so constructed as to take only a lamp rated at less than 100 W, the current rating shall be assessed accordingly.

Each lighting socket-outlet will count for two lighting points.

4.6 Parallel connection of cables

The current-carrying capacity of cables connected in parallel is the sum of the current ratings of all parallel conductors provided the cables have equal impedance, equal cross-section, equal maximum permissible conductor temperatures and follow substantially identical routing or are installed in close proximity. Connection in parallel will be permitted only for cross-sections of 10 mm² or above. When equal impedance cannot be assured, a factor of 0,9 shall be applied.

4.7 Separation of circuits

Separate cables are to be used for all circuits requiring individual short-circuit or overcurrent protection, with the following exceptions:

- A control circuit which is branched off from its main circuit (e.g. for an electric motor) may be carried in the same cable as the main circuit provided the main circuit and the subsidiary control circuit are controlled by a common isolator.
- Non-essential circuits with voltages not exceeding the "safety voltage" as defined in IEC 61892-1. Also consideration shall be given to fire performance characteristics and electromagnetic interference, see 4.14 and IEC 61892-6 respectively.

4.8 Short circuit capacity (withstand capability).

Cables and their insulated conductors shall be capable of withstanding the mechanical and thermal effects of the maximum short circuit current which can flow in any part of the circuit in which they are installed, taking into consideration not only the time/current characteristics of the circuit protective device, but also the peak value of the prospective short circuit current during the first half cycle.

Further information is given in IEC 60724 and IEC 60986.

4.9 Conductor

All conductor configurations shall be as listed in IEC 60228.

Stranded copper class 2 conductors or class 5 conductors are recommended for general use in fixed installation systems. Class 5 conductors are also recommended for use to ease the installation of cables in areas involving tight bending radii or high vibration, or which are subject to occasional flexing.

NOTE When cables are subject to continuous flexing, the advice of the manufacturer shall be sought.

4.10 Insulation material

The range of materials for use as conductor insulation shall be as listed in IEC 60092-351. The rated operating temperature of the insulating material shall be at least 10 °C higher than the maximum ambient temperature likely to exist, or to be produced, in the space where the cable is installed.

NOTE The construction of a cable can significantly influence the conductor operating temperature and this may be limited to a temperature below that of the thermal rating of the insulation.

4.11 Screen, core screen or shield

The construction of the screen, core screen or shield shall be as specified in the relevant part identified in 4.1.

4.12 Sheathing material

The materials for use as sheathing shall be selected from one of those listed in IEC 60092-359.

Consideration shall also be given to fluid resistance for cables installed where water condensation, harmful vapours (including oil vapour), oil or drilling fluids may be present. In this instance the cables shall meet the appropriate fluid resistance requirements of IEC 60092-359.

NOTE 1 Not all materials in IEC 60092-359 meet the fluid resistance requirement.

NOTE 2 Guidance for cables required to be resistant to drilling fluids ("mud") is given in Annex D.

NOTE 3 In hazardous locations, inner taped coverings used in lieu of an inner sheath will not prevent the migration of combustible gas or dust particles through the cable. This is normally prevented by hazardous location rated cable glands dependent upon an impervious inner sheath on which to affect a seal.

In choosing different types of over sheathing as a protective coverings, due consideration shall also be given to the mechanical actions to which each cable may be subjected during installation and in service. If the mechanical strength of the oversheath is considered insufficient, the cable shall be fitted in pipes or conduits or trunking or be otherwise protected.

All thermoset sheathed cables shall be suitable for an oil production installation. The oil resistance properties shall be demonstrated by a test according to IEC 60092-359, Table II, Clause 3, type SHF2.

Also consideration shall be given to the fire performance characteristics given in 4.14.

4.13 Metallic braid armour

The construction of the metallic braid armour shall be in accordance with IEC 60092-350 and the applicable product standard.

NOTE In case of single-core cables, or cables for circuits with high contents of harmonic, as e.g. SCR circuits non-magnetic braid or armour is normally to be used.

4.14 Fire performance

All cables or insulated wiring shall meet the requirements for flame spread as given in IEC 60332-1-2 and IEC 60332-3-22.

Unless otherwise given in the individual product standard, the cables shall be tested in a touching configuration (using a 300 mm ladder) in multiple layers if required to achieve the 7 l/m loading of the ladder.

NOTE 1 It cannot be assumed that because a cable or an insulated wire meets the requirements of IEC 60332-1-2, a bunch of similar cables or insulated wires will behave in a similar manner. The flame spread performance of bunched cables is assessed by the requirements of IEC 60332-3-22. This performance requirement (i.e. for cables mounted vertically in a touching formation) has been chosen to best reflect the installation conditions generally observed on board mobile and fixed offshore units. Experience has shown that the test for the flame spread of cables installed vertically is adequate for horizontal installations, all other parameters being generally the same.

NOTE 2 Further information is given in IEC 60332-3-22.

NOTE 3 Additional protection may be provided by the use of fire stops, see Annex B.

For systems required to maintain electrical circuit integrity under fire conditions, e.g. for fire alarm, fire detection, fire extinguishing services, remote stopping and similar control circuits, the cables shall meet the requirements of IEC 60331-21 or IEC 60331-31 as given in the appropriate individual product standard. Unless otherwise given in the individual product standard the flame application time shall be at least 90 min at the temperature specified in the relevant standard. This requirement is not applicable where the systems are of a self-monitoring type, failing to safety or are duplicated or routed away from high fire risk areas.

NOTE 4 The use of suitable installation materials is essential for cables that are required to maintain electrical circuit integrity under fire conditions.

NOTE 5 Guidance for testing of cables required to withstand a hydrocarbon fire is given in Annex C.

Cables for installation in accommodation spaces and passenger areas shall be of low smoke / zero halogen construction.

Where applicable, the cables shall be evaluated in accordance with the following test methods given in:

- IEC 61034-2
- IEC 60754-1
- IEC 60754-2

Unless otherwise given in the individual product standard the cables shall meet the requirements given in the test specification.

4.15 Bending radius

The internal bending radius for the installation of cables shall be as recommended by the manufacturer according to the type of cables chosen, and shall not be less than values given in Table 9 and Table 10.

Table 9 – Bending radii for cables rated up to 1,8/3 kV

Cable construction		Overall diameter of cable (D)	Minimum internal radius of bend
Insulation	Covering		
Thermoplastic or thermosetting with circular copper conductors	Unarmoured or unbraided	≤25 mm	4 D ^a
		>25 mm	6 D
	Metal braid screened or armoured	Any	6 D
	Metal wire armoured	Any	6 D
	Metal tape armoured or metal-sheathed		
	Composite polyester/metal laminate tape screened units or collective tape screening	Any	8 D
Thermoplastic or thermosetting with sector shaped copper conductors	Any	Any	8 D
^a 6 D for defined circuit integrity			

Table 10 – Bending radii for cables rated at 3,6/6,0(7,2) kV and above

Cable construction	Overall diameter of cable (D)	Minimum internal radius of bend
Single-core cable	Any	12 D
3-core cables	Any	9 D
NOTE For cables rated at 3,6/6(7,2) kV and above employing flexible conductor stranding (Class 5) and braid insulation shields indicating a minimum bend radius of 6D for unarmoured cables and 8D for armoured cables in concurrence with the approval of the cable manufacturer		

Annex A
(informative)
Tabulated current-carrying capacities –
Defined installations

A.1 General

The current ratings in Tables A.1 to A.8 are applicable for d.c. and a.c. with a nominal frequency of 50 or 60 Hz. For higher frequencies, the current rating shall be calculated with an appropriate method (e.g. IEC 60287).

NOTE 1 The current ratings in Tables A.1 to A.8 are applicable, with fair approximation, whatever is the type of covering (e.g. both armoured and unarmoured cables). Where the armour, screens or metallic sheaths of single-core cables are bonded at both ends of a run, the circulating currents in the metallic layers will reduce the current rating of the cables. The extent of the reduction will depend on the resistance of the metallic layer. In such cases the current rating should be calculated for the specific cable type.

NOTE 2 The current ratings in Tables A.1 to A.8 are based on the nominal dimensions of 600/1000 V cables. Current ratings for higher voltage cables, up to 30 kV, may be up to about 5 % lower than the tabulated values for LV cables.

NOTE 3 The current ratings in Tables A.1 to A.8 are based on class 2 conductors. When using cables with class 5 conductors, users should carefully check the applicable current rating, which may be lower than for cables with the same nominal cross-sectional area of class 2 conductors. See IEC 60228 for references to classes of conductors.

A.2 Reference methods of installation

The reference methods are those methods for which the current-carrying capacity has been determined by test or calculation.

For the electrical installations in offshore units the following reference methods of IEC 60364-5-52 are considered applicable and are presented in Tables A.1 to A.8 (in which ' D_e ' is the value of a cable diameter):

NOTE The installation methods A and D as given in IEC 60364-5-52 are not currently used in this standard – however to avoid confusion the other reference notations from that specification have been retained.

- **Reference methods B1** (insulated conductors in a conduit on a bulkhead) and **B2** (multi-core cable in a conduit on a bulkhead).
Circuit mounted on a bulkhead so that the gap between the conduit and the surface is less than 0,3 times the conduit diameter. The conduit can be metal or plastic.
- **Reference method C** (single-core or multicore cable on a bulkhead).
Cable mounted on a bulkhead so that the gap between the cable and the surface is less than 0,3 times the cable diameter.
- **Reference methods E, F and G** (single-core or multi-core cable in free air).
A cable so supported that the total heat dissipation is not impeded. Heating due to solar radiation and other sources shall be taken into account. Care shall be taken that natural air convection is not impeded. In practice, a clearance between a cable and any adjacent surface of at least 0,3 times the cable external diameter for multicore cables, or one times the cable diameter for single-core cables, is sufficient to permit the use of current-carrying capacities appropriate to free air conditions.

NOTE The current-carrying capacities in this document are applicable for either metallic or non-metallic bulkheads.

A.3 Other methods of installation

- Cable on or under a deck: this is similar to reference **method C** except that the rating for a cable under a deck is slightly reduced (see Table A.11) from the value for a bulkhead or on a deck because of the reduction in natural convection.
- Cable tray: a perforated tray has a regular pattern of holes so as to facilitate the use of cable fixings. The ratings for cables on perforated trays have been derived from test work utilising trays where the holes occupied 30 % of the area of the base reference **methods E or F**. If the holes occupy less than 30 % of the area of the base the tray is regarded unperforated. This is similar to reference **method C**.
- Ladder support: this is of a type of construction which offers a minimum of impedance to the airflow around the cables, i.e. supporting metal work under the cables occupies less than 10 % of the plan area - reference **methods E or F**.
- Cleats and hangers: this type of cable support holds the cable at intervals along its length and permits substantially complete free air around the cable. Reference **methods E, F or G**.
- Decks (false floors): cables installed under decks or false floors reference methods B1 for single-core cables and B2 for multicore cables.

A.4 Correction factors for cable grouping

The current-carrying capacities tabulated in Tables A.1 to A.8 shall be subjected to the group correction factors in case of a group of insulated conductors or cables.

The group correction factors are applicable to groups of insulated conductors or cables having the same maximum operating temperature.

For groups containing cables or insulated conductors having different maximum operating temperatures, the current-carrying capacity of all the cables or insulated conductors in the group shall be based on that of the lowest maximum rated conductor temperature of any cable in the group together with the appropriate group correction factor.

Where operating conditions are known, and a cable or insulated conductor is not expected to carry a current greater than 30 % of its calculated grouped rating, it can be ignored for the purpose of obtaining a correction factor for the rest of the group. Also in the case of cables not being loaded simultaneously, consideration of the actual loading appertaining is permitted.

NOTE 1 Cables are said to be bunched when two or more are contained within a single conduit, trunking or duct, or, if not enclosed, are not separated from each other.

For installation methods B and C the current-carrying capacities given in Tables A.1 to A.8 relate to single circuits consisting of the following numbers of conductors:

- two insulated conductors or two single-core cables, or one twin-core cable;
- three insulated conductors or three single-core cables, or one three-core cable

Where more insulated conductors or cables are installed in the same group, the group correction factors specified in Table A.9 shall be applied.

NOTE 2 The group correction factors have been calculated on the basis of prolonged steady-state operation at the 100 % load factor for all line conductors. Where the loading is less than 100 % as a result of the conditions of operation of the installation, the group correction factors may be higher.

For installations methods E and F on trays, cleats and the like, current-carrying capacities for both single circuits and groups shall be obtained by multiplying the capacities given in Tables A.1 to A.5, (for the relevant arrangements of insulated conductors or cables in free air), by the installation and group correction factors given in Table A.10 and Table A.11 – see the following notes.

NOTE 3 Group correction factors have been calculated as averages for the range of conductor sizes, cable types and installations considered. Attention is drawn to the notes under each table. In some instances, a more precise calculation may be desirable.

NOTE 4 Group correction factors have been calculated on the basis that the group consists of similar equally loaded insulated conductors or cables. When a group contains various sizes of cable or insulated conductor, caution should be exercised over the current loading of the smaller ones.

IECNORM.COM : Click to view the full PDF of IEC 61892-4:2007

**Table A.4 – Current-carrying capacities in amperes –
Copper conductor temperature 60 °C and reference ambient air temperature 30 °C**

Nominal cross-sectional area of conductor mm ²	Installation method					
	Method B1 Insulated conductors or single-core cables in conduit on a bulkhead		Method B2 Multi-core cable in conduit on a bulkhead		Method C Multi-core cables on a bulkhead	
	Two conductors	Three conductors	Two conductors	Three conductors	Two conductors	Three conductors
1,5	15	13,5	14,5	13	17	15
2,5	21	18,5	20	17,5	23,5	21
4	28	24	26	23	31	28
6	36	31	33	30	40	36
10	50	44	45	40	55	50
16	66	59	60	54	74	66
25	88	77	78	70	97	84
35	109	96	97	86	120	104
50	131	117	116	103	146	125
70	167	149	146	130	185	160
95	202	180	175	156	224	194
120	234	208	202	179	260	225
150					299	260
185					341	297
240					401	351
300					461	404
400						
500						
630						

Table A.5 – Current-carrying capacities in amperes –
Copper conductors temperature 70 °C and reference ambient temperature 30 °C

Nominal cross-sectional area of conductor mm ²	Installation method					
	Method B 1 Insulated conductors or single-core cables in conduit on a bulkhead	Method B 2 Multi-core cable in conduit on a bulkhead	Method C Multi-core cables on a bulkhead	Method E Multi-core cables in free air	Method F Single-core cables, touching in free air	Method G Single-core cables, spaced in free air
Two conductors	Three conductors	Two conductors	Three conductors	Two conductors	Three conductors	Three conductors
1,5	17,5	15,5	16,5	15	19,5	17,5
2,5	24	21	23	20	27	22
4	32	28	30	27	36	30
6	41	36	38	34	46	41
10	57	50	52	46	63	57
16	76	68	69	62	85	76
25	101	89	90	80	112	96
35	125	110	111	99	138	119
50	151	134	133	118	168	144
70	192	171	168	149	213	184
95	232	207	201	179	258	223
120	269	239	232	206	299	259
150					344	299
185					392	341
240					461	403
300					530	464
400						
500						
630						

Table A.6 – Current-carrying capacities in amperes –
Copper conductors temperature 85 °C and reference ambient temperature 30 °C

Nominal cross-sectional area of conductor mm ²	Installation method					
	Method B1 Insulated conductors or single-core cables in conduit on a bulkhead		Method B2 Multi-core cable in conduit on a bulkhead		Method C Multi-core cables on a bulkhead	
	Two conductors	Three conductors	Two conductors	Three conductors	Two conductors	Three conductors
1,5	22	19	21	18,5	23	21
2,5	30	27	29	25	32	29
4	40	36	38	34	43	38
6	52	46	49	42	56	50
10	72	63	66	58	77	68
16	96	84	87	77	103	92
25	128	112	114	101	132	114
35	157	138	140	123	164	141
50	190	168	168	148	201	172
70	243	213	212	186	258	220
95	294	258	254	224	315	267
120	340	300	293	257	367	309
150					423	356
185					486	407
240					575	480
300					665	553
400						
500						
630						

Nominal cross-sectional area of conductor mm ²	Installation method					
	Method B1 Insulated conductors or single-core cables in conduit on a bulkhead		Method B2 Multi-core cable in conduit on a bulkhead		Method C Multi-core cables on a bulkhead	
	Two conductors	Three conductors	Two conductors	Three conductors	Two conductors	Three conductors
1,5	22	19	21	18,5	23	21
2,5	30	27	29	25	32	29
4	40	36	38	34	43	38
6	52	46	49	42	56	50
10	72	63	66	58	77	68
16	96	84	87	77	103	92
25	128	112	114	101	132	114
35	157	138	140	123	164	141
50	190	168	168	148	201	172
70	243	213	212	186	258	220
95	294	258	254	224	315	267
120	340	300	293	257	367	309
150					423	356
185					486	407
240					575	480
300					665	553
400						
500						
630						

Table A.7 – Current-carrying capacities in amperes –
Copper conductors temperature 90 °C and reference ambient temperature 45 °C

Nominal cross-sectional area of conductor mm ²	Installation method						Method G Single-core cables, spaced in free air	
	Method B1 Insulated conductors or single-core cables in conduit on a bulkhead		Method B2 Multi-core cable in conduit on a bulkhead		Method C Multi-core cables on a bulkhead			
	Two conductors	Three conductors	Two conductors	Three conductors	Two conductors	Three conductors		
1,5	20	17,5	19	17	21	19	20	
2,5	27	24	26	23	29	26	28	
4	37	32	35	30	39	35	37	
6	47	42	44	38	50	45	47	
10	65	57	60	52	70	62	65	
16	87	77	79	70	93	84	87	
25	116	102	104	91	120	104	110	
35	143	125	127	111	149	128	161	
50	172	152	152	134	182	156	196	
70	220	193	192	169	234	199	251	
95	266	234	231	203	285	242	306	
120	308	371	265	233	332	280	357	
150					384	323	412	
185					440	369	472	
240					521	435	558	
300					603	501	645	
400								
500								
630								

