
**Plastics piping systems for soil and
waste discharge (low and high
temperature) inside buildings —
Thermoplastics — Recommended
practice for installation**

*Systèmes de canalisations en plastique pour l'évacuation des eaux-
vannes et des eaux usées (à basse et à haute température) à l'intérieur
des bâtiments — Thermoplastiques — Pratiques recommandées pour
la pose*



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 7024:2005

© ISO 2005

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms, definitions, symbols and abbreviations	2
3.1 General terms	2
3.2 Terms and definitions.....	2
3.3 Symbols	4
3.4 Abbreviations	6
4 Design limits of the system	6
5 Storage, transport and handling	6
5.1 General.....	6
5.2 Transport	6
5.3 Storage.....	7
5.4 Handling on site	9
6 Installation	9
6.1 General recommendations for installation	9
6.2 Recommendations for above-ground installation.....	11
6.3 Jointing procedure	22
7 Special precautions	29
7.1 Concreting of thermoplastics systems within the building structure.....	29
7.2 Foaming of thermoplastics systems	34
7.3 Prevention of additional stresses in pipework	34
8 Jointing to other materials or other constructions	34
8.1 General.....	34
8.2 Solvent-cement joints.....	34
8.3 Ring seal joints	34
8.4 Jointing to non-thermoplastics components	35
8.5 Adaptors	36
9 Environmental aspects.....	37
10 Fire resistance of pipework	37
11 Testing and inspection of installations	37
11.1 Testing	37
11.2 General inspection.....	37
12 Maintenance and cleaning of installations.....	38
12.1 General.....	38
12.2 Cleaning and descaling techniques.....	38
13 Chemical resistance of thermoplastics materials	38
Annex A (informative) Recommendations for installation in buried conditions	39
Bibliography	42

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

In other circumstances, particularly when there is an urgent market requirement for such documents, a technical committee may decide to publish other types of normative document:

- an ISO Publicly Available Specification (ISO/PAS) represents an agreement between technical experts in an ISO working group and is accepted for publication if it is approved by more than 50 % of the members of the parent committee casting a vote;
- an ISO Technical Specification (ISO/TS) represents an agreement between the members of a technical committee and is accepted for publication if it is approved by 2/3 of the members of the committee casting a vote.

An ISO/PAS or ISO/TS is reviewed after three years in order to decide whether it will be confirmed for a further three years, revised to become an International Standard, or withdrawn. If the ISO/PAS or ISO/TS is confirmed, it is reviewed again after a further three years, at which time it must either be transformed into an International Standard or be withdrawn.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO/TS 7024 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 1, *Plastics pipes and fittings for soil, waste and drainage (including land drainage)*.

This Technical Specification is a guidance document only, to be mainly used as a basis for preparing more specific manufacturer's instructions. It is associated with standards for piping systems covering a particular thermoplastic material for a specified application. There are a number of such standards.

This Technical Specification is consistent with general standards on functional requirements and on recommended practice for installation.

This first edition cancels and replaces Technical Report ISO/TR 7024:1985.

Introduction

This Technical Specification covers the recommended practice for installation of the thermoplastics piping systems for soil and waste discharge. The most important recommendations are expressed by the use of the imperative. These are strongly recommended.

Guidance for installation is presented, e.g. by the use of “may” or “is recommended”, for consideration as a matter of judgement in each case.

This Technical Specification refers to ISO standards in which buried application is not covered. Buried application is described, for information only, in Annex A.

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 7024:2005

Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Thermoplastics — Recommended practice for installation

1 Scope

This Technical Specification gives the recommended practice for installation of thermoplastics piping systems in the field of soil and waste discharge (low and high temperature) inside buildings (marked with “B”).

This Technical Specification is applicable to thermoplastics pipes and fittings as specified in the associated standards ISO 3633 (PVC-U), ISO 7671 (PP), ISO 7682 (ABS), ISO 8770 (PE-HD), ISO 19220 (SAN + PVC) and ISO 7675 (PVC-C), their joints and to joints with components of other plastics and non-plastics materials intended to be used for the following purposes.

- a) Soil and waste discharge pipework for the conveyance of domestic waste waters (low and high temperature).

NOTE 1 See Clause 4 for waste discharge temperature limits.

- b) Ventilating pipework associated with a).
- c) Rainwater pipework within the building structure (see Figure 1).

If specified in the relevant associated standard, this Technical Specification also covers soil and waste discharge pipework fixed externally on to the building (See Figure 1). It is not applicable to pipework that passes under the building without any connection from the discharge system.

NOTE 2 According to the associated standards, for external above-ground soil and waste discharge, additional requirements depending on the climate are to be agreed between the manufacturer and the user.

NOTE 3 According to the associated standards, components conforming to other standards on plastic piping systems may be used with pipes and fittings conforming to a given associated standard, if they conform to the requirements for joint dimensions and functional requirements of the given associated standard.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3633, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Unplasticized poly(vinyl chloride) (PVC-U)*

ISO 7671, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Polypropylene (PP)*

ISO 7675, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Chlorinated poly(vinyl chloride) (PVC-C)*

ISO 7682, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Acrylonitrile/butadiene/styrene (ABS)*

ISO 8770, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — polyethylene (PE)*

ISO/TR 10358, *Plastics pipes and fittings — Combined chemical-resistance classification table*

ISO 19220, *Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Styrene copolymer blends (SAN + PVC)*

EN 12056-1, *Gravity drainage systems inside buildings — Part 1: General and performance requirements*

EN 12056-2, *Gravity drainage systems inside buildings — Part 2: Sanitary pipework, layout and calculation*

EN 12056-3, *Gravity drainage systems inside buildings — Part 3: Roof drainage, layout and calculation*

EN 12056-5, *Gravity drainage systems inside buildings — Part 5: Installation and testing, instructions for operation, maintenance and use*

3 Terms, definitions, symbols and abbreviations

For the purposes of this document, the following terms, definitions, symbols and abbreviations apply.

3.1 General terms

For the general terms, refer to EN 12056-1, EN 12056-2 or EN 12056-3, where applicable, and see Figure 1 (the figure is schematic only).

Local and/or national regulations may require separate drainpipe systems for foul and rainwater.

3.2 Terms and definitions

For the purposes of this document, the terms and definitions given in the relevant associated standard apply, together with the following.

3.2.1

associated standard

standard which specifies all requirements applicable to pipes, fittings and joints made of a particular material to be installed according to the recommendations of this Technical Specification

3.2.2

ring seal socket length

type S, type N or M or type L

length of a ring seal socket, which is designated as short (type S), normal or medium (type N or type M), or long (type L) in the relevant associated standards

NOTE In some cases, type N sockets are designated by type M (medium).

3.2.3

flexible leg

L_1 and L_2


free length between two fixed points either sides of a bend of a solvent cement system designated L_1 and L_2

3.2.4 expansion gap

E , E_1 , E_2

distance left during installation between the bottom of a socket and the spigot of the inserted component, allowing expansion of the system

Dimensions in metres

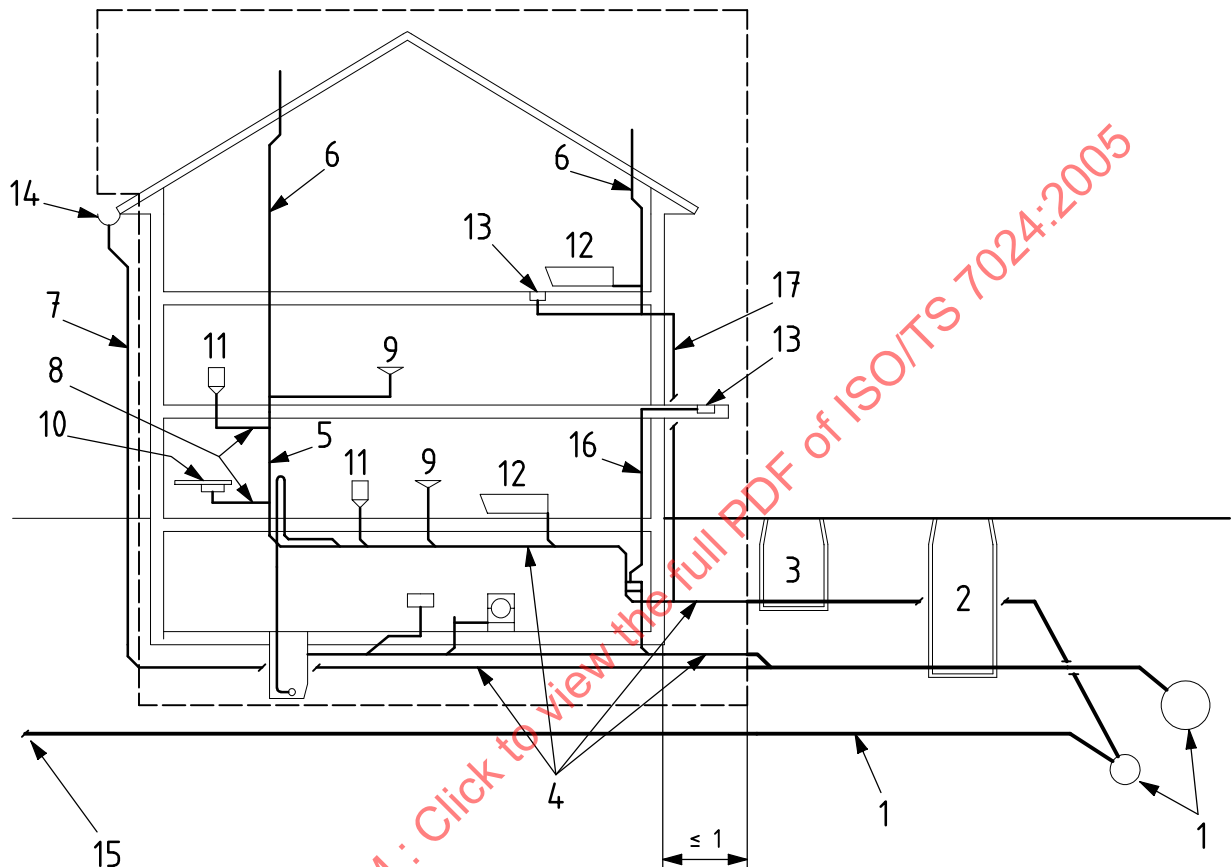

Key

1 sewer	7 rainwater down pipe	13 floor gully/trap
2 manhole	8 branch discharge pipe	14 gutter
3 inspection chamber	9 wash basin	15 pipework from other buildings
4 drains	10 sink	16 internal rainwater down pipe
5 discharge stack	11 water closet	17 external discharge stack
6 stack vent	12 bath	

NOTE Keys 1, 2, 7 and 14 are not covered by this Technical Specification. Key 3 is covered if the distance to the building wall is smaller than or equal to 1 m.

Figure 1 — Terms for a soil and waste discharge system

3.3 Symbols

3.3.1 Symbols for installation

$D_{\max}$	recommended maximum distance between support centres in above-ground installation (see 6.2.4.2)
$L_{c,\max}$	maximum recommended distance between anchored brackets in concreted-in installation (see 7.1.2.7)
L_F	free length between fixed points in above-ground installation (see 6.2.3.1)
Y	effective sealing length (see 6.2.3.2)

3.3.2 Symbols for junctions

NOTE The symbols of a basic nature for junctions are given in ISO 2553, ISO 14617-3 and ISO 14617-15.

3.3.2.1 Symbol for sockets for solvent cement jointing

The design symbol (square-shaped) given in Figure 2 signifies a rigid, non-removable connection of two pipes and/or fittings made by means of a solvent cement socket.

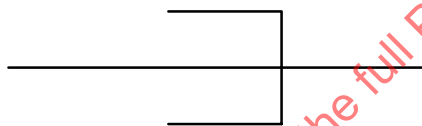


Figure 2 — Design symbol for solvent cement joint

3.3.2.2 Symbols for sockets for ring seal jointing

The design symbols (cup-shaped) given in Figure 3 signify a non-rigid, removable connection of two pipes and/or fittings made by means of a rubber seal in a type S, type N, type M or type L socket.


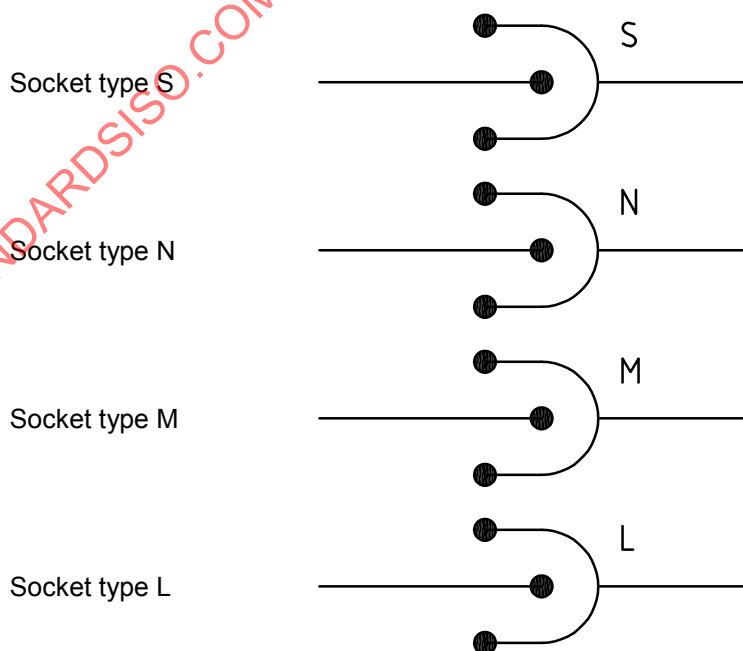


Figure 3 — Design symbols for ring seal joint

3.3.2.3 Symbol for butt-fusion joint

The design symbol given in Figure 4 signifies a rigid, non-removable connection of two pipes and/or fittings made after fusion by means of a heating plate.




NOTE A number should be written between the two branches of the fork. It refers to the number of the welding process given in ISO 4063.

Figure 4 — Design symbol for butt-fusion joint

3.3.2.4 Symbol for electrofusion sleeve coupling

The design symbol given in Figure 5 signifies a rigid, non-removable connection of two pipes and/or fittings made by means of integral electrically powered fusion.



NOTE The number written between the two branches of the fork refers to the number of the welding process given in ISO 4063; in this case, the number is 25 for resistance butt welding.

Figure 5 — Design symbol for electrofusion sleeve coupling

3.3.2.5 Symbol for flange and backing ring joint

The design symbol given in Figure 6 signifies a rigid connection of two pipes and/or fittings made by means of bolts and nuts.




Figure 6 — Design symbol for flange and backing ring joint

3.3.2.6 Symbol for compression joint

The design symbol given in Figure 7 signifies a rigid connection of two pipes and/or fittings made by means of thread, rubber ring and screw.





Figure 7 — Design symbol for compression joint

3.3.3 Symbols for brackets

The design symbols for brackets given in Figure 8 signify an anchor bracket or a guide bracket, respectively.



Anchor bracket
(for fixed point)



Guide bracket
(for free movement of pipe)

Figure 8 — Design symbols for brackets

3.4 Abbreviations

For the thermoplastics materials, the following abbreviations apply:

ABS	Acrylonitrile-butadiene-styrene
PE	Polyethylene
PP	Polypropylene
PP-H	Polypropylene homopolymer
PVC-C	Chlorinated poly(vinyl chloride)
PVC-U	Unplasticized poly(vinyl chloride)
SAN + PVC	Styrene copolymer blend

4 Design limits of the system

Discharge systems of thermoplastics are primarily designed for intermittent waste discharge of domestic origin, including from washing and dishwashing machines. Discharge systems of PE, PP, ABS and PVC-C are also designed for discharges from public laundries, launderettes or other installations where long periods of high temperature discharge occur. For the design of systems for other discharges than domestic waste, see Clause 13 and manufacturer's recommendations.

Apply the requirements for the calculation of the flow capacity of plumbing installations, as specified in relevant European Standards, subject to any applicable national and/or local regulations.

NOTE Among European Standards, EN 12056-2 and EN 12056-3 are primarily applicable for flow capacity calculation.

5 Storage, transport and handling

5.1 General

Attention is drawn to any relevant local and/or national safety regulations.

Avoid damage to the surfaces and ends of pipe and fittings.

Loading and handling of components made of PP-homopolymers (marked PP-H), for which performance impact testing is carried out at 23 °C (see ISO 7671) is not recommended at ambient temperatures lower than + 5 °C. For components made of other materials, follow the manufacturer's instructions regarding installation at low temperature.

Support pipes with sockets and with pre-assembled fittings, in such a way that they are protected from damage and that the ends are free from loading, e.g. by alternating the socket and non-socket ends in given or adjacent layers.

5.2 Transport

Load pipes and fittings in such a way that no damage occurs during transport (see Figure 9).

Stack the pipes at a maximum stacking height of 1,5 m, unless otherwise specified in the manufacturer's instructions, e.g. when transporting caged bundles.

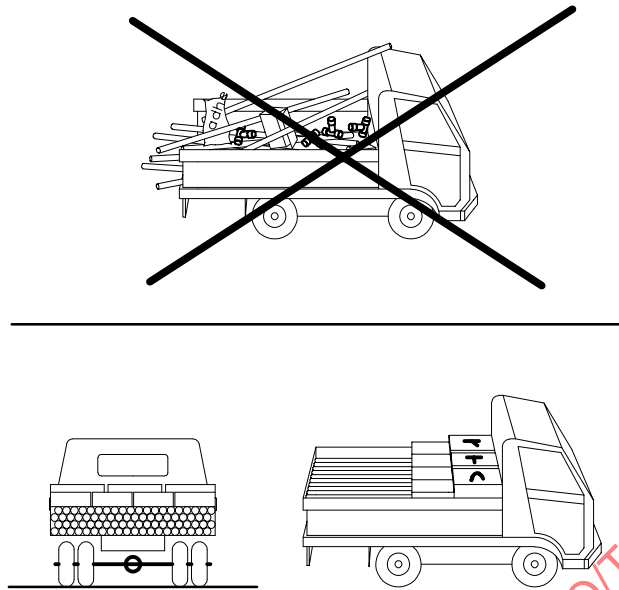


Figure 9 — Loading for transport

5.3 Storage



Do not carelessly unload pipes and fittings (see Figure 10).

Provide a storage area free from substances harmful to the relevant thermoplastics (see Clause 13), comprising smooth and level ground or a flat timber base to avoid the risk of bent or damaged pipes. Where PE pipes are supplied in coils, store them either stacked flat one on top of the other or (chiefly for sizes greater than DN 90) vertically in purpose-built racks or cradles.

Avoid storage in direct sunlight over a period longer than one year. Where long-term storage and/or strong sunlight is expected, screening from the direct rays of the sun is recommended, except for black-coloured PE components.

Recommended maximum stacking height is 1,5 m [see Figure 10, a)], unless otherwise stated in the manufacturer's instructions, e.g. when stacking caged bundles [see Figure 10, b)].

Dimensions in metres

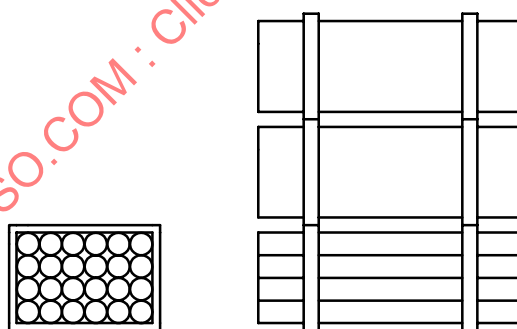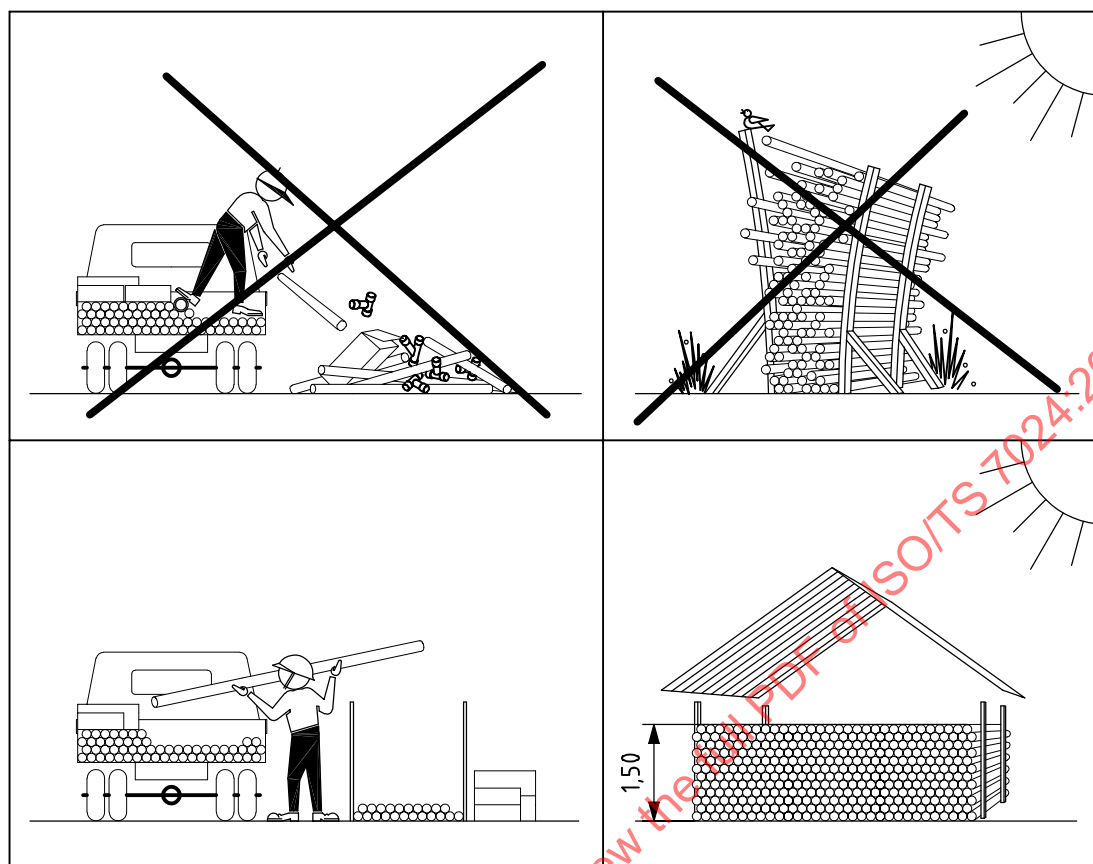

b)

Figure 10 — Storage on site

5.4 Handling on site

To avoid risk of damage, carry (i.e. do not drag) pipes and fittings to the work place (see Figure 11).

NOTE Careless handling might lead to damaged materials and faulty installations.

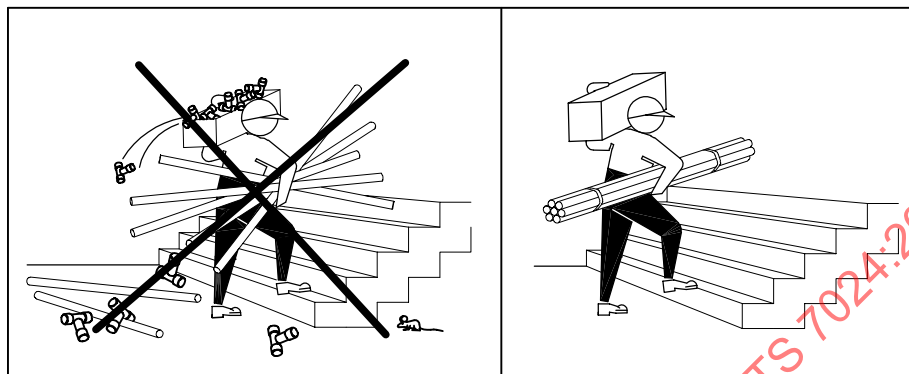


Figure 11 — Handling on site

6 Installation

6.1 General recommendations for installation

6.1.1 Cutting of pipe

Cut pipe square to length with a fine-tooth saw, or special purpose equipment (see Figure 12). Remove all burrs at the inside and outside edges of the cut surfaces.

Prior to fusion jointing, if necessary, e.g. if the pipe ends were slightly tapered during their production, cut 10 mm to 15 mm from the factory-made pipes.

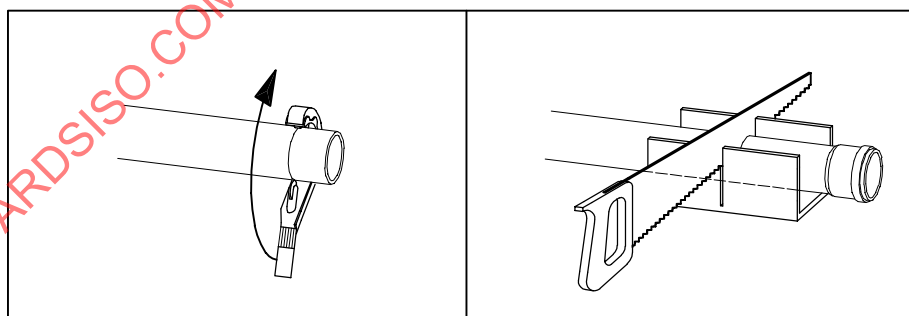


Figure 12 — Cutting of pipe

To obtain a square guide line, a piece of paper may be wrapped around the pipe and the edges brought together (see Figure 13).

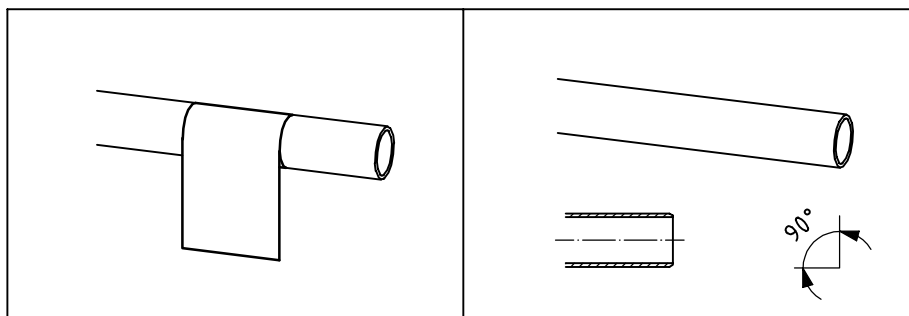


Figure 13 — Optional method for square cutting

6.1.2 Chamfering of pipe

6.1.2.1 Do not chamfer components made of PE or PP, which are designed for butt-fusion jointing (see 6.3.3.2).

6.1.2.2 For components to be jointed by other techniques, the pipes may be chamfered, if necessary, according to the manufacturer's instructions. Chamfer the pipes with a medium file or special purpose equipment. Provide approximately matching chamfers on the pipe and the socket; with an angle, α , of between 15° and 45° . Keep a remaining wall thickness of at least $e/3$ (see Figure 14).

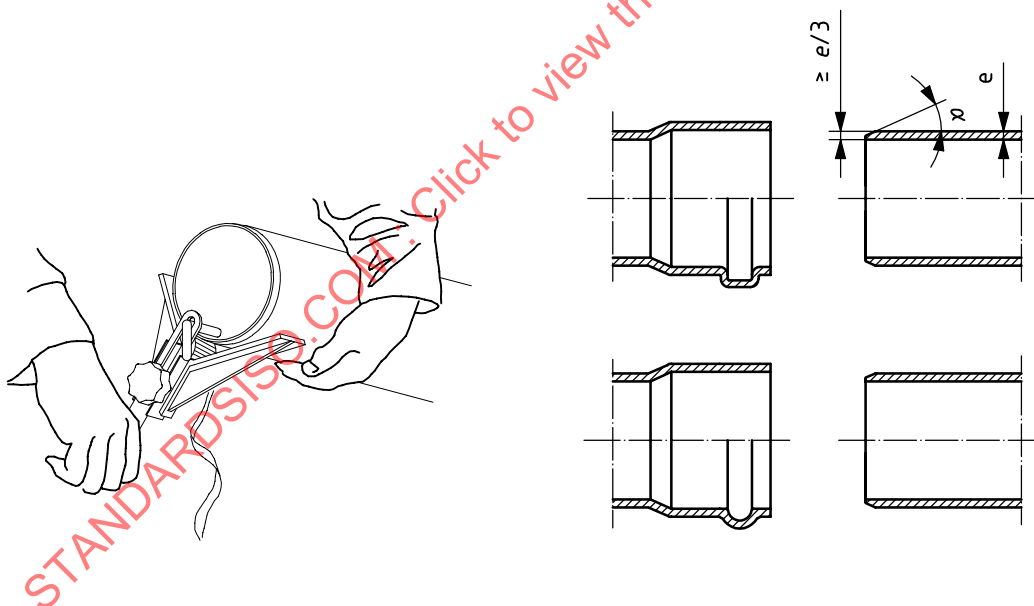


Figure 14 — Chamfering of pipe end

6.1.3 Fabricating

Do not fabricate on-site thermoplastics components by any other means (fusion, socket forming, bending etc.) than those described in 6.1.1 and 6.1.2.

6.2 Recommendations for above-ground installation

6.2.1 General


When thermoplastics are subject to changes in temperature, thermal movement or forces occur. The actual forces or movement are a function of variation in temperature and cannot be calculated directly from the coefficient of thermal expansion formula and the water temperature. This is because hot discharges are intermittent, resulting in a difference in temperature between the internal and the external surfaces of the pipe due to the low coefficient of conductivity through the wall.

6.2.2 Installation of PE and PP pipeworks with non-removable rigid joints

PE and PP pipeworks with non-removable rigid joints (e.g. PE or PP butt-fused joints or joints with electrofusion sleeve couplings, see 6.3.3 or 6.3.4 respectively) may be installed, preventing any thermal movement. In this case, the pipework components and the supports are intended to withstand the forces that occur due to changes in temperature and result in stress in the pipework.

Fix all pipes rigidly to the building structure and fasten each branch to the building structure by anchor brackets (e.g. with an arrangement of fixed points as shown in Figure 15). This Figure is given as an example and does not apply for support centres (see Table 3).

For fixed point design, refer to the note in 6.2.4.1, and carefully follow the manufacturer's instructions.

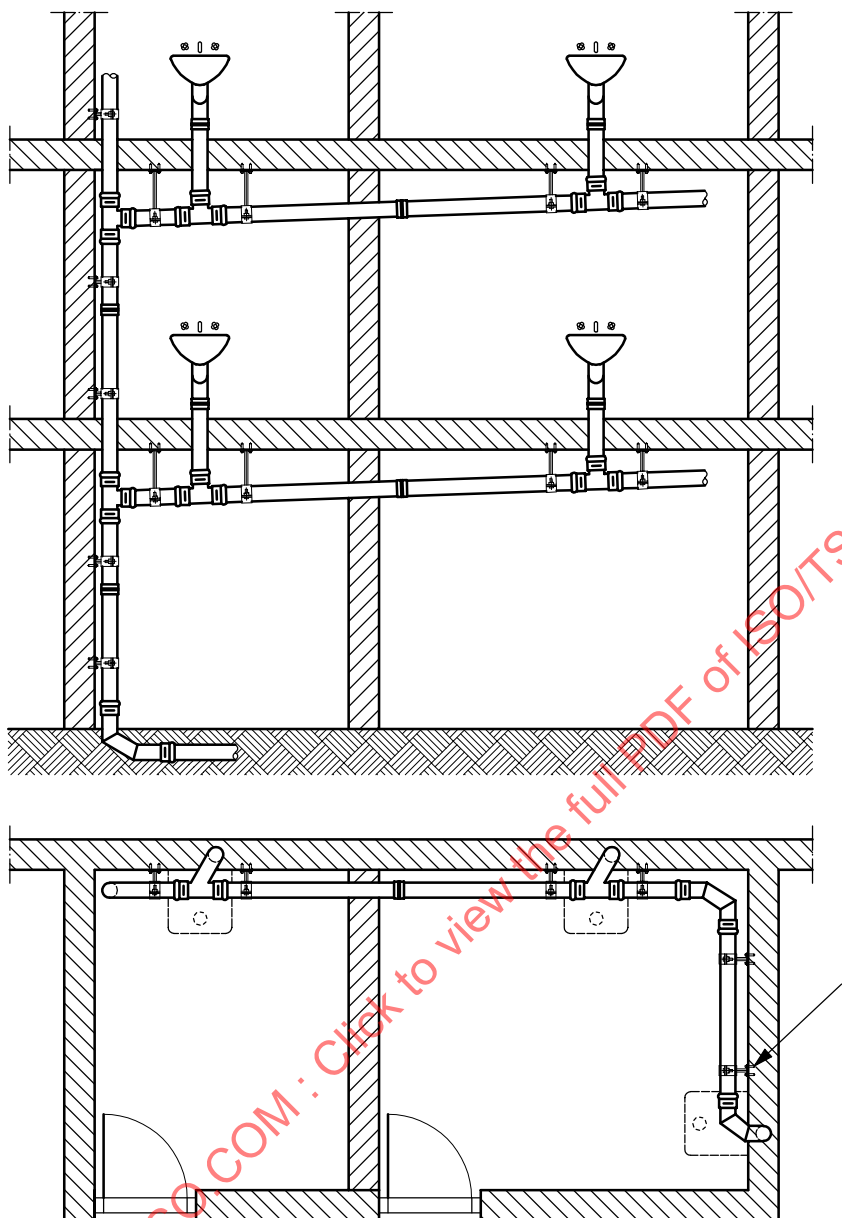

Key

- 1 anchor bracket (also all other brackets)

Figure 15 — Typical arrangement of fixed points for PE and PP pipework with rigid joints

6.2.3 Installation with joint design taking account of thermal movement

6.2.3.1 Expansion gap and length between fixed points

In all the other cases which are not covered by 6.2.2, the thermal movement is not prevented and it is relieved by the joint design.

The effective maximum temperature has been used for designing the socket depth and the maximum recommended free length of pipe permitted by each joint, when the installation is operated at temperatures ranging from 0 °C to 30 °C.

The coefficients of thermal expansion for thermoplastics are given in Table 1.

Table 1 — Coefficients of thermal expansion

Material	Coefficient of thermal expansion °C ⁻¹
ABS	8×10^{-5} to 9×10^{-5}
PE	17×10^{-5} to 20×10^{-5} ^a
PP	11×10^{-5} to 18×10^{-5}
PVC-C	6×10^{-5} to 8×10^{-5}
PVC-U	6×10^{-5} to 8×10^{-5}
PVC-U with structured-wall pipes	6×10^{-5} to 8×10^{-5}
SAN + PVC	6×10^{-5} to 8×10^{-5}
^a This is the conventional range of coefficients; other values may be used, with reference to manufacturer's instructions.	

In above-ground installations, such systems require fixed points (secured with anchor brackets or built into the building structure) and intermediate supports provided by guide brackets. Branches are always considered as fixed points.

Hence, when the length between fixed points, L_F , in above-ground horizontal installation exceeds 1 m, use non-rigid joints for expansion: a relevant ring seal socket (type S, type N or M or type L), as specified in the relevant associated standard, may be suitable. Therefore, conform to Table 2 for the maximum recommended lengths, L_F , permitted by each type of expansion socket. During installation, keep also an expansion gap, E , according to Table 2, at each socket bottom.

NOTE For PE systems, the ring seal sockets type L have been specially designed to allow thermal movement; refer to ISO 8283-2 for the selection of the appropriate design.


Table 2 — Recommended length between fixed points, and recommended expansion gap at each socket, for above-ground horizontal installation

Material	Type S socket		Type N or M socket		Type L socket	
	L_F^a	E	L_F^a	E	L_F^a	E
	m	mm	m	mm	m	mm
ABS	$1 \leq L_F \leq 4^b$	≥ 10	$1 \leq L_F \leq 4$	≥ 10	$1 \leq L_F \leq 8$	≥ 20
PE	(no type S for PE)		$1 \leq L_F \leq 4^b$	≥ 20	$1 \leq L_F \leq 8$	≥ 50
PP	(no type S for PP)		$1 \leq L_F \leq 4$	$\geq 15^c$	$1 \leq L_F \leq 8$	≥ 20
PVC-C	$1 \leq L_F \leq 4^b$	≥ 10	$1 \leq L_F \leq 4$	≥ 10	$1 \leq L_F \leq 8$	≥ 20
PVC-U	$1 \leq L_F \leq 4^b$	≥ 10	$1 \leq L_F \leq 4$	≥ 10	$1 \leq L_F \leq 8$	≥ 20
PVC-U with structured-wall pipes	$1 \leq L_F \leq 4^b$	≥ 10	$1 \leq L_F \leq 4$	≥ 10	$1 \leq L_F \leq 8$	≥ 20
SAN + PVC	(no type S for SAN + PVC)		$1 \leq L_F \leq 4$	≥ 10	$1 \leq L_F \leq 8$	≥ 20
NOTE These recommendations apply for ambient installation temperatures between 0 °C and + 30 °C.						
^a Where $L_F \leq 1$ m, then E is not specified.						
^b For nominal outside diameter, $d_n \leq 50$ mm, reduce L_F to ≤ 2 m, and prefer type N or M sockets.						
^c Reduce E to ≥ 10 mm where $L_F \leq 2$ m.						

For expansion of soil and waste vertical pipes, install a ring seal joint at least at each storey height. Typical above-ground installations with solvent-cement and ring seal joints are given in Figures 16 and 17, respectively. Both figures are given as examples and do not apply for support centres.

For expansion of rainwater vertical pipes, install a ring seal joint at least every second storey height.


Dimensions in millimetres

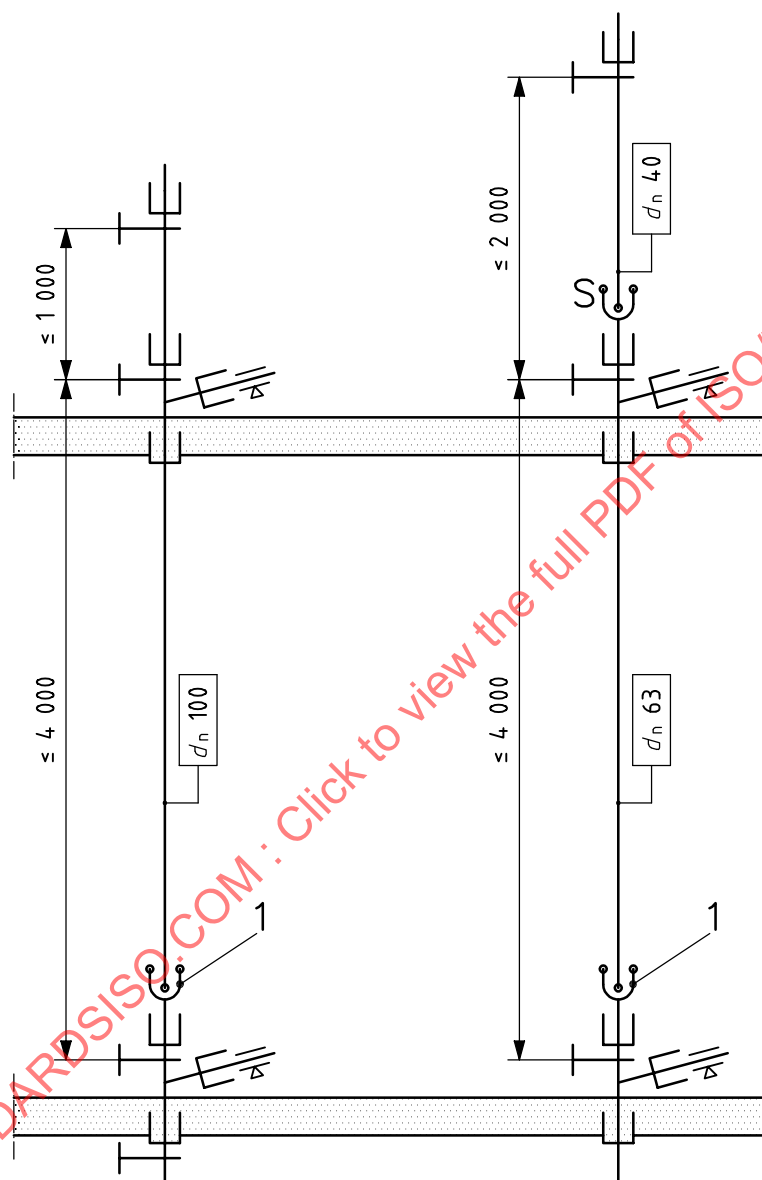

Key

- 1 socket type N or M

Figure 16 — Example of installation with solvent cement joints and expansion sockets

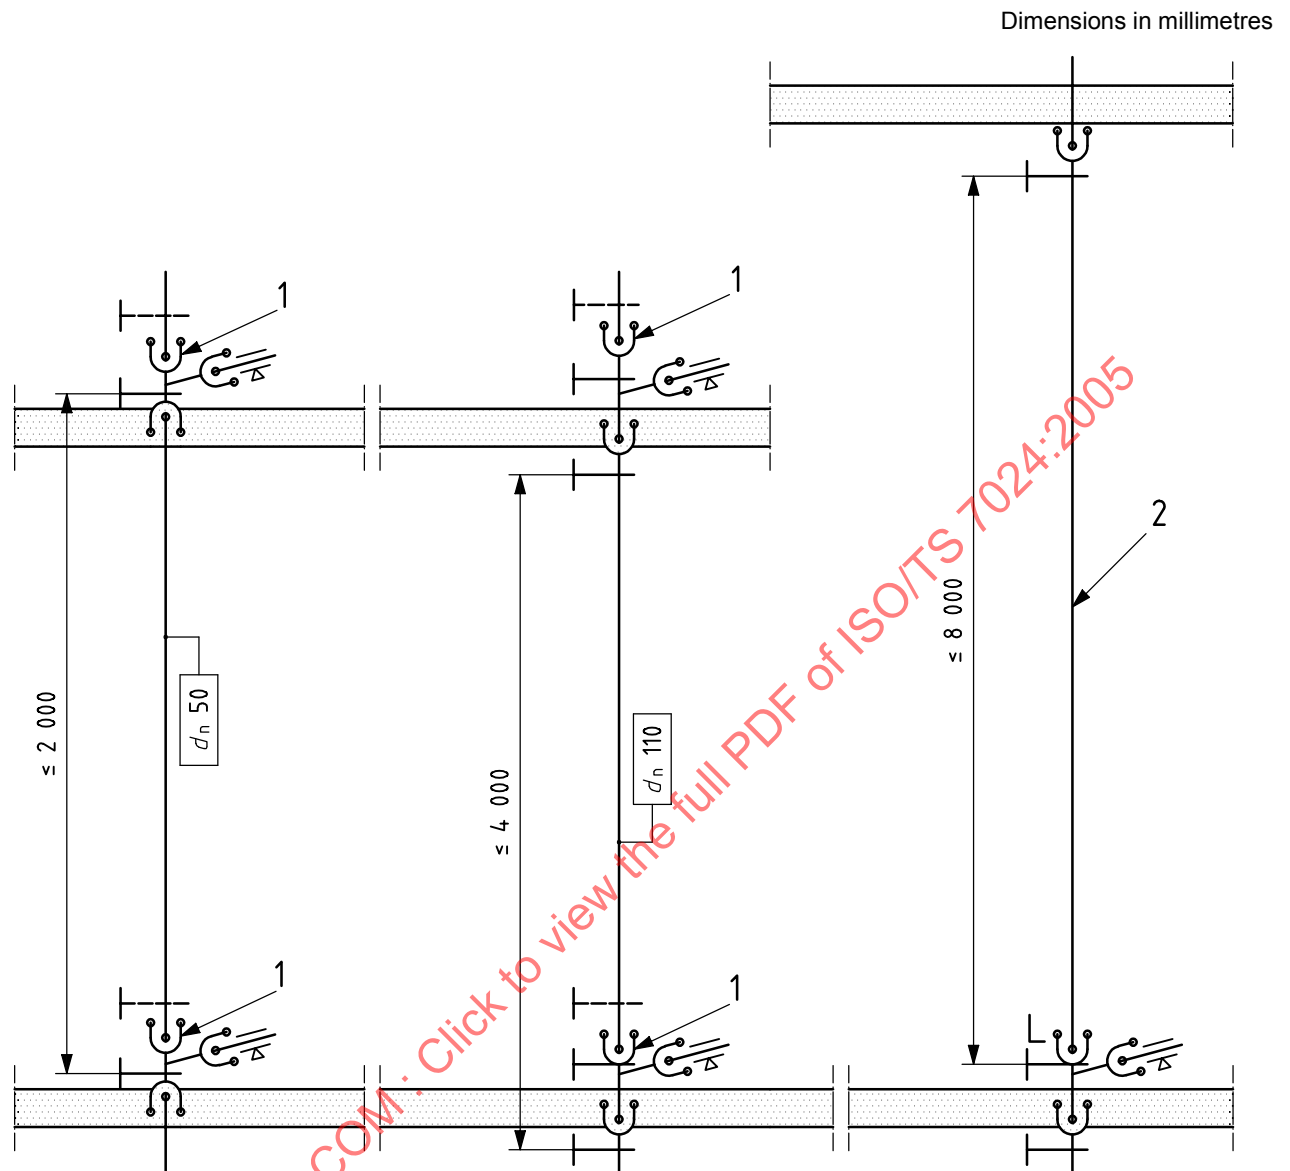**Key**

- 1 socket type N or M
- 2 pipe of any diameter

Figure 17 — Example of installation with ring seal joints**6.2.3.2 Effective sealing length**

When jointing spigots of pipes or fittings into ring seal sockets, including into expansion sockets combined with other jointing techniques, e.g. fusion or solvent-cement joints, take care to ensure that the cylindrical part of the spigot is sufficiently inserted in the seal in the socket. The recommended minimum effective sealing length, Y (see Figure 18), for such joint is 10 mm for $d_n \leq 50$ mm and $0,2 d_n$ for $d_n > 50$ mm.



Figure 18 — Effective sealing length

6.2.4 Supports

6.2.4.1 Bearing capacity, fit and fixing of brackets


Brackets are made of metals or plastics.

Where applicable, check the brackets for marking and/or associated information to confirm that the bracket is intended to carry the size and weight of the system components to be supported.

For brackets to be used as fixed points [see Figure 19 a)], ensure that the bracket can grip the pipe or fitting firmly but not clamp it hard, taking account of the thickness of any coatings and/or sleeves involved.

NOTE For PE systems, if the ring seal socket type L has no special anchoring device such as factory-made collar, the construction of anchor bracket may be made using an electrofusion tape [see Figure 19 b)].


For brackets to be used as guide brackets (see Figure 20), ensure that the guide is smooth and allows the pipe to move linearly, taking account of the thickness of any coating and/or sleeves involved. If any sleeves are to be used, locate them in position.

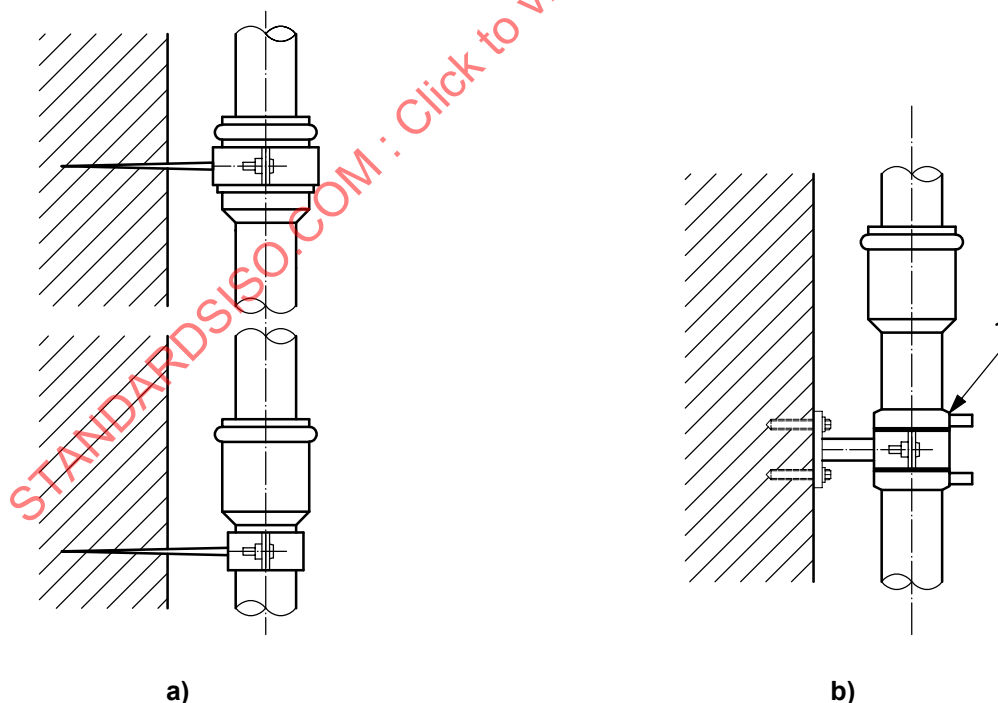

Key

- 1 electrofusion tape for fixed point constructions

Figure 19 — Typical anchor brackets

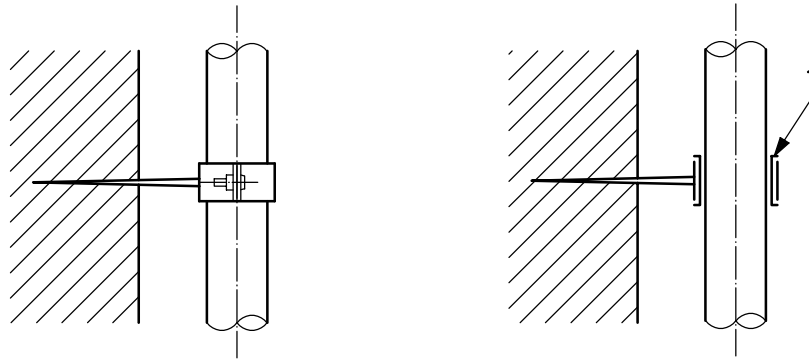**Key**

1 sleeve of soft material

Figure 20 — Typical guide brackets**6.2.4.2 Distance between support centres**

For simple installations, unless otherwise specified in the manufacturer's instructions, do not exceed the recommended value for $D_{\max}$ given in Table 3 as the distance between two following support centres, either fixed or guide centres.

When the design of brackets does not allow to sustain the distances of Table 3, then use shorter distances according to the manufacturer's instructions.

NOTE Continuous support may be used for horizontal pipes.

Table 3 — Recommended maximum distance, $D_{\max}$, between support centres

Nominal outside diameter d_n mm	Distance between support centres	
	Horizontal pipework $D_{\max}$ m	Vertical pipework $D_{\max}$ m
32	0,5	1,2
40	0,5	1,2
50	0,5	1,5
63	0,8	1,5
75	0,8	2,0
80	0,8	2,0
82	0,8	2,0
90	0,9	2,0
100	1,0	2,0
110	1,1	2,0
125	1,25	2,0
140	1,4	2,0
160	1,6	2,0
180	1,7	2,0
200	1,7	2,0
250	2,0	3,0
315	3,0	3,0

For more demanding applications, see manufacturer's instructions.

Attention is drawn to specific requirements that may be needed, for instance, for solvent cement jointed systems presenting a bend. In such a case, a flexible leg may be installed (see Figure 21) in which the total length $L_1 + L_2$ does not exceed the recommended value $D_{\max}$ of Table 2: $L_1 + L_2 \leq D_{\max}$. It is recommended for each length L_1 or L_2 not to exceed the value given in Table 4.

Table 4 — Recommended maximum distance between support centres for bends of solvent cement jointed pipework systems

Nominal outside diameter d_n mm	Distance between support centres and bend L_1 or L_2 mm
≤ 40	≤ 200
> 40 and ≤ 50	≤ 250
> 50 and ≤ 75	≤ 375
> 75 and ≤ 110	≤ 550
> 110 and ≤ 125	≤ 625
> 125 and ≤ 160	≤ 800

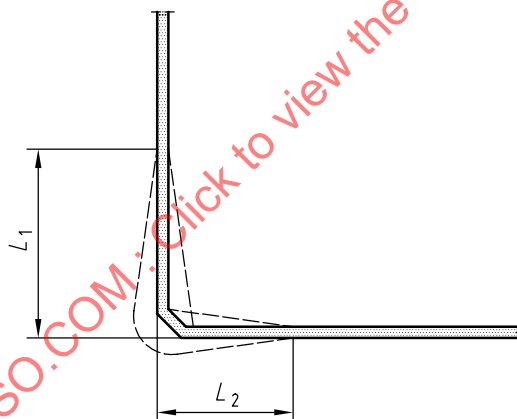


Figure 21 — Flexible leg

6.2.4.3 Installation of brackets

6.2.4.3.1 General

Make fixed points at the pipe sockets or at the sockets of fittings (see Figures 22 and 23).

NOTE For PE systems an electrofusion tape can be used, see Figure 24 as an example. If no electrofusion tape is available, two electrofusion couplings can be used, instead.

Install for each pipe only one anchor bracket for a fixed point.

Install guide brackets in such a way that the distance between the centres of the brackets (support centres) never exceeds the maximum recommended distance, $D_{\max}$, given in Table 3.


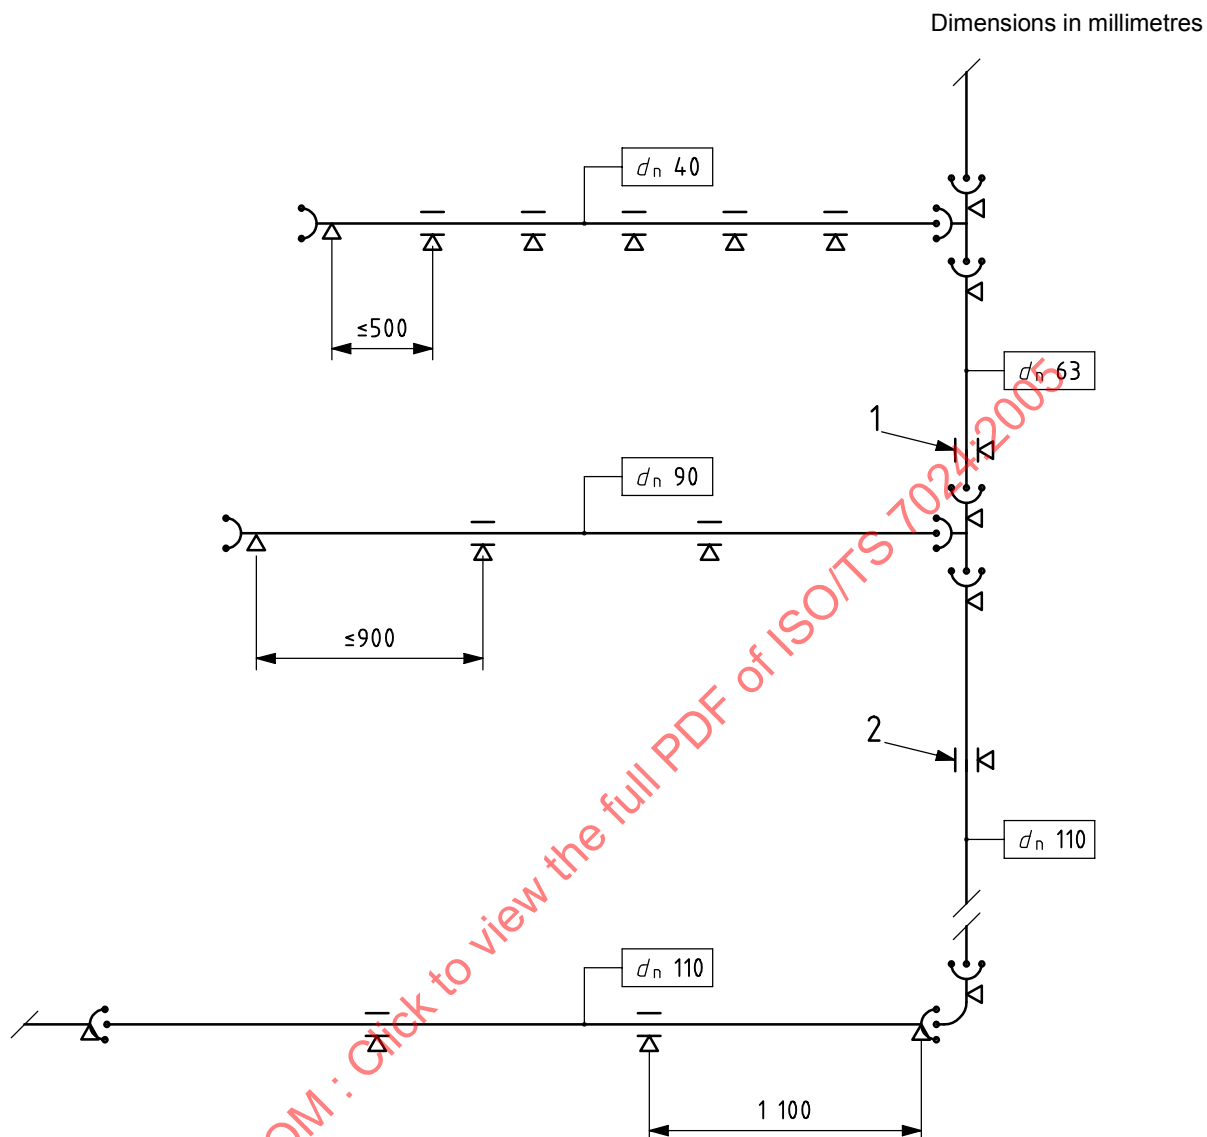


Figure 22 — Typical above-ground installation with d_n of 40 mm, 63 mm, 90 mm and 110 mm pipes and fittings

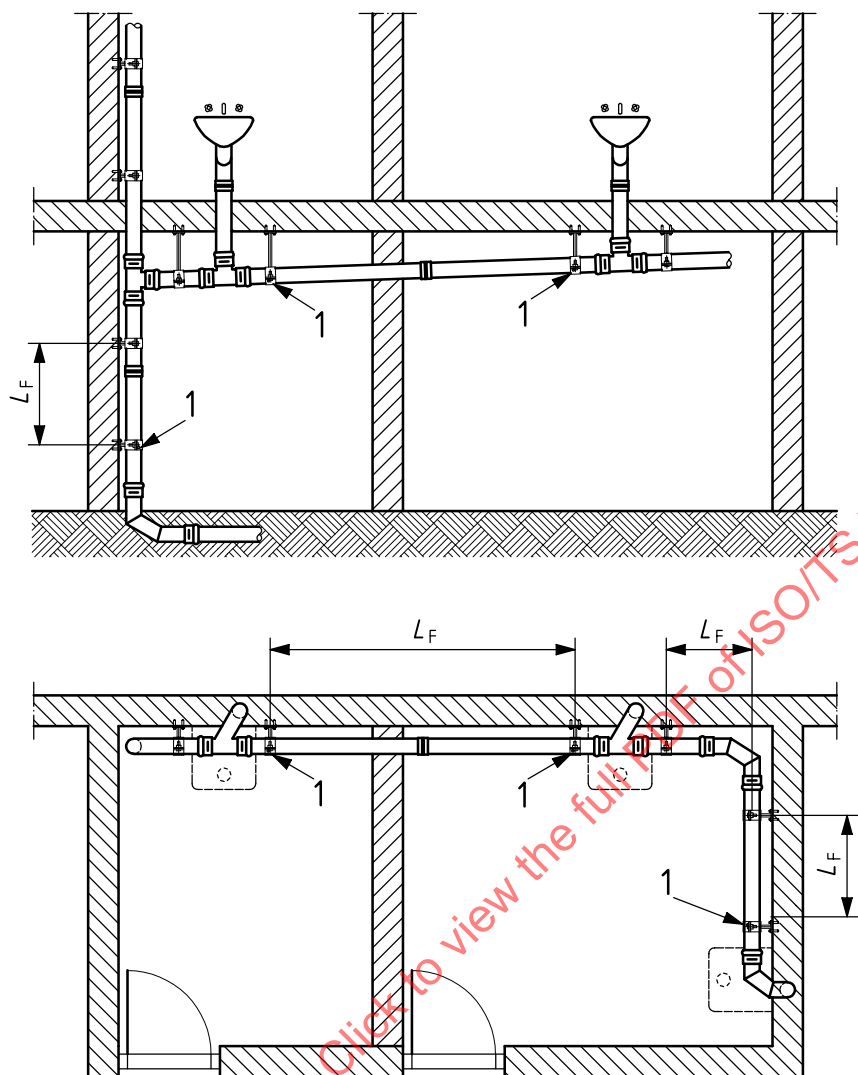


Key

L_F recommended length between fixed points, see Table 2

1 ring seal socket type L or type N or type M, according to L_F value (see Table 2)

Figure 23 — Typical general sketch for above-ground installation

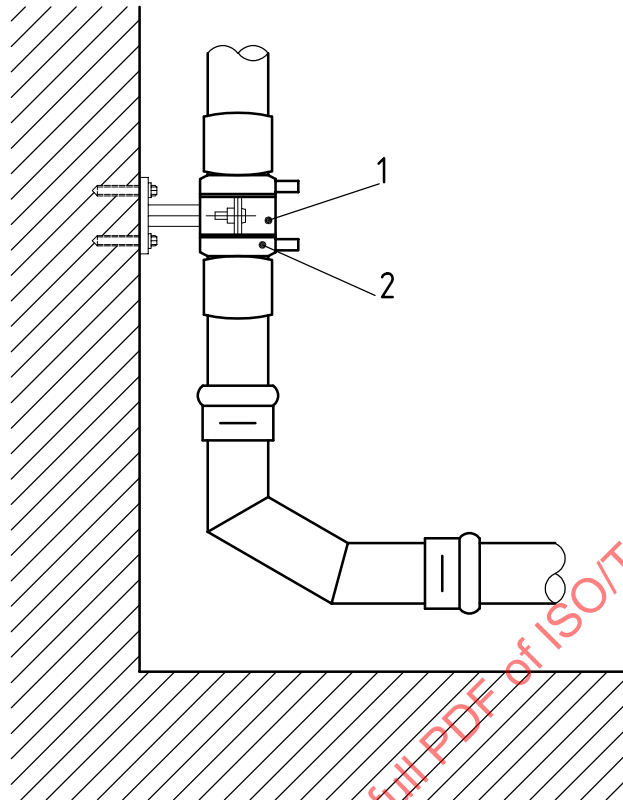**Key**

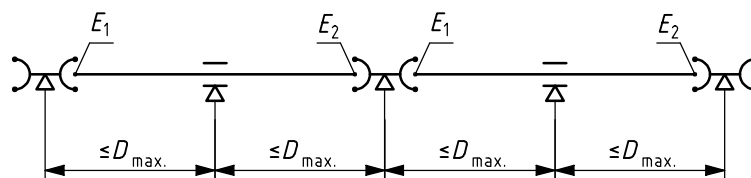
- 1 anchor bracket
- 2 electrofusion tape

Figure 24 — Fixing with an electrofusion tape**6.2.4.3.2 Supports for jointing with double sockets**

Always use an anchor bracket to fix the double socket.

For horizontal pipes, arrange the sum of the expansion gaps, $E_1 + E_2$ (see Figure 25), to be equal to, or greater than, the value of E , as recommended in 6.2.3.1.

Keep the distance between support centres smaller than or equal to $D_{\max}$ as recommended in Table 3.

**Figure 25 — Expansion gaps with double sockets**


6.3 Jointing procedure

6.3.1 Jointing with solvent cement joints

This technique is applicable to above-ground or below-ground installations with ABS, PVC-C, PVC-U and SAN + PVC systems and provides rigidly jointed pipework.

Solvent cementing is recommended to be made only at ambient temperatures ranging between -5°C and $+30^{\circ}\text{C}$, unless otherwise specified by the adhesive manufacturer.

Cut and chamfer pipe as required. Use only those solvent adhesives that are specified by the manufacturer and in accordance with the relevant associated system standard. To avoid evaporation, use small cans or tubes; reseal immediately after use (see Figure 26). Attention is drawn to any relevant local and/or national health and safety regulations; seek manufacturer's advice.

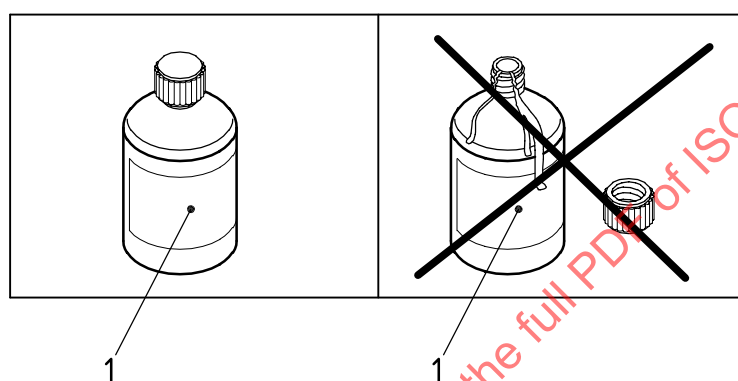


Key

1 can with solvent adhesive

Figure 26 — Sealing the can

If not specified by the manufacturer's instructions, the pipes may be prepared by abrading the mating surfaces with abrasive paper, then cleaning the surfaces with a cleaning fluid (see Figure 27).

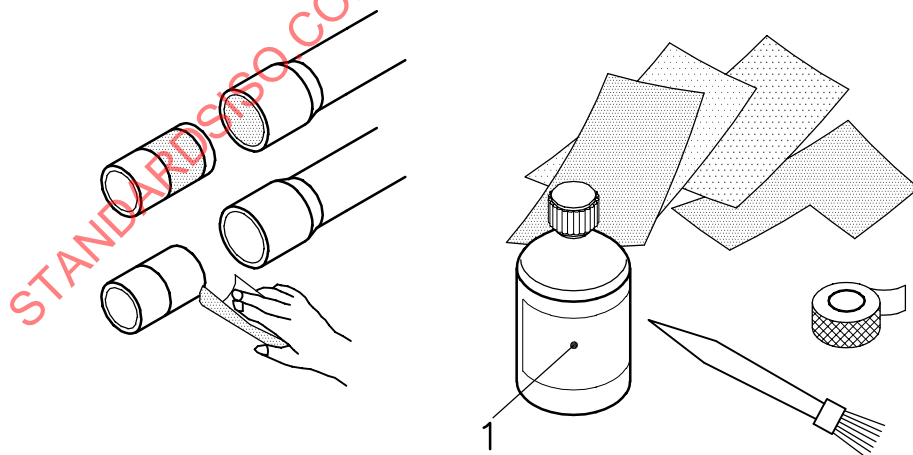


Key

1 can with cleaning fluid

Figure 27 — Abrading and cleaning the pipe end

Do not thin or dilute solvent adhesives, except for ABS systems where solvent adhesive may be thinned with thinners recommended by the adhesive manufacturer only.

Apply an even coat of solvent adhesive to the socket and the pipe. It is preferable to use axial strokes of the brush so as to avoid a build-up of solvent adhesive on the pipe and in the socket, or the formation of large bubbles in the film layer (see Figure 28).

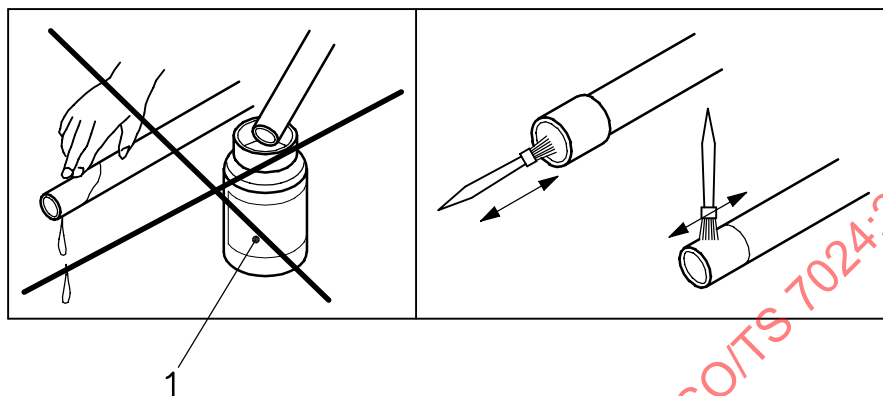

Key

1 can with solvent adhesive

Figure 28 — Brushing with axial strokes

Immediately after applying adhesive, insert the pipe in the socket to its full depth without excessive twisting and ensure correct alignment (see Figure 29). Remove excess adhesive. Leave joint undisturbed for the time recommended by the pipe manufacturer.

It is recommended to clean the brushes immediately after use with a suitable thinner or cleaning fluid, and to ensure that they are dry before being used again.

NOTE Attention is drawn to 8.2 for the solvent cement jointing of components made of different plastics.

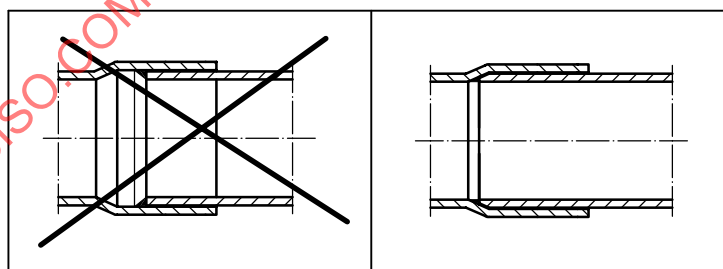


Figure 29 — Full insertion of the spigot end

6.3.2 Jointing with ring seal joints

This technique is applicable to above-ground or below-ground installations of components made of all the materials covered by the associated system standards and provides non-rigidly jointed pipework.


When the sealing ring is not placed in the socket by the manufacturer, use only the sealing rings specified by the manufacturer. Clean the groove of the ring seal socket, wipe the sealing ring clean and dry. Insert the ring in the groove, ensuring that the ring is not distorted or misaligned.

Cut and chamfer the pipe as required. Clean the end of the pipe. Apply the lubricant to the spigot end and insert the spigot into the socket, keeping an expansion gap, E , equal to the recommended value given in Table 2. Use only the lubricant recommended by the manufacturer.

Inserting the spigot (ensuring that the expansion gap left is the relevant length) can be done by using one of the following techniques:

- inserting to the full depth, marking the pipe around the mouth of the socket [see Figure 30 a)] and then withdrawing it by the relevant amount [see Figure 30 b)];
- marking the spigot end to the relevant depth, as specified by the manufacturer, then inserting the spigot to the mark (see Figure 31).


Expansion units are ready for use according to the second technique, as shown in Figure 31, because these are premarked and preassembled.

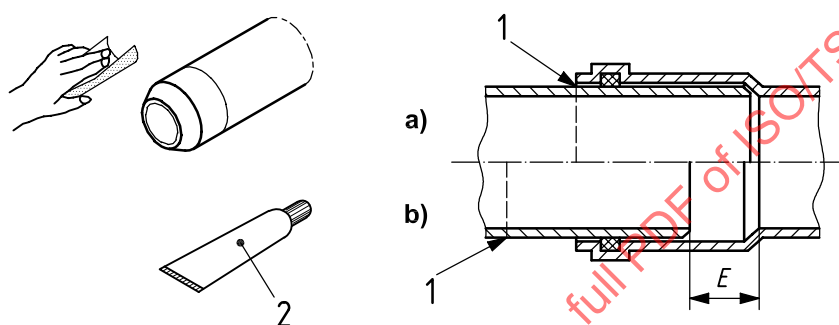

Key

- 1 insertion mark
2 lubricant

Figure 30 — Expansion gap with a ring seal joint

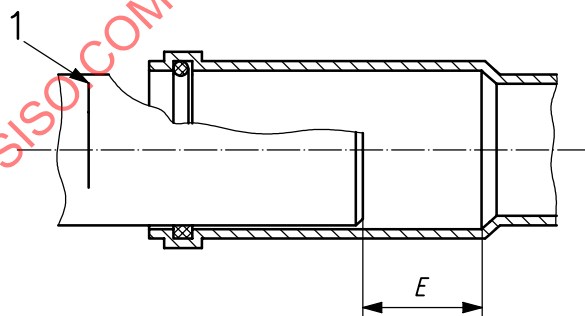


Key

- 1 insertion mark

Figure 31 — Expansion gap with an expansion unit

In horizontal pipework, double socketed fittings may also be installed with an expansion gap on the upstream end of the fitting. In this case, anchor the fitting with a bracket (see Figure 32), and anchor the pipe upstream with a bracket approximately in the middle of the pipe (see 6.2.4.3.2).

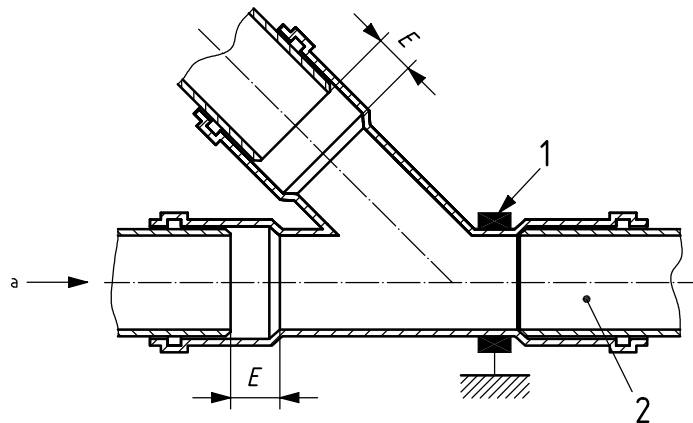**Key**

- 1 anchor bracket
- 2 plain end pipe inserted to the bottom of fitting socket
- a Direction of flow.

Figure 32 — Normal positioning of expansion gaps in double socketed fittings

6.3.3 Jointing with butt fusion

6.3.3.1 General

The butt fusion technique is applicable to above-ground or below-ground installation with PP and PE components and provides rigidly jointed pipework. The pipe or fitting ends to be fused are heated by means of a heating element, then pressed together using a given pressure.

NOTE 1 The fused joints have physical and mechanical properties similar to those of the pipe material, since an interlacing of the material molecule chains occurs.

For components made of PP, joint by butt fusion, only those that are made of materials with melt mass-flow rate (MFR) in the same class or in adjacent classes, and that are MFR class marked on the component itself (e.g. MFR B).

NOTE 2 Classes of MFR (230/2,16) for PP materials are as follows:

- Class A: $0 < [\text{MFR}] \leq 0,3 \text{ g/10 min}$;
- Class B: $0,3 < [\text{MFR}] \leq 0,6 \text{ g/10 min}$;
- Class C: $0,6 < [\text{MFR}] \leq 0,9 \text{ g/10 min}$;
- Class D: $0,9 < [\text{MFR}] \leq 1,5 \text{ g/10 min}$.

In all cases, follow the manufacturer's instructions to ensure a leak- and trouble-free joint.

6.3.3.2 Jointing recommendations

6.3.3.2.1 General

Carry out the fusion operation in a clean place, protected from frost and high levels of humidity.

Depending on the dimension of the pipes and fittings to be fused, use the equipment and techniques as shown in Figure 33.

The method of butt welding comprises three stages as described in 6.3.3.2.2 to 6.3.3.2.4.

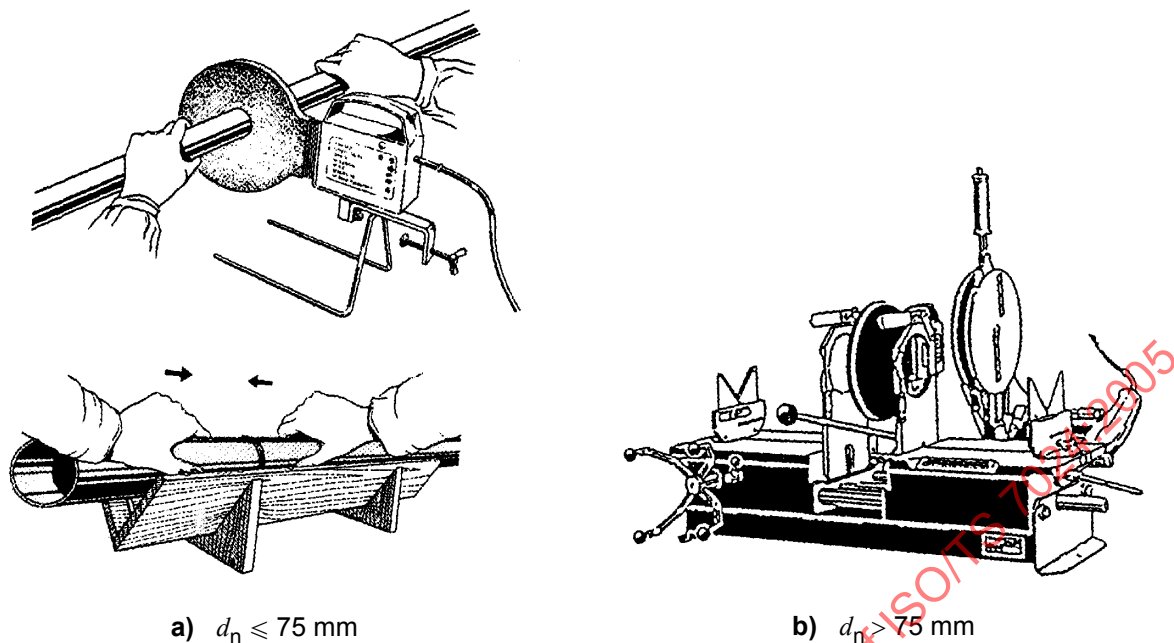



Figure 33 — Butt fusion techniques

6.3.3.2.2 Surface preparation

Check that the matching surfaces for assembly are cut square, without chamfer, and are free from defects.

6.3.3.2.3 Heating of surfaces

Before starting the fusion process, check the operation of the fusion machine. Raise the temperature of the heater according to the manufacturer's instructions, normally between 200 °C and 230 °C for PE, and between 190 °C and 220 °C for PP. Align the joint surfaces of the jointing components to be fused and insert the hot heating plate between them. Press the two components together with the heating plate at a pressure in the fusion surface between 0,12 MPa and 0,22 MPa for PE, and between 0,10 MPa and 0,20 MPa for PP. Maintain the heating-up pressure until a bead of melt material is formed around the whole circumference of the components to be fused. Manufacturer's instructions may include recommendation for parameters of the fusion operation, as shown in Figure 34, including time intervals and related pressures together with the preferred ranges of temperature.

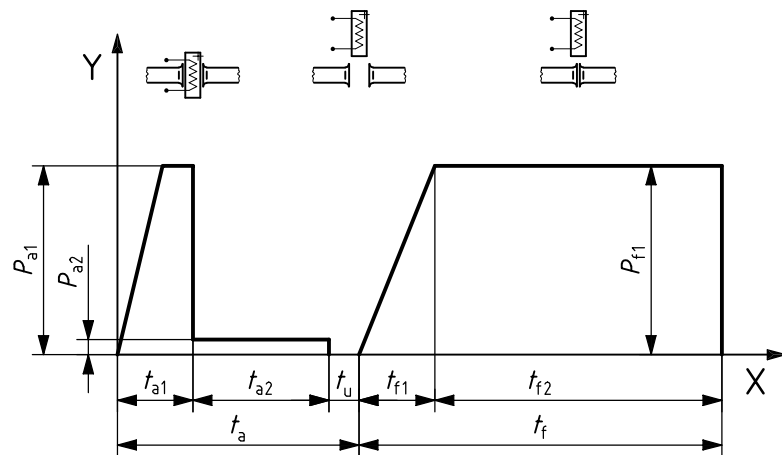**Key**

X	time, t , in seconds
Y	pressure, P , in megapascals
P_{a1} , P_{a2}	heating pressures, high and low
P_{f1}	fusion pressure
t_{a1} , t_{a2}	heating times with high and low pressures
t_a	total heating time
t_{f1}	pressure build-up time
t_{f2}	cooling time
t_f	total cooling time
t_u	change-over time

Figure 34 — Parameters for fusion operation**6.3.3.2.4 Fusion**

Remove the hot plate and press the heated surfaces together. Maintain the pressure according to the manufacturer's instructions with a correct alignment of the two components until the fusion zone has cooled. Parameters for fusing the parts together and for the cooling operation may be given in the manufacturer's instructions (see Figure 34).

Do not accelerate the cooling process by means of cold water or any other cooling equipment since this may impair the quality of the joint.

6.3.4 Jointing with electrofusion sleeve couplings**6.3.4.1 General**

Electrofusion sleeve couplings are applicable to above-ground and below-ground installations with PE components and provide rigidly jointed pipework.

The parts (pipe or fitting ends) to be fused are inserted, after cleaning, into the coupling and brought to the fusion temperature produced by a built-in heating coil.

6.3.4.2 Additional preparation of pipe ends

The pipe ends may be chamfered. Mark the pipe at the insert length required by the coupling. If a repair coupling without a butt ring is to be used, the insert lengths correspond to half the length of the coupling. If recommended by the manufacturer's instructions, scrape the marked area with a knife or special equipment (see Figure 35).

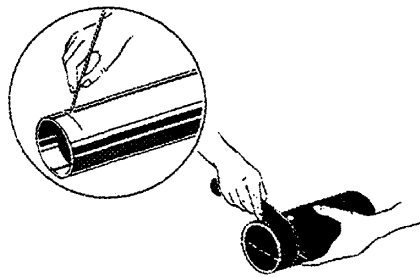


Figure 35 — Preparation of pipe end

6.3.4.3 Jointing recommendations

Ensure that the electrofusion sleeve coupling is clean and free from grease and dust.

If necessary, clean the coupling by abrading, but without using soap or any other cleaning agents.

Insert the prepared pipe or fitting ends into the coupling, until the inserted ends reach the butt rings, if any, or, if a repair coupling without butt ring is used, until the marked length has been inserted (see 6.3.4.2).

Prior to the welding procedure, check the pipe and/or fitting for correct alignment.

NOTE 1 Incorrect alignment causes stress.

Connect the terminals to an electrical power source and operate the power input according to the manufacturer's instructions.

NOTE 2 A fully automatic electrofusion machine is recommended.

Once the fusion operation is done, check visually for the successful completion.

NOTE 3 Some electrofusion sleeve couplings are provided with ejectable pins or thermochromatic indicators that have the function of witnessing the satisfactory execution of the fusion (refer to manufacturer's instructions).

6.3.5 Jointing with flanges and backing rings

6.3.5.1 General

Joints with flange and backing rings are applicable to above-ground installations of PE and provide rigidly jointed pipeworks.

The pipe ends or fittings are connected to the flange adaptors by means of butt fusion or electrofusion sleeve coupling. The adaptors are tightened by compressing the flange rings by means of bolts and nuts.

6.3.5.2 Jointing recommendations

Ensure that the fusion flange adaptors are correctly aligned prior to connection. Insert the seal between the adaptors, set in all bolts, washers and nuts and tighten in correct sequence.

6.3.6 Jointing with compression joints

6.3.6.1 General

Joints with compression couplings are applicable to above-ground installations of PE and provide rigidly jointed pipeworks.

NOTE Compression couplings are designed to grip and seal on to the outer surface of a pipe or spigot end. They are not designed to compensate thermal movement within the pipework.

6.3.6.2 Jointing recommendations

Cut the pipe as required. Clean the end of the pipe with a clean cloth. Split the nut, the antifriction ring and the rubber seal over the pipe end and insert the pipe end fully into the coupling. Securely tighten the nut.

7 Special precautions

7.1 Concreting of thermoplastics systems within the building structure

7.1.1 General

Carefully follow the manufacturer's instructions, subject to any relevant local and/or national regulations.

Provided they are rigidly jointed (e.g. systems with fused joints) PE and PP components may be concreted in without any special precaution (see Figure 36 in comparison with Figure 23).

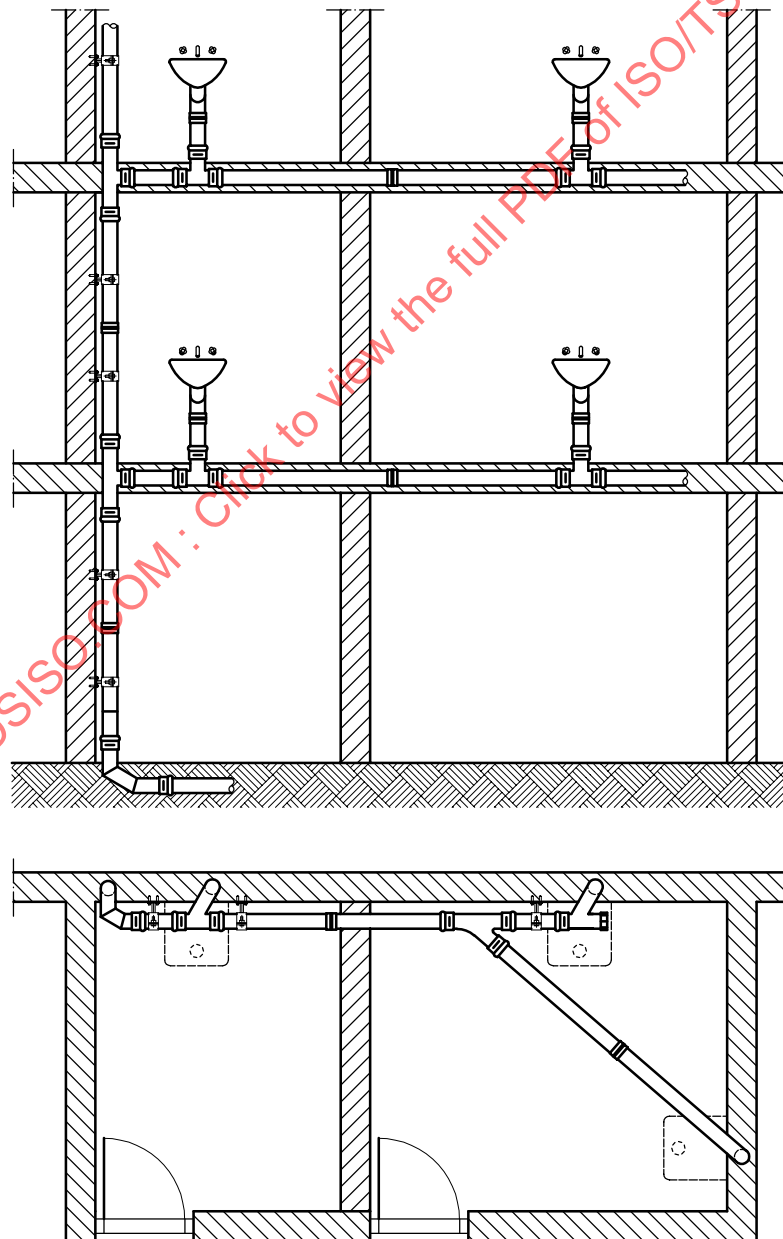


Figure 36 — Example of concreted-in rigidly jointed PE or PP system

For the other situations with PE and PP systems, and for all systems made of the other materials, 7.1.2 or 7.1.3 apply, whichever is relevant according to the curing temperature of concrete, ambient or with post-heating. Take care not to exceed the recommended maximum cover height of concrete above the components, given in Table 5.

Table 5 — Recommended maximum cover height of concrete

Material	Pipe S-Series from the associated system standards	Recommended maximum cover height of concrete		
		at ambient temperature	with post-heated concrete	
		m	at 50 °C m	at 70 °C m
ABS	S-25	0,5	no	no
	S-16,7	1,5	0,5	no ^a
PE	S-16	1,0	—	0,5
	S-12,5	2,5		1,0
PP	S-20	0,5		no
	S-16	1,5	no	0,5
	S-14	2,5		1,0
PVC-C	S-25	0,5	no	no
	S-16,7	3,0	1,25	no ^a
PVC-U	S 25	no	no	no
	S 20	1,0	no	no
SAN + PVC	S-25	0,5	no	no
	S-16,7	2,0	0,75	no ^a

^a Post-heating between 50 °C and 70 °C is recommended with PE and PP systems only (see 7.1.3.1).

7.1.2 Inserting systems in concrete setting at ambient temperature

7.1.2.1 Attention is drawn to any relevant local and/or national regulations.

7.1.2.2 Fasten systems with ring seal assemblies to prevent floating and support them sufficiently to prevent deflection during pouring of the concrete.

7.1.2.3 During pouring and vibration of the concrete take great care to prevent damage to the pipework.

7.1.2.4 Protect the ring seal sockets with tape on the outside to prevent concrete entering the socket mouths. Cap or plug open pipes in order to prevent the entry of water or concrete.

7.1.2.5 Fix all connected pipes which are branched off in the same way as the pipe they are connected to in order to avoid displacements or bending forces.

7.1.2.6 When a run of pipework is jointed by a branch of smaller diameter, use an appropriate means of fixing the larger pipe close to the branch in order to protect against shearing of the smaller pipe.

7.1.2.7 Figure 37 shows how fixing to the concrete formwork may be carried out. It is recommended that the fixing brackets have a strength sufficient to hold the pipe in the correct position. For the distances between support centres for concreted systems, do not exceed the recommended maximum value, $L_{c,max}$, given in Table 6.

NOTE The pipe can also be fixed to the steel reinforcement.

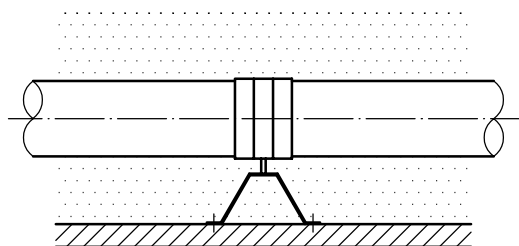
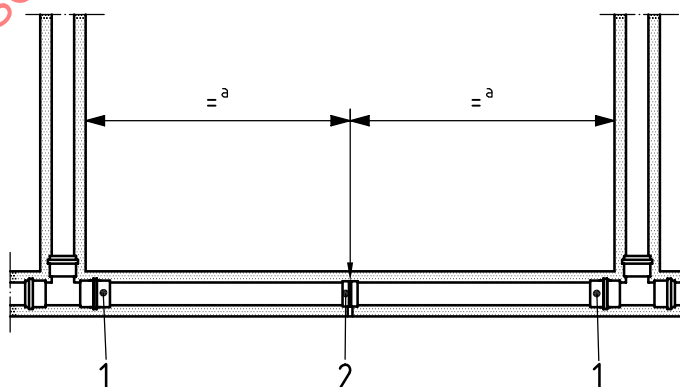


Figure 37 — Typical fixing to the concrete formwork

Table 6 — Recommended maximum distance between support centres for pipes to be concreted in

Nominal outside diameter d_n mm	Distance between support centres	
	Horizontal pipework $L_{c,max}$ m	Vertical pipework $L_{c,max}$ m
32	0,4	0,8
40	0,5	1,0
50	0,5	1,0
63	0,5	1,0
75	1,0	1,5
80	1,0	1,5
82	1,0	1,5
≥ 90	1,0	2,0

7.1.2.8 For pipes that are completely concreted-in, do not exceed the recommended maximum cover height of concrete given in Table 5 and do not install more than a 3 m length without a fixed point in the concrete (see Figure 38). Sockets, electrofusion sleeve couplings and various types of fittings will act as fixed points in the concrete. A ring made of the same material as the pipe may be cement-welded or fused, as applicable, to the outside of the pipe in order to act as an extra fixed point when the pipe length exceeds 6 m.

**Key**

- 1 socket with ring seal and expansion gap
- 2 anchor bracket fastened to concrete formwork
- a ≤ 3 m


Figure 38 — Typical completely concreted-in pipe system

7.1.2.9 Install at least one ring seal socket between two fixed points to accommodate the expansion of the pipes. To ensure free movement of the pipes in the ring seals, lubricate the spigot-ends of the pipes.

For expansion gaps, conform to the recommendations for *E* in Table 2.

7.1.2.10 Always install partly concreted-in pipe systems with fixed points in the concrete ceiling or floor (see Figure 39).

Dimensions in millimetres

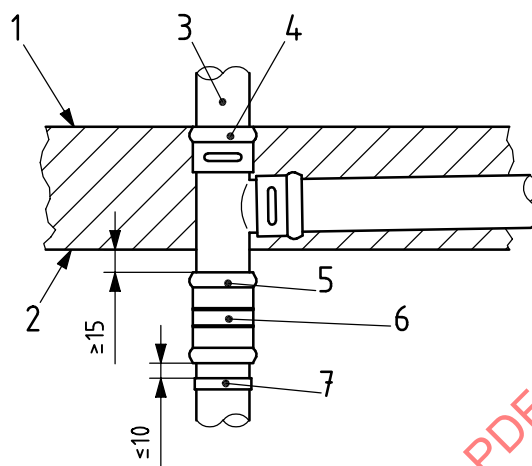

Key

- 1 floor
- 2 ceiling
- 3 pipe to be installed after concreting
- 4 sealing ring socket with expansion gap
- 5 expansion gap in this socket (example with double socket)
- 6 expansion gaps in double socket (example)
- 7 guide bracket or solvent cemented or fused ring to secure the double socket


Figure 39 — Typical partly concreted-in pipe systems

7.1.2.11 Pipes that are connected to partly concreted-in pipe systems between concrete floors and ceilings are often installed after the concreting.

The spigot or pipe end may end directly against the concrete formwork. A collar made of expanded polystyrene may be placed around the spigot or the pipe end as shown in Figure 40. Once the concrete has been established, remove the collar to enable connection of further pipework to the spigot end, as shown in Figure 41 a) is applicable to all non-rigidly jointed systems, and Figure 41 b) to rigidly jointed PE and PP systems.

Pipe ends in the upper part of the formwork may be arranged in the same way in order to avoid damage to pipes above the formwork during the concreting (see Figure 42).


Dimensions in millimetres

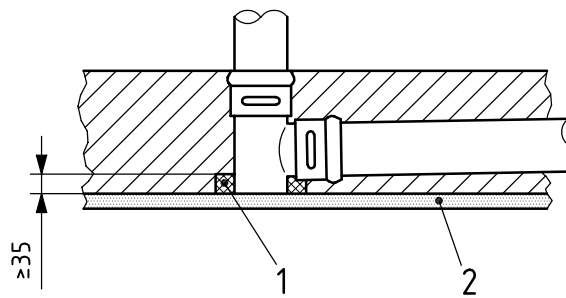**Key**

- 1 ring of expanded polystyrene
- 2 formwork for the concrete

Figure 40 — How to arrange expanded polystyrene ring on spigot or pipe in the formwork

Dimensions in millimetres

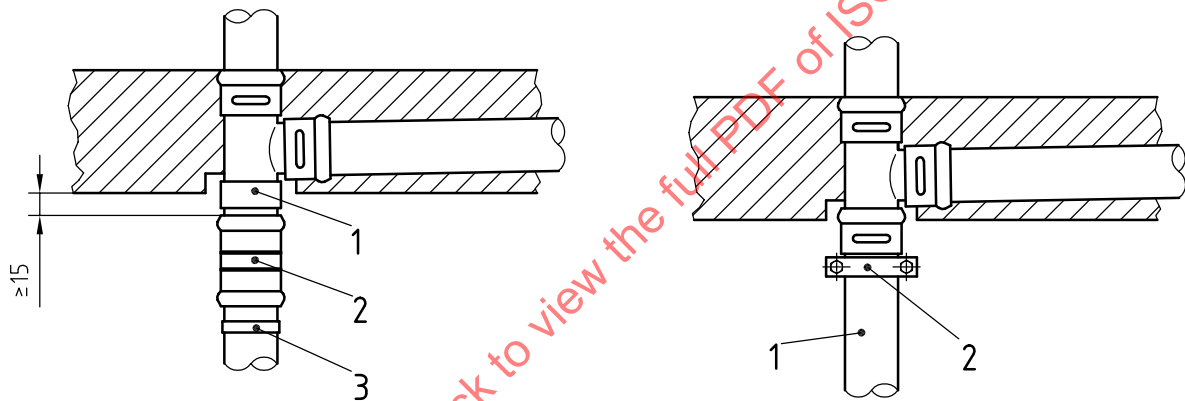**a) For non-rigidly jointed systems****b) For PE and PP rigidly jointed systems****Key**


- 1 extension of the spigot end
- 2 slip coupling
- 3 solvent cemented or fused ring to secure slip coupling

Key

- 1 anchor bracket
- 2 pipe with socket

Figure 41 — How to continue the installation under the concrete ceiling (polystyrene ring and formwork removed)**Key**

- 1 ring of expanded polystyrene
- 2 plug

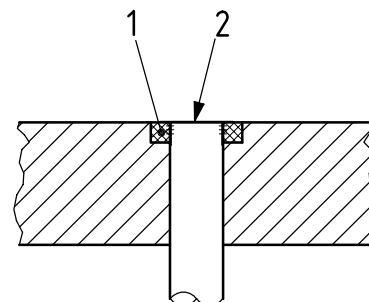**Figure 42 — How to end a pipe against the upper part of the formwork (formwork removed)**

7.1.2.12 When installation of partly concreted-in pipe systems is carried out under winter conditions, in order to avoid damage caused by subsequent freezing of water in the pipework, ensure that melted ice/snow does not flow into installed pipes and fittings. This precaution is not applicable to PE systems.

7.1.3 Inserting systems into post-heated concrete

7.1.3.1 For post-heating at a maximum temperature of 50 °C, use only systems with wall thicknesses thicker than or equal to S 16,7 (which excludes any PVC-U system and S-20 PP systems). For temperatures between 50 °C and 70 °C, use only PE and PP components conforming to Table 5.

Attention is drawn to any relevant local and/or national regulations. Carefully follow the manufacturer's instructions, with special attention to distances of support centres, and take the following precautions in addition to those of 7.1.2.

7.1.3.2 Do not let the temperature in the concrete at the location of the pipework rise above 50 °C or above 70 °C, whichever is relevant (see Table 5).

7.1.3.3 After finishing the heating treatment, let the pipework cool down slowly.

7.2 Foaming of thermoplastics systems

This subclause only applies to systems when they are prefabricated in factories.

NOTE Do not foam on site these systems unless allowed by national and/or local regulations.

Take care to insure that pipes and fittings stay in initial position during the foaming operation.

Under certain circumstances, when higher temperatures than allowed for the material may occur, it may be necessary to cool the pipework, e.g. by means of cold water, in which case anchor the components to prevent displacement.

7.3 Prevention of additional stresses in pipework

Avoid misalignment of the pipework. When filling up the space between a hole in a wall and the pipe passing through that wall, take care not to push the pipe out of line.

8 Jointing to other materials or other constructions

8.1 General

Any joint of a thermoplastic component with components made of dissimilar materials shall conform to functional requirements as given in the relevant associated system standard.

In all cases, follow the manufacturer's instructions for ensuring a leaktight and trouble-free joint.

8.2 Solvent-cement joints

In the case of solvent cementing of dissimilar plastics materials, use only components having dimensions and tolerances on outside diameter very close to those of the other material components, and those types of solvent adhesive that are compatible with both types of plastic and thus only applicable to jointing PVC-U, ABS, PVC-C and SAN + PVC components.

8.3 Ring seal joints

In the case of jointing a ring seal socket made of a given basic thermoplastics material, use only components made from other materials having tolerances on the outside diameter of their spigot smaller than or equal to