

NFPA 50

Bulk Oxygen Systems at Consumer Sites

1990 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1990 NFPA, All Rights Reserved

NFPA 50
Standard for
Bulk Oxygen Systems at Consumer Sites
1990 Edition

This edition of NFPA 50, *Standard for Bulk Oxygen Systems at Consumer Sites*, was prepared by the Technical Committee on Industrial and Medical Gases and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 13-15, 1989 in Seattle, WA. It was issued by the Standards Council on January 12, 1990, with an effective date of February 5, 1990, and supersedes all previous editions.

The 1990 edition of this document has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 50

Development of NFPA 50 was initiated by the Compressed Gas Association, Inc., who submitted a complete text to the NFPA Committee on Gases in 1955. Working responsibility for the project was assigned to the Sectional Committee on Industrial Gases, and the standard was Tentatively Adopted in 1956. A revised edition was Officially Adopted in 1957, and subsequent revised editions were adopted in 1962 and 1965 as NFPA 566.

In June 1966 responsibility for NFPA 566 was reassigned to the Committee on Industrial and Medical Gases. With the 1971 edition, the standard was redesignated as NFPA 50.

Since the 1971 edition, revised editions were adopted in 1973, 1974, 1979, 1985, and 1990.

Technical Committee on Industrial and Medical Gases

Fred K. Kitson, *Chairman*

F. K. Kitson Safety Associates

Theodore C. Lemoff, *Secretary*

National Fire Protection Association

(Nonvoting)

Francis X. Bender, Safety Engineering
Consultants

Carl A. Caves, US Dept. of Energy

Leo G. Foxwell, Hartford Insurance Group

Rep. AISG

Lee W. Gibbs, Underwriters Laboratories Inc.

Charles B. Henrici, Elk Grove Village Fire Dept.

Rep. IAFC

Edward J. Kilrer, Monsanto Co.

Rep. CMA

Douglas F. Nelson, Industrial Risk Insurers

Henry C. Scuoteguazza, Factory Mutual

Research

David Simon, Liquid Air Corp.

Rep. CGA

Lionel Wolpert, Airco Industrial Gases Div.

Rep. CGA

Alternates

William H. Barlen, Compressed Gas Assn. Inc.

(Alternate to D. Simon and L. Wolpert)

John M. Cece, US Dept. of Energy

(Alternate to C. A. Caves)

Tommy E. England, Industrial Risk Insurers

(Alternate to D. F. Nelson)

Marvin E. Kennebeck, Jr., American Welding
Society

(Alternate to AWS Rep.)

(Vote limited to NFPA 51)

Nonvoting

L. G. Matthews, Las Cruces, NM

(Member Emeritus)

Theodore C. Lemoff, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 General	50- 5
1-1 Introduction.	50- 5
1-2 Application.	50- 5
1-3 Definitions.	50- 5
Chapter 2 Siting	50- 6
2-1 Location of Bulk Oxygen Systems.	50- 6
2-2 Distance between Bulk Oxygen Systems and Exposures.	50- 6
Chapter 3 System Fabrication	50- 7
3-1 Bulk Oxygen Storage Containers.	50- 7
3-2 Piping, Tubing, and Fittings.	50- 8
3-3 Safety Relief Devices.	50- 8
3-4 Liquid Oxygen Vaporizers.	50- 8
3-5 Equipment Assembly and Installation.	50- 8
Chapter 4 Operation and Maintenance	50- 8
4-1 Operating Instructions.	50- 8
4-2 Maintenance.	50- 8
Chapter 5 Referenced Publications	50- 9
Appendix A	50- 9
Appendix B Referenced Publications	50-10
Index	50-10

NFPA 50**Standard for****Bulk Oxygen Systems at Consumer Sites****1990 Edition**

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 5 and Appendix B.

Chapter 1 General**1-1 Introduction.**

1-1.1 Oxygen gas is colorless, odorless, tasteless, and non-toxic. It comprises about 21 percent of normal air and is about 10 percent heavier than air. At atmospheric pressure and temperatures below -297°F (-182.5°C) oxygen is a liquid. Oxygen is stable in both gas and liquid phases. In the absence of moisture, oxygen in the gaseous or liquid form is noncorrosive.

1-1.2 Oxygen is nonflammable. Ignition of combustible materials may occur more readily in an oxygen-rich atmosphere than in air, and combustion proceeds at a faster rate although no more total heat is released. This standard, therefore, provides primarily for protection of the bulk oxygen system from involvement by fire from sources apart from the system itself. It is important to locate bulk oxygen systems in well-ventilated locations since oxygen-rich atmospheres may collect temporarily in confined areas in the event of functioning of a safety relief device or leakage from the system.

1-1.3* Oxygen system components, including, but not limited to, containers, valves, valve seats, lubricants, fittings, gaskets, and interconnecting equipment including hoses, shall have adequate compatibility with oxygen under the conditions of temperature and pressure to which the components may be exposed in the containment and use of oxygen. Easily ignitable materials shall be avoided unless they are parts of equipments or systems that are approved, listed, or proved suitable by tests or by past experience.

1-2 Application.

1-2.1 This standard covers the general principles recommended for the installation of bulk oxygen systems on consumer premises where the supply to the consumer premises originates outside the consumer premises and is delivered by mobile equipment.

1-2.2 An existing system that is not in strict compliance with the provisions of this standard may be continued in use when such use does not constitute a distinct hazard to life or adjoining property.

1-2.3 This standard does not apply to oxygen manufacturing plants or other establishments operated by the oxygen supplier or his agent for the purpose of storing oxygen and refilling portable containers, trailers, mobile supply trucks, or tank cars.

1-2.4 This standard does not apply to oxygen storage systems having capacities less than those stated in the definition of Bulk Oxygen System in Section 1-3 since those systems are covered by NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes*, and NFPA 99, *Standard for Health Care Facilities* (Chapter 4, Gas and Vacuum Systems).

1-2.5 When a bulk oxygen system is intended for medical gas applications, additional provisions are included in NFPA 99, *Standard for Health Care Facilities*.

1-3 Definitions. For the purpose of the standard, the following terms are defined:

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Bulk Oxygen System. A bulk oxygen system is an assembly of equipment, such as oxygen storage containers, pressure regulators, safety devices, vaporizers, manifolds, and interconnecting piping, that has a storage capacity of more than 20,000 cu ft (566 m³) of oxygen (NTP) including unconnected reserves on hand at the site. The bulk oxygen system terminates at the point where oxygen at service pressure first enters the supply line. The oxygen containers may be stationary or movable, and the oxygen may be stored as gas or liquid.

Combustible Liquid. Combustible liquid shall mean a liquid having a closed cup flash point at or above 100°F (37.8°C) and shall be subdivided as follows: Class II liquids shall include those having a flash point at or above 100°F (37.8°C)

and below 140°F (60°C). Class IIIA liquids shall include those having a flash point at or above 140°F (60°C) and below 200°F (93.4°C). Class IIIB liquids shall include those having flash points at or above 200°F (93.4°C).

Cubic Foot. Cubic foot of gas at 14.7 psia (101 kPa) and 70°F (21°C).

Fire-Resistive Construction. A type of building construction as defined in NFPA 220, *Standard on Types of Building Construction*.

Flammable Liquid. Flammable liquid Class I shall mean any liquid having a closed cup flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 psia (276 kPa) at 100°F (37.8°C).

Gallon. A standard U.S. gallon.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Noncombustible/Limited-Combustible Construction. A type of building construction as defined in NFPA 220, *Standard on Types of Building Construction*.

Noncombustible Material (as defined in NFPA 220, *Standard on Types of Building Construction*). A material which, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat. Materials reported as noncombustible, when tested in accordance with ASTM E-136, *Standard Method of Test for Behavior of Materials in a Vertical Tube Furnace at 750°C*, shall be considered noncombustible materials.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Wood Frame Construction. A type of building construction as defined in NFPA 220, *Standard on Types of Building Construction*.

Chapter 2 Siting

2-1 Location of Bulk Oxygen Systems.

2-1.1 Bulk oxygen storage systems shall be located above-ground out of doors, or shall be installed in a building of fire-resistive or noncombustible/limited-combustible construction,

adequately vented, and used for that purpose exclusively. The location selected shall be such that containers and associated equipment shall not be beneath or exposed by the failure of electric power lines, piping containing all classes of flammable or combustible liquids (*see Definitions*), or piping containing flammable gases.

2-1.2 The system shall be located so that it is readily accessible to mobile supply equipment at ground level and to authorized personnel. Bulk oxygen systems shall not be located on rooftops of buildings or other structures.

2-1.3 On bulk liquid oxygen storage systems, the tank's liquid delivery connections, pressure relief device outlets, and the mobile supply equipment withdrawal connection shall be at least 8 ft (2.5 m) from the inlet of underground sewer systems.

2-1.4 Where oxygen is stored as a liquid, surfacing of noncombustible material shall be provided at ground level under liquid delivery connections for the storage container and mobile supply equipment. This area of noncombustible surfacing shall be at least 3 ft (1 m) in diameter from points at ground level upon which leakage of liquid oxygen might fall during unloading and normal operation of the system. The area under the mobile supply equipment shall be at least the full width of the vehicle and at least 8 ft (2.5 m) in the direction of the vehicle axis. For purposes of this standard, asphaltic or bitumastic paving is considered to be combustible. The slope, if any, of such areas shall consider possible flow of spilled liquid oxygen to adjacent combustible material. If expansion joints are used, fillers shall also be of noncombustible materials.

2-1.5* Where it is necessary to locate a bulk oxygen system on ground lower than all classes of adjacent flammable or combustible liquid storage, suitable means shall be taken (such as by diking, diversion curbs, or grading) with respect to the adjacent flammable or combustible liquid storage to prevent accumulation of liquids under the bulk oxygen system.

2-2* Distance between Bulk Oxygen Systems and Exposures.

2-2.1 Except as provided in 2-2.1.14, the minimum distance from any bulk oxygen storage container to exposures, measured in the most direct line (except as indicated in 2-2.1.5 and 2-2.1.11), shall be as indicated in 2-2.1.1 to 2-2.1.14 inclusive.

2-2.1.1 50 ft (15 m) from buildings of wood frame construction.

2-2.1.2 Not less than 1 ft (0.3 m) (or other distance to permit system maintenance) from buildings of other than wood frame construction.

2-2.1.3 At least 10 ft (3 m) from any opening in walls of adjacent structures. This provision shall apply to all elements of a bulk oxygen system where the oxygen storage is high pressure gas. Where the storage is as liquid, this provision shall apply to only pressure regulators, safety devices, vaporizers, manifolds, and interconnecting piping.

2-2.1.4 All Classes of Flammable and Combustible Liquid Storage Aboveground.

Distance		Capacity	
(ft)	(m)	(gal)	(L)
25*	(7.5)	1000 or less	(3785)
50*	(15)	1001 or more	(3789)

*May be reduced to 15 ft (4.6 m) for Class IIIB combustible liquids.

2-2.1.5 All Classes of Flammable and Combustible Liquid Storage Belowground.

Distance Measured Horizontally from Oxygen Storage Container to Tank		Distance from Oxygen Storage Container to Filling and Vent Connections or Openings to Tank	
(ft)	(m)	(ft)	(m)
15	(4.6)	25	(7.5)

2-2.1.6 Flammable Gases Aboveground.

Flammable Gas	Quantity	Distance	
		(ft)	(m)
Liquefied Hydrogen*	Any	75	22.5
Other Liquefied Gases	1000 gal (3785 L) or less	25	7.5
	Over 1000 gal (3785 L)	50	15
Non-liquefied or Dissolved Gases	25,000 cu ft (708 m ³) (NTP) or less	25	7.5
	Over 25,000 cu ft (708 m ³) (NTP)	50	15

*See NFPA 50B, *Standard for Liquefied Hydrogen Systems at Consumer Sites*.

2-2.1.7 50 ft (15 m) from solid materials that burn rapidly, such as excelsior or paper.

2-2.1.8 25 ft (7.5 m) from solid materials that burn slowly, such as coal and heavy timber.

2-2.1.9 75 ft (22.5 m) in one direction and 35 ft (11 m) in approximately 90° direction from confining walls [not including protective structures having a minimum fire resistance rating of two hours less than 12 ft (3.7 m) high] to provide adequate ventilation in courtyards and similar confining areas.

2-2.1.10 50 ft (15 m) from places of public assembly.

2-2.1.11 50 ft (15 m) in a direct line from the inner container pressure relief device discharge piping outlets and filling and vent connections from areas occupied by nonambulatory patients.

2-2.1.12 10 ft (3 m) from any public sidewalk or parked vehicles.

2-2.1.13 5 ft (1.5 m) from any line of adjoining property that may be built upon.

2-2.1.14 The distances in 2-2.1.1, 2-2.1.4 to 2-2.1.8 inclusive, 2-2.1.12, and 2-2.1.13 do not apply where protective structures having a minimum fire resistance of 2 hours interrupt the line-of-sight between uninsulated portions of the bulk oxygen storage installation and the exposure. In such cases, the bulk oxygen installation shall be a minimum distance of 1 ft (0.3 m) (or greater distance if required for system maintenance) from the protective structure.

The protective structure (in lieu of distance) protects uninsulated oxygen storage containers or supports, control equipment enclosures, and system piping (or parts thereof) from external fire exposure. Liquid oxygen storage containers are insulated. Such containers can provide line-of-sight protection for uninsulated system components.

Protective structure configuration and dimensions will, therefore, vary depending upon the components of a particular system and their spatial relation to each other and to the exposure.

Chapter 3 System Fabrication**3-1 Bulk Oxygen Storage Containers.**

3-1.1 Foundations and Supports. Permanently installed containers shall be provided with substantial supports of noncombustible material on firm foundations of noncombustible material.

3-1.2 Liquid oxygen containers shall comply with 3-1.2.1 or 3-1.2.2.

3-1.2.1 Be fabricated from materials meeting the impact test requirements of Paragraph UG-84 of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels. Containers operating at pressures above 15 psig (103 kPa) shall be designed, constructed, and tested in accordance with appropriate requirements of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels. Insulation surrounding the liquid oxygen container shall be of noncombustible material.

3-1.2.2 Be designed, constructed, tested, and maintained in accordance with U.S. Department of Transportation (DOT) Specifications and Regulations for 4L containers.

3-1.3 High-pressure gaseous oxygen containers shall comply with 3-1.3.1 or 3-1.3.2.

3-1.3.1 Be designed, constructed, and tested in accordance with appropriate requirements of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels.

3-1.3.2 Be designed, constructed, tested, and maintained in accordance with U.S. Department of Transportation (DOT) Specifications and Regulations.

3-2 Piping, Tubing, and Fittings.

3-2.1 Piping, tubing, and fittings shall be suitable for oxygen service and for the pressures and temperatures involved.

3-2.2 Material specifications and thickness requirements for piping and tubing shall conform to ANSI/ASME B31.3, *Code for Chemical Plant and Petroleum Refinery Piping*.

3-2.3* Piping or tubing for operating temperatures below -20°F (-28.9°C) shall be fabricated from materials meeting the impact test requirements of Chapter III of ANSI/ASME B31.3, *Code for Chemical Plant and Petroleum Refinery Piping*, when tested at the minimum operating temperature to which the piping may be subjected in service.

3-3 Safety Relief Devices.

3-3.1 Bulk oxygen storage containers, regardless of design pressure, shall be equipped with safety relief devices as required by the ASME Code or the DOT Specifications and Regulations. (*See Section 3-1.*)

3-3.2 Bulk oxygen storage containers designed and constructed in accordance with DOT Specifications (*see 3-1.3.2*) shall be equipped with safety relief devices as required by the DOT.

3-3.3 Bulk oxygen storage containers designed and constructed in accordance with the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels, shall be equipped with safety relief devices meeting the provisions of CGA Publication S-1.3, *Safety Relief Device Standards for Compressed Gas Storage Containers*.

3-3.4 Insulation casing on liquid oxygen containers shall be equipped with suitable safety relief devices.

3-3.5 All safety relief devices shall be so designed or located that moisture cannot collect and freeze in a manner that would interfere with proper operation of the device.

3-4 Liquid Oxygen Vaporizers.

3-4.1 The vaporizer shall be anchored and its connecting piping be sufficiently flexible to provide for the effects of expansion and contraction due to temperature changes.

3-4.2 The vaporizer and its piping shall be adequately protected on the oxygen and heating medium sections with safety relief devices.

3-4.3 Heat used in an oxygen vaporizer shall be indirectly supplied only through mediums such as steam, air, water, or water solutions that do not react with oxygen.

3-4.4 If electric heaters are used to provide the primary source of heat, the vaporizing system shall be electrically grounded.

3-5 Equipment Assembly and Installation.

3-5.1 Equipment making up a bulk oxygen system shall be cleaned in order to remove oil, grease, or other readily oxidizable materials before placing the system in service.

3-5.2 Joints in piping and tubing may be made by welding or brazing, or by use of flanged, threaded, socket, slip, or compression fittings. Gaskets or thread sealants shall be suitable for oxygen service. Brazing materials shall have a melting point above 1000°F (538°C).

3-5.3 Valves, gages, regulators, and other accessories shall be suitable for oxygen service.

3-5.4 Installation of bulk oxygen systems shall be supervised by personnel familiar with proper practices with reference to their construction and use.

3-5.5 After installation all field-erected piping shall be tested and proved gastight at maximum operating pressure. Any medium used for testing shall be oil-free and nonflammable.

3-5.6 Storage containers, piping, valves, regulating equipment, and other accessories shall be protected against physical damage and against tampering by the general public.

3-5.7 Any enclosure containing oxygen control or operating equipment shall be adequately vented.

3-5.8 The bulk oxygen storage location shall be permanently placarded to indicate: "OXYGEN — NO SMOKING — NO OPEN FLAMES," or an equivalent warning.

3-5.9 Bulk oxygen installations are not hazardous (classified) locations as defined and covered in Article 500 of NFPA 70, *National Electrical Code*®. Therefore, general purpose or weatherproof types of electrical wiring and equipment are acceptable depending upon whether the installation is indoors or outdoors. Such equipment shall be installed in accordance with the applicable provisions of NFPA 70, *National Electrical Code*.

Chapter 4 Operation and Maintenance

4-1 Operating Instructions. For installations that require any operation of equipment by the user, legible instructions shall be maintained at operating locations.

4-2 Maintenance.

4-2.1 Each bulk oxygen system installed on consumer premises shall be inspected annually and maintained by a qualified representative of the equipment owner.

4-2.2 Weeds and long dry grass shall be cut back within 15 ft (4.6 m) of any bulk oxygen storage container.

Chapter 5 Referenced Publications

5-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

5-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 70-1990, *National Electrical Code*

NFPA 220-1985, *Standard on Types of Building Construction*.

5-1.2 ASME Publications. American Society of Mechanical Engineers, 345 East 47th St., New York, NY 10017.

ANSI/ASME B31.3 (1987), *Code for Chemical Plant and Petroleum Refinery Piping*

ASME Boiler and Pressure Vessel Code (1986).

5-1.3 CGA Publications. Compressed Gas Association, Inc., 1235 Jefferson Davis Highway, Arlington, VA 22202.

S-1.3, *Safety Relief Device Standards for Compressed Gas Storage Containers* (1980).

5-1.4 ASTM Publications. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM E-136-1982, *Standard Method of Test for Behavior of Materials in a Vertical Tube Furnace at 750°C*.

5-1.5 U.S. Government Publications. The following publication is available from the U.S. Government Printing Office, Washington, DC 20402.

DOT Specifications and Regulations. Code of Federal Regulations. *Title 49, Transportation, Parts 171-190*. (Also available from the Association of American Railroads, American Railroads Bldg., 1920 L St. NW, Washington, DC 20036, and American Trucking Assn., Inc., 1916 P St. NW, Washington, DC 20036.)

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-1-1.3 Compatibility involves both combustibility and ease of ignition. Materials that burn in air will burn violently in pure oxygen at normal pressure and explosively in pressurized oxygen. Also many materials that do not burn in air will do so in pure oxygen, particularly under pressure. Metals for containers and piping must be carefully selected, depending on service conditions. The various steels are acceptable for many applications, but some service conditions may call for other materials (usually copper or its alloys) because of their greater resistance to ignition and lower rate of combustion.

Similarly, materials that can be ignited in air have lower ignition energies in oxygen. Many such materials may be ignited by friction at a valve seat or stem packing or by adiabatic compression produced when oxygen at high pressure is rapidly introduced into a system initially at low pressure.

A-2-1.5 When locating bulk oxygen systems near all classes of aboveground flammable or combustible liquid storage that may be either indoors or outdoors, it is advisable to locate the system on ground higher than the flammable or combustible liquid storage.

A-2-2 The following diagram serves to illustrate the separation distances between bulk oxygen systems and exposures:

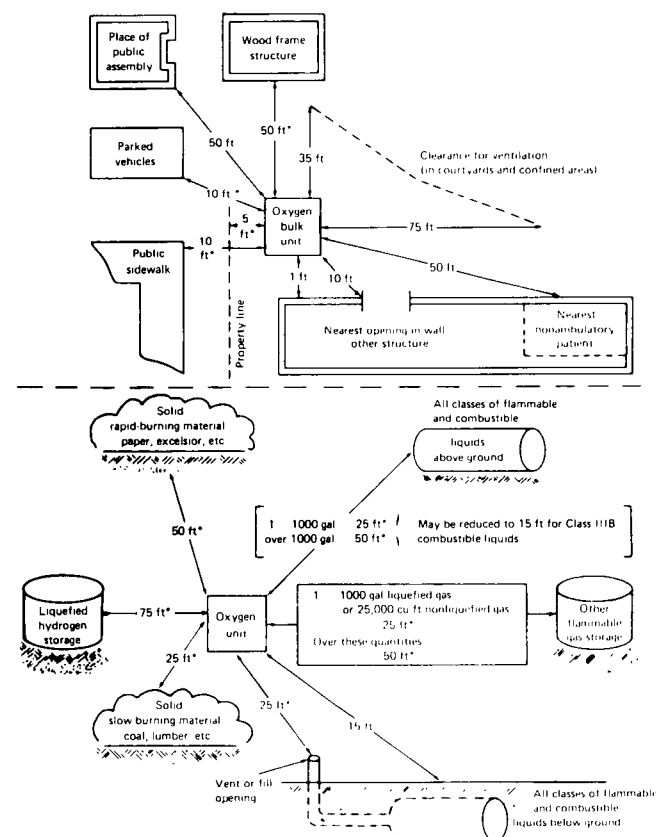


Illustration of Section 2-2, Distance Between Bulk Oxygen Systems and Exposures. (This diagram is not a part of NFPA 50, and the text shall govern.)

***NOTE:** These distances do not apply where protective structures having a minimum fire resistance rating of two hours interrupt the line-of-sight between uninsulated portions of the bulk oxygen storage installation and the exposure. The protective structures protect uninsulated oxygen storage containers or supports, control equipment, and system piping (or parts thereof) from external fire exposure. Liquid oxygen storage containers are insulated. Such containers may provide line-of-sight protection for uninsulated system components. (See 2-2.1.14.)

A-3-2.3 Some materials suitable for low temperature piping are austenitic chromium-nickel alloy steels, copper, copper-silicon alloys, aluminum, and some brasses and bronzes.

Appendix B Referenced Publications

B-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

B-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 50B-1989, *Standard for Liquefied Hydrogen Systems at Consumer Sites*

NFPA 51-1987, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes*

NFPA 99-1990, *Standard for Health Care Facilities*.

Index

©1990 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-	-G-
Application of standard 1-2	Gallon Definition 1-3 Gases, flammable, aboveground 2-2.1.6
-B-	-I-
Bulk oxygen system Definition 1-3	Installation of system 3-5 Instructions, operating 4-1
-C-	-L-
Compatibility of system components 1-1.3, A-1-1.3 Construction Fire-resistive Definition 1-3 Noncombustible/limited-combustible Definition 1-3 Wood frame Definition 1-3 Containers, bulk oxygen storage 3-1 Foundations and supports 3-1.1 Cubic foot Definition 1-3	Liquids Flammable and combustible Definitions 1-3 Storage aboveground 2-2.1.4 Storage belowground 2-2.1.5 Location of system 2-1, A-2-1.4
-D-	-M-
Distances between systems and exposures 2-2, A-2-2	Maintenance 4-2
-E-	-N-
Equipment, assembly and installation 3-5	Noncombustible material Definition 1-3
-F-	-O-
Fabrication of system Chap. 3 Fittings 3-2	Operations Chap. 4 Oxygen, characteristics of 1-1.1, 1-1.2

-P-

Paving requirements 2-1.4
Piping 3-2, A-3-2.3

-S-

Safety relief devices 3-3
Siting Chap. 2

Storage

Flammable and combustible liquids 2-2.1.4, 2-2.1.5
Flammable gases 2-2.1.6

-T-

Tubing 3-2

-V-

Vaporizers, liquid oxygen 3-4, A-3-2.3

The NFPA Codes and Standards Development Process

Since 1896, one of the primary purposes of the NFPA has been to develop and update the standards covering all areas of fire safety.

Calls for Proposals

The code adoption process takes place twice each year and begins with a call for proposals from the public to amend existing codes and standards or to develop the content of new fire safety documents.

Report on Proposals

Upon receipt of public proposals, the technical committee members meet to review, consider, and act on the proposals. The public proposals – together with the committee action on each proposal and committee-generated proposals – are published in the NFPA's Report on Proposals (ROP). The ROP is then subject to public review and comment.

Report on Comments

These public comments are considered and acted upon by the appropriate technical committees. All public comments – together with the committee action on each comment – are published as the Committee's supplementary report in the NFPA's Report on Comments (ROC).

The committee's report and supplementary report are then presented for adoption and open debate at either of NFPA's semi-annual meetings held throughout the United States and Canada.

Association Action

The Association meeting may, subject to review and issuance by the NFPA Standards Council, (a) adopt a report as published, (b) adopt a report as amended, contingent upon subsequent approval by the committee, (c) return a report to committee for further study, and (d) return a portion of a report to committee.

Standards Council Action

The Standards Council will make a judgement on whether or not to issue an NFPA document based upon the entire record before the Council, including the vote taken at the Association meeting on the technical committee's report.

Voting Procedures

Voting at an NFPA Annual or Fall Meeting is restricted to members of record for 180 days prior to the opening of the first general session of the meeting, except that individuals who join the Association at an Annual or Fall Meeting are entitled to vote at the next Fall or Annual Meeting.

"Members" are defined by Article 3.2 of the Bylaws as individuals, firms, corporations, trade or professional associations, institutes, fire departments, fire brigades, and other public or private agencies desiring to advance the purposes of the Association. Each member shall have one vote in the affairs of the Association. Under Article 4.5 of the Bylaws, the vote of such a member shall be cast by that member individually or by an employee designated in writing by the member of record who has registered for the meeting. Such a designated person shall not be eligible to represent more than one voting privilege on each issue, nor cast more than one vote on each issue.

Any member who wishes to designate an employee to cast that member's vote at an Association meeting in place of that member must provide that employee with written authorization to represent the member at the meeting. The authorization must be on company letterhead signed by the member of record, with the membership number indicated, and the authorization must be recorded with the President of NFPA or his designee before the start of the opening general session of the Meeting. That employee, irrespective of his or her own personal membership status, shall be privileged to cast only one vote on each issue before the Association.

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council

National Fire Protection Association, 1 Batterymarch Park, Quincy, Massachusetts 02269-9101

Fax No. 617-770-3500

Note: All proposals must be received by 5:00 p.m. EST/EDST on the published proposal-closing date.

If you need further information on the standards-making process, please contact the
Standards Administration Department at 617-984-7249.

Date 9/18/93 Name John B. Smith Tel. No. 617-555-1212

Company _____

Street Address 9 Seattle St., Seattle, WA 02255

Please Indicate Organization Represented (if any) Fire Marshals Assn. of North America

1. a) NFPA Document Title National Fire Alarm Code NFPA No. & Year NFPA 72, 1993 ed.

b) Section/Paragraph 1-5.8.1 (Exception No.1)

2. Proposal recommends: (Check one) ☐ new text
☐ revised text
☒ deleted text

FOR OFFICE USE ONLY

Log # _____

Date Rec'd _____

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

Delete exception.

4. **Statement of Problem and Substantiation for Proposal:** (Note: State the problem that will be resolved by your recommendation; give the specific reason for your proposal including copies of tests, research papers, fire experience, etc. If more than 200 words, it may be abstracted for publication.)

A properly installed and maintained system should be free of ground faults. The occurrence of one or more ground faults should be required to cause a "trouble" signal because it indicates a condition that could contribute to future malfunction of the system. Ground fault protection has been widely available on these systems for years and its cost is negligible. Requiring it on all systems will promote better installations, maintenance and reliability.

5. ☒ **This Proposal is original material.** (Note: Original material is considered to be the submitter's own idea based on or as a result of his/her own experience, thought, or research and, to the best of his/her knowledge, is not copied from another source.)

☐ **This Proposal is not original material; its source (if known) is as follows:** _____

Note 1: Type or print legibly in black ink.

Note 2: If supplementary material (photographs, diagrams, reports, etc.) is included, you may be required to submit sufficient copies for all members and alternates of the technical committee.

I hereby grant NFPA the non-exclusive, royalty-free rights, including non-exclusive, royalty-free rights in copyright, in this proposal and I understand that I acquire no rights in any publication of NFPA in which this proposal in this or another similar or analogous form is used.

John B. Smith
Signature (Required)

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL

Sequence of Events Leading to Publication of an NFPA Committee Document

Call for proposals to amend existing document or for recommendations on new document.



Committee meets to act on proposals, to develop its own proposals, and to prepare its report.



Committee votes on proposals by letter ballot. If two-thirds approve, report goes forward.
Lacking two-thirds approval, report returns to committee.



Report is published for public review and comment. (Report on Proposals - ROP)



Committee meets to act on each public comment received.



Committee votes on comments by letter ballot. If two-thirds approve, supplementary report goes forward. Lacking two-thirds approval, supplementary report returns to committee.



Supplementary report is published for public review. (Report on Comments - ROC).



NFPA membership meets (Annual or Fall Meeting) and acts on committee report (ROP and ROC).



Committee votes on any amendments to report approved at NFPA Annual or Fall Meeting.



Complaints to Standards Council on Association action must be filed
within 20 days of the NFPA Annual or Fall Meeting.



Standards Council decides, based on all evidence, whether or not to issue standard
or to take other action, including hearing any complaints.



Appeals to Board of Directors on Standards Council action must be filed
within 20 days of Council action.